

STORM SEWER NOTES

(ISSUE DATE: 04-20-18)

(THESE NOTES ARE CONSIDERED SUPPLEMENTAL TO THE GENERAL CONSTRUCTION NOTES)

1. STORM SEWER CONSTRUCTION SHALL CONFORM TO THE CITY OF HUNTSVILLE SPECIFICATIONS FOR STORM SEWER CONSTRUCTION.
2. ALL STORM SEWER TO BE ASTM C-76, CLASS III REINFORCED CONCRETE PIPE WITH RUBBER GASKETED JOINTS CONFORMING TO ASTM C443. CLASS IV RCP REQUIRED UNDER PAVEMENT WITH LESS THEN 2' OF COVER.
3. ALL STORM SEWER INLETS SHALL BE BACKFILLED WITH CEMENT STABILIZED SAND (1.5 SACKS PER TON). ALL BEDDING SHALL BE CLASS "AA". ALL STORM SEWERS TO BE INSPECTED BY THE CITY PRIOR TO BACKFILL.
4. ALL STORM SEWER TRENCHES UNDER PROPOSED AND FUTURE PAVEMENT OR WITHIN THREE-FOOT (3') CLEAR DISTANCE FROM BACK OF CURB TO BE BACKFILLED WITH CEMENT STABILIZED SAND (1.5 SACKS PER TON) TO A POINT OF ONE FOOT (1') BELOW PAVEMENT SUBGRADE. THE REMAINING BACKFILL TO BE MADE WITH COMPACTED SELECT MATERIAL. COST OF BACKFILL AND BEDDING TO BE INCLUDED IN UNIT PRICE PER LINEAR FOOT OF PIPE.
5. HIGH DENSITY POLYETHYLENE PIPE MAY BE SUBSTITUTED ON PRIVATE PROPERTY AND ON PUBLIC ROW (ON A CASE-BY-CASE BASIS), APPROVED BY THE CITY ENGINEER, FOR REINFORCED CONCRETE PIPE SUBJECT TO THE FOLLOWING:
 - a) FOR PIPES 36" AND SMALLER - CEMENT STABILIZED SAND PLACED BEFORE PIPE IS LAID, TO 7" MIN. BEDDING DEPTH. FOR SEWERS 42"-60" CEMENT STABILIZED SAND PLACED BEFORE PIPE IS LAID, TO 10" MIN. BEDDING DEPTH. THE SIDES SHALL BE 12" MIN. FROM EDGE OF TRENCH TO SPRINGLINE.
 - b) CEMENT STABILIZED SAND SHALL BE THOROUGHLY RODDED, PLACED AND COMPACTED TO 95% STANDARD PROCTOR DENSITY 1'-0" ABOVE THE TOP OF PIPE, AFTER PIPE IS LAID.
 - c) PIPE AND FITTINGS: THE TYPES OF PIPE WILL BE INDICATED ON THE DRAWINGS BY THE FOLLOWING DESCRIPTION CONFORMING TO AASHTO M 252, AASHTO M 294, AND/OR AASHTO MP6-95, LATEST EDITION. PIPE DESCRIPTION: CPP (CORRUGATED POLYETHYLENE PIPE).
 - d) TYPE S (THIS PIPE SHALL HAVE A FULL CIRCULAR CROSS-SECTION, WITH AN OUTER CORRUGATED PIPE WALL AND A SMOOTH INNER LINE).
 - e) USE OF HDPE IN PUBLIC ROW MUST BE APPROVED BY THE CITY ENGINEER AND MAINTAIN A MINIMUM THREE (3') FOOT CLEAR DISTANCE FROM THE OUTER EDGE OF THE PIPE AND THE BACK OF CURB.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS



City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS CONSTRUCTION NOTES

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
0	KSJB	07/10/2018	KSJB	SD-01

NAME: CONSTRUCTION NOTES
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

PRIVATE DRAINAGE AND DETENTION POND OPERATION AND MAINTENANCE REQUIREMENTS

AS-BUILT REQUIREMENTS

1. PRIOR TO FACILITY OCCUPANCY, THE ENGINEER OF RECORD (EOR) WILL PROVIDE AS-BUILT DRAWINGS CERTIFYING THE POND SYSTEM DESIGN AND THE VALUE PROVIDED IS IN ACCORDANCE TO THE APPROVED PLANS. THE OWNER OR THEIR DESIGNATED REPRESENTATIVE WILL BE RESPONSIBLE FOR PROVIDING SIGNAGE IDENTIFYING THE RESPONSIBLE CONTACT AND PHONE NUMBER FOR CONTINUED OPERATION AND MAINTENANCE OF THE POND IN ACCORDANCE TO THE APPROVED PLANS.

SITE INSPECTIONS AND REPORTING REQUIREMENTS

1. THE OWNER OR THEIR DESIGNATED REPRESENTATIVE WILL BE RESPONSIBLE FOR INSPECTING THE SITE TO ENSURE THAT ALL SYSTEMS ARE MAINTAINED AND ARE IN GOOD WORKING CONDITION.

ROUTINE INSPECTIONS

1. ROUTINE INSPECTIONS WILL DICTATE MAINTENANCE REQUIREMENTS FOR GENERAL ITEMS AT THE SITE INCLUDING (IF APPLICABLE TO SITE), LOCKS, FENCING, SIGNAGE, AND ROAD/ACCESS CONDITIONS.
2. DEFECTIVE OR MISSING LOCKS WILL BE REPLACED AND WILL BE KEYED TO MATCH ALL OTHER SITE LOCKS.
3. MISSING OR DAMAGE CHAIN LINK FENCE WILL BE REPAIRED OR REPLACED, AS NEEDED. FENCING REPAIR OR REPLACEMENT WILL BE IN ACCORDANCE WITH SPECIFICATIONS FROM THE ORIGINAL DESIGN PLANS.
4. DAMAGE OR MISSING SIGNS WILL BE REPLACED WITH A SIMILAR TYPE SIGN.
5. ROADWAY SURFACES WHICH ARE DAMAGED WILL BE REPAIRED IN ACCORDANCE TO THE ORIGINAL PLAN SPECIFICATIONS.
6. SURFACE WATER DITCHES AND DETENTION PONDS WILL BE OBSERVED FOR EROSION OR SEDIMENT BUILD-UP, WHICH COULD RESULT IN OVERTOPPING AND SEVER EROSION DOWN-SLOPE.

SPECIAL INSPECTIONS AFTER MAJOR HURRICANE OR TORNADO EVENTS

1. SPECIAL UNSCHEDULED INSPECTIONS WILL BE CONDUCTED AS NECESSARY AT THE SITE AFTER MAJOR HURRICANE OR TORNADO EVENTS. EVERY ATTEMPT WILL BE MADE TO HAVE THESE INSPECTIONS CONDUCTED WITHIN SEVERAL DAYS AFTER THE STORM EVENT TO ENSURE FENCING IS STILL IN PLACE AND MAJOR DAMAGE TO THE FACILITIES HAS NOT OCCURRED. ANY REPAIR WILL BE CONDUCTED AS SOON AS POSSIBLE.

MONTHLY MAINTENANCE

1. THE MAJORITY OF THE SITE WAS PLANTED WITH A TYPE OF DEFINITIVE GRASS, AS NOTED ON THE PLANS. TYPICALLY, THESE AREAS WILL REQUIRE MOWING TWICE A MONTH FROM APRIL THROUGH OCTOBER, AND MONTHLY MOWING FROM NOVEMBER THROUGH MARCH.

ANNUAL MAINTENANCE

1. ANNUAL MAINTENANCE OF THE SITE MAY INCLUDE FERTILIZING AND RESEEDING THE SITE, AS NECESSARY.

SURFACE MAINTENANCE

1. INSPECTIONS PERFORMED AS PART OF THE SCHEDULED ROUTINE INSPECTIONS AT THE SITE, WILL DICTATE MAINTENANCE REQUIREMENTS FOR THE SITE. THE ITEMS TO BE ROUTINELY INSPECTED INCLUDE SURFACE WATER RUNOFF CONTROL, PONDED WATER, PRESENCE OR EROSION OR GULLYING, AND WHETHER OR NOT THE TOPSOIL AND VEGETATION ARE INTACT.
2. THE SITE WILL BE INSPECTED TO DETERMINE WHETHER IT DRAINS WITHOUT PONDING AND EROSION.
3. TOPSOIL WILL BE INSPECTED FOR EROSION, SETTLEMENT, AND CRACKING. TOPSOIL WILL BE ADDED AS NECESSARY TO MAINTAIN DRAINAGE CHARACTERISTICS IN ACCORDANCE WITH THE ORIGINAL SPECIFICATIONS.
4. TOPOGRAPHIC SURVEYING OF THE DETENTION POND AND STORM DRAINAGE SYSTEM MAY NEED TO BE PERIODICALLY PERFORMED TO VERIFY FUNCTIONALITY OF THE SYSTEM.

SURFACE WATER MANAGEMENT SYSTEM MAINTENANCE

1. INSPECTIONS PERFORMED, AS PART OF THE SCHEDULED ROUTINE INSPECTIONS AT THE SITE WILL DICTATE MAINTENANCE REQUIREMENTS FOR THE SURFACE AFTER MANAGEMENT SYSTEM AT THE SITE. THE ITEMS TO BE ROUTINELY INSPECTED INCLUDE INLETS, CULVERTS, DRAINAGE PIPES, SEDIMENT CONTROLS, EROSION OF DRAINAGE DITCHES OR BERMS, AND THE CONDITION OF THE DETENTION PONDS.
2. INLETS CULVERTS AND PIPES WILL BE VISUALLY INSPECTED TO ENSURE THAT NO OBSTRUCTIONS ARE HINDERING THE PERFORMANCE OF THE SURFACE WATER DRAINAGE SYSTEM.
3. ANY SIGNIFICANT OBSTRUCTIONS FOUND WILL BE REMOVED.
4. INLETS ALSO WILL BE VISUALLY INSPECTED TO ENSURE THAT GRATES ARE IN PLACE.
5. ANY MISSING OR DAMAGED GRATES WILL BE REPLACED.
6. INLETS, CULVERTS, AND PIPES WILL BE VISUALLY INSPECTED FOR LEAKS OR STRUCTURAL DAMAGE.
7. ANY DAMAGED ITEMS WILL BE REPAIRED OR REPLACED IN ACCORDANCE TO WITH THE ORIGINAL SPECIFICATIONS.
8. AREAS ARE TO BE VISUALLY INSPECTED FOR SEDIMENT BUILD-UP INCLUDES DRAINAGE PIPES, DRAINAGE DITCHES AND THE AREA WITHIN THE POND SITE.
9. IF SEDIMENT BUILDUP OCCURS IN THE SURFACE WATER PIPING SYSTEM, THE SEDIMENT WILL BE CLEANED FROM THE PIPES TO MAINTAIN THEIR ORIGINAL HYDRAULIC CAPACITY.
10. IF SEDIMENT BUILDUP IS OBSTRUCTING THE NORMAL FLOW PATTERN IN THE DRAINAGE DITCHES, THE SEDIMENTS WILL BE REMOVED.
11. SURFACE WATER DITCHES AND DETENTION POND SIDE SLOPES WILL BE VISUALLY INSPECTED FOR EROSION AND GULLYING.
12. IF EROSION OCCURS IN SURFACE WATER DITCHES, TOPSOIL WILL BE ADDED AS NECESSARY TO MAINTAIN DRAINAGE CHARACTERISTICS IN ACCORDANCE TO THE ORIGINAL PLANS.
13. IF EROSION OCCURS ON THE DETENTION POND SIDE SLOPES, A FILL MATERIAL WILL BE ADDED A NECESSARY TO MAINTAIN THE ORIGINAL GRADE OF THE SLOPE.
14. THE DETENTION POND WILL BE VISUALLY INSPECTED FOR THE PRESENCE OF LITTER. ANY LITTER WILL BE REMOVED ON A CONTINUAL BASIS.

EQUIPMENT REQUIREMENTS (WHEN APPLICABLE)

1. THE EQUIPMENT MAINTENANCE REQUIREMENTS WILL BE DETERMINED BASED UPON THE MANUFACTURERS RECOMMENDATIONS AND WILL BE INCLUDED ON THE DESIGN PLANS. AT A MINIMUM, LIFT STATIONS WILL REQUIRE DUPLEX SYSTEMS. THE ENGINEER OF RECORD WILL PROVIDE FOR CITY REVIEW EQUIPMENT OPERATION AND MAINTENANCE REQUIREMENTS.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320


**CITY OF HUNTSVILLE STANDARD DETAILS
CONSTRUCTION NOTES**

NAME: CONSTRUCTION NOTES
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-02

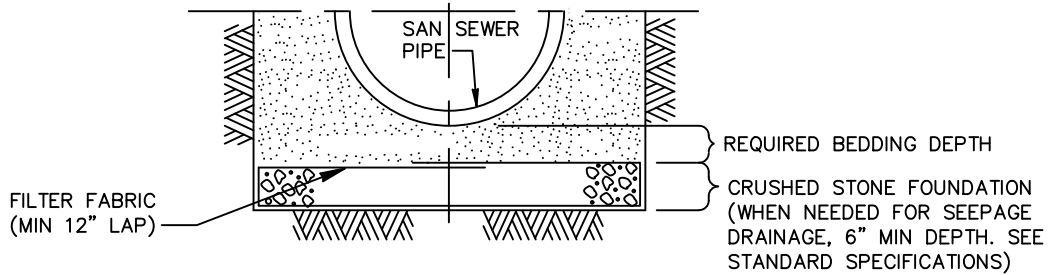

CROSS-SECTION OF CRUSHED
STONE FOUNDATION

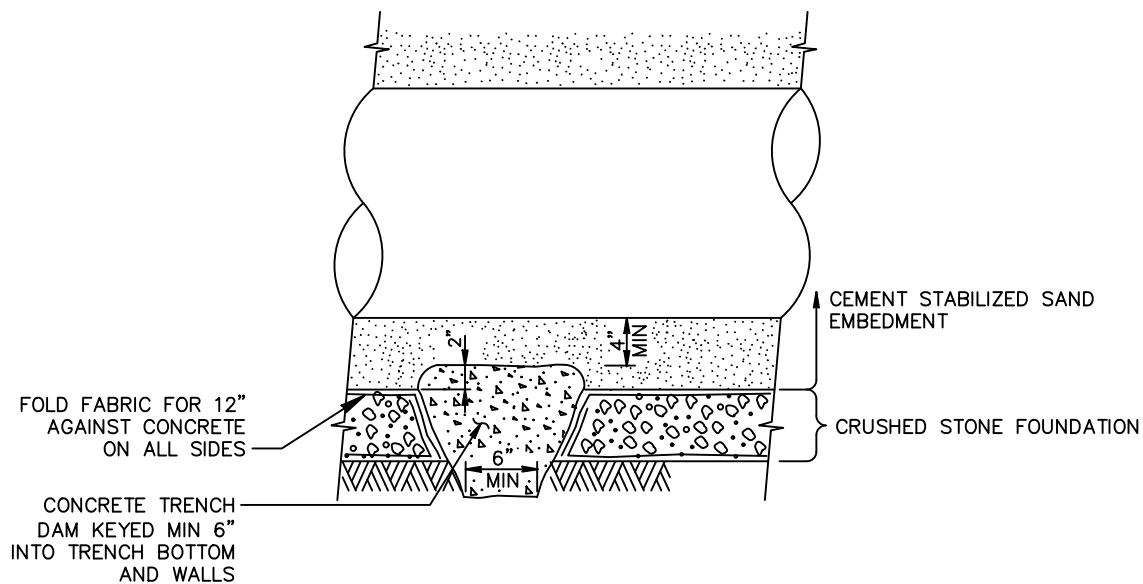

LONGITUDINAL SECTION ALONG PIPE ϕ
AT FOUNDATION TRENCH DAM

NOTES:

1. ACTUAL SHAPE OF CONCRETE TRENCH DAM CROSS SECTION MAY BE DETERMINED BY CONTRACTOR IN FIELD, MEETING MINIMUM THICKNESS AND KEY DEPTH REQUIREMENTS.
2. THIS DETAIL SHALL BE USED WITH CEMENT STABILIZED SAND EMBEDMENT, OR OTHER CLASS II EMBEDMENT, IN WET STABLE TRENCH CONDITIONS.
3. PLACE TRENCH DAMS IN CLASS I EMBEDMENT AT THE MIDPOINT OF LINE SEGMENTS LONGER THAN 100 FEET BETWEEN MANHOLES.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
STORM CRUSHED STONE FOUNDATION
FOR WET STABLE TRENCH

NAME: STM CRUSHED STONE FDN
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-03

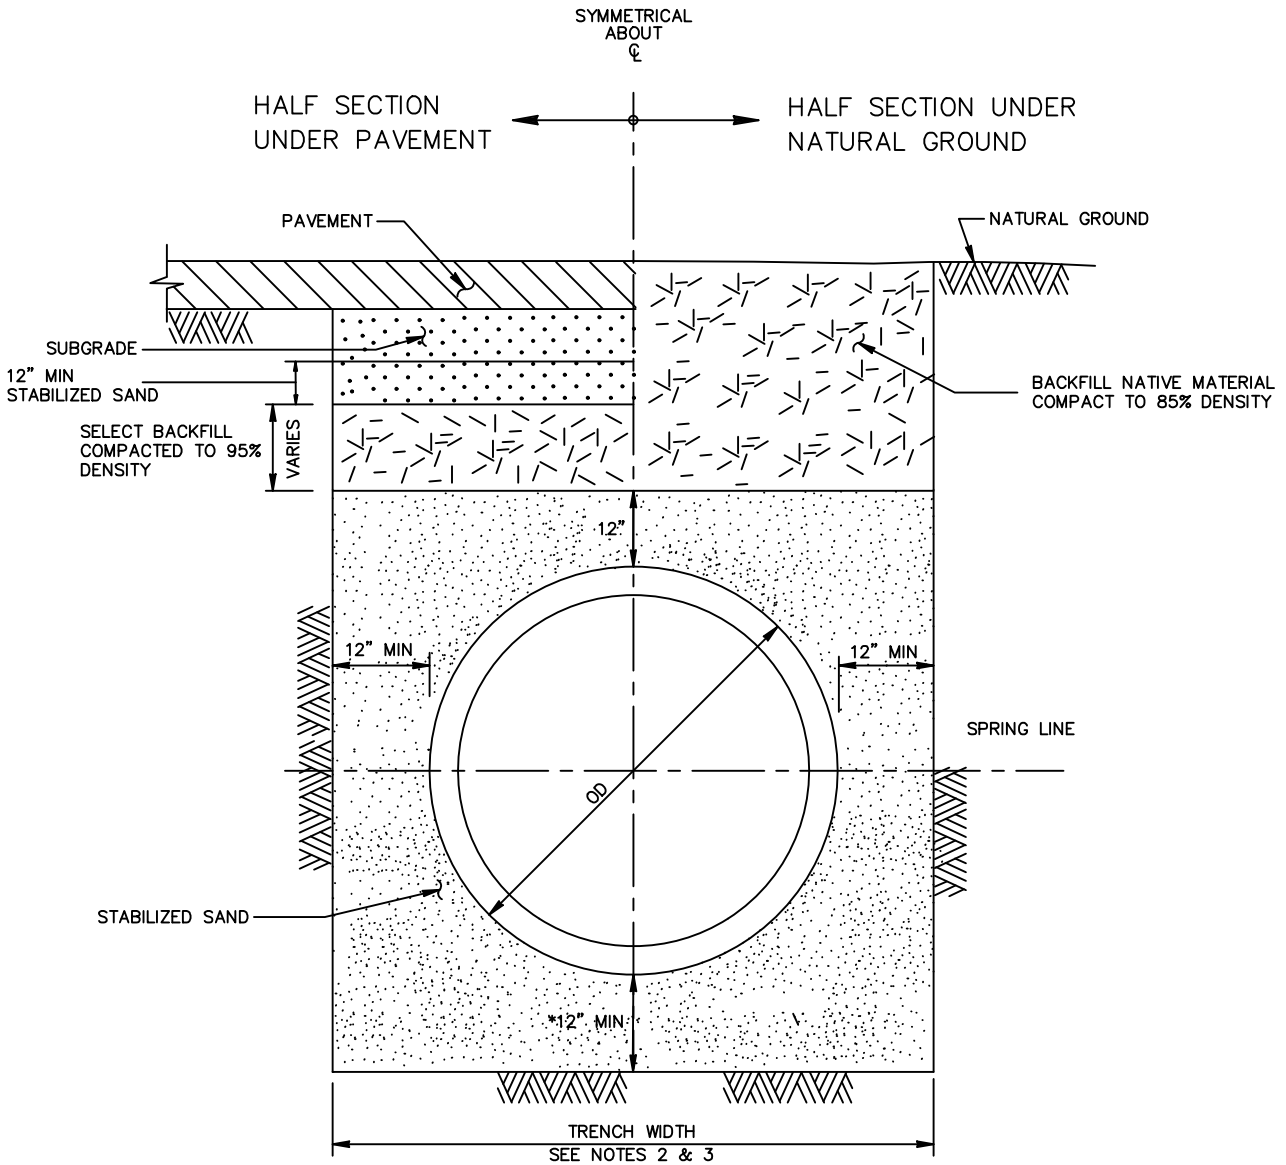

NOTES:

- WHERE WET SAND IS ENCOUNTERED, REINFORCED CONCRETE PIPE SEWERS SHALL BE CONSTRUCTED USING APPROVED SPECIAL DESIGN AS SHOWN ON DRAWINGS.
- MIN TRENCH WIDTH SHALL BE PIPE OD PLUS AN ALLOWANCE "A" FOR THE NOMINAL PIPE SIZE:

NOMINAL PIPE SIZE	"A"
18" TO 30"	24"
OVER 30"	36"
- MAX TRENCH WIDTH SHALL NOT BE GREATER THAN MIN TRENCH WIDTH PLUS 24 INCHES, UNLESS OTHERWISE NOTED.
- NOTE DETAIL SD-01 HDPE USE BACKFILL AND BEDDING REQUIREMENTS.

ENGINEERING DEPARTMENT

CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
STORM BEDDING & BACKFILL FOR DRY STABLE TRENCH

NAME: ST BEDDING & BACKFILL
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1 SD-04
0	MAM	07/10/2018		
1	MAM	10/16/2019	RAM	
2	KSJB	06/21/2022	KSJB	

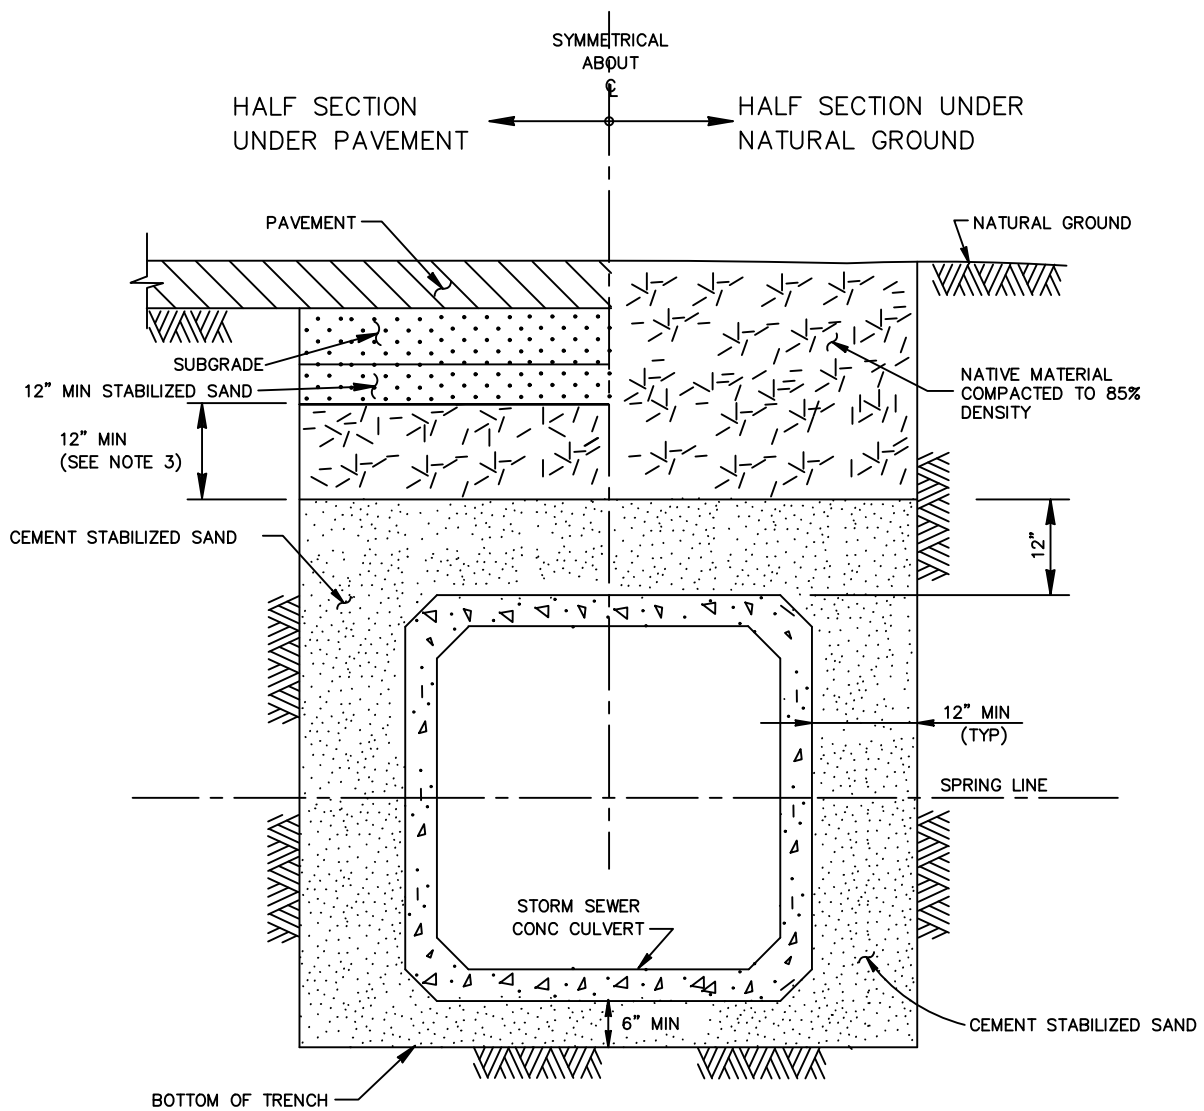

NOTES:

1. WHERE MULTIPLE BOX SEWERS ARE USED IN THE SAME TRENCH, MIN OUTSIDE TO OUTSIDE BOX SEWER SEPARATION SHALL BE 6".
2. THIS DETAIL TO BE USED ONLY WHERE SOIL CONDITIONS ARE SATISFACTORY.
3. SELECT BACKFILL FOR RIGID PAVEMENT, COMPACTED TO 95% DENSITY;
FLEXIBLE BASE MATERIAL FOR ASPHALT PAVEMENT.

ENGINEERING DEPARTMENT
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
PRECAST CONCRETE BOX FOR DRY STABLE TRENCH

NAME: PRECAST CONC. BOX
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
1	MAM	10/16/2019	RAM	SD-05

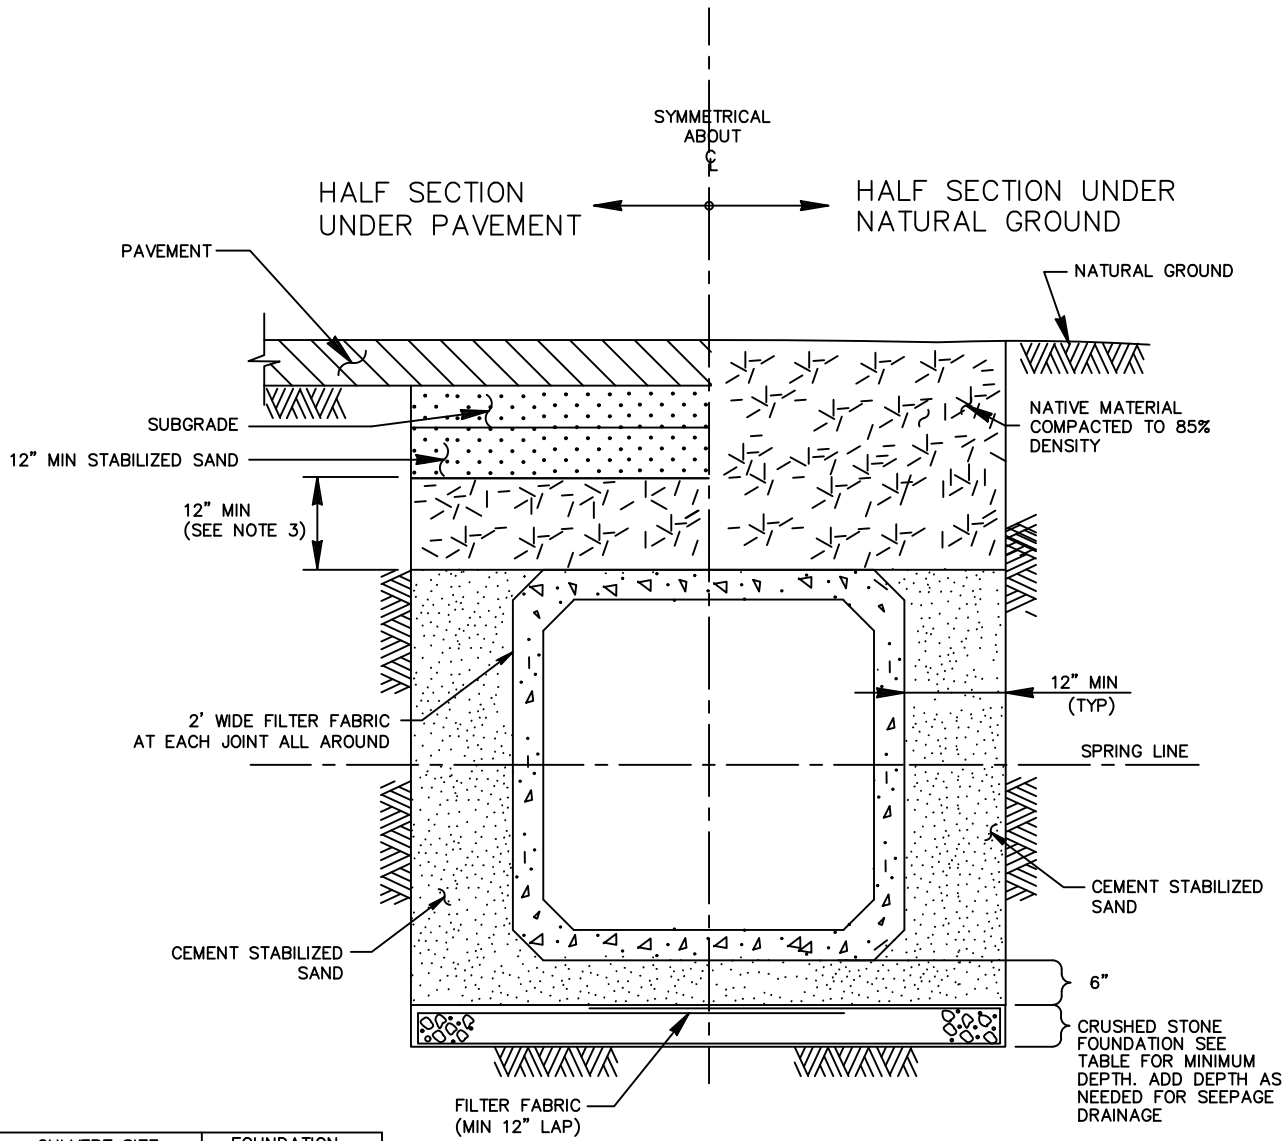

CULVERT SIZE (IN)	FOUNDATION DEPTH (IN)
3' X 2' TO 6' X 6'	12
6' X 6' AND LARGER	18

NOTES:

1. WHERE MULTIPLE BOX SEWERS ARE USED IN THE SAME TRENCH, MIN OUTSIDE TO OUTSIDE BOX SEWER SEPARATION SHALL BE 6".
2. ALTERNATE TRENCH BOTTOM TREATMENT MAY BE USED AS APPROVED BY THE CITY ENGINEER.

ENGINEERING DEPARTMENT
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
PRECAST CONCRETE BOX FOR WET STABLE TRENCH

NAME: PRECAST CONC. BOX
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
1	MAM	10/16/2019	RAM	SD-06

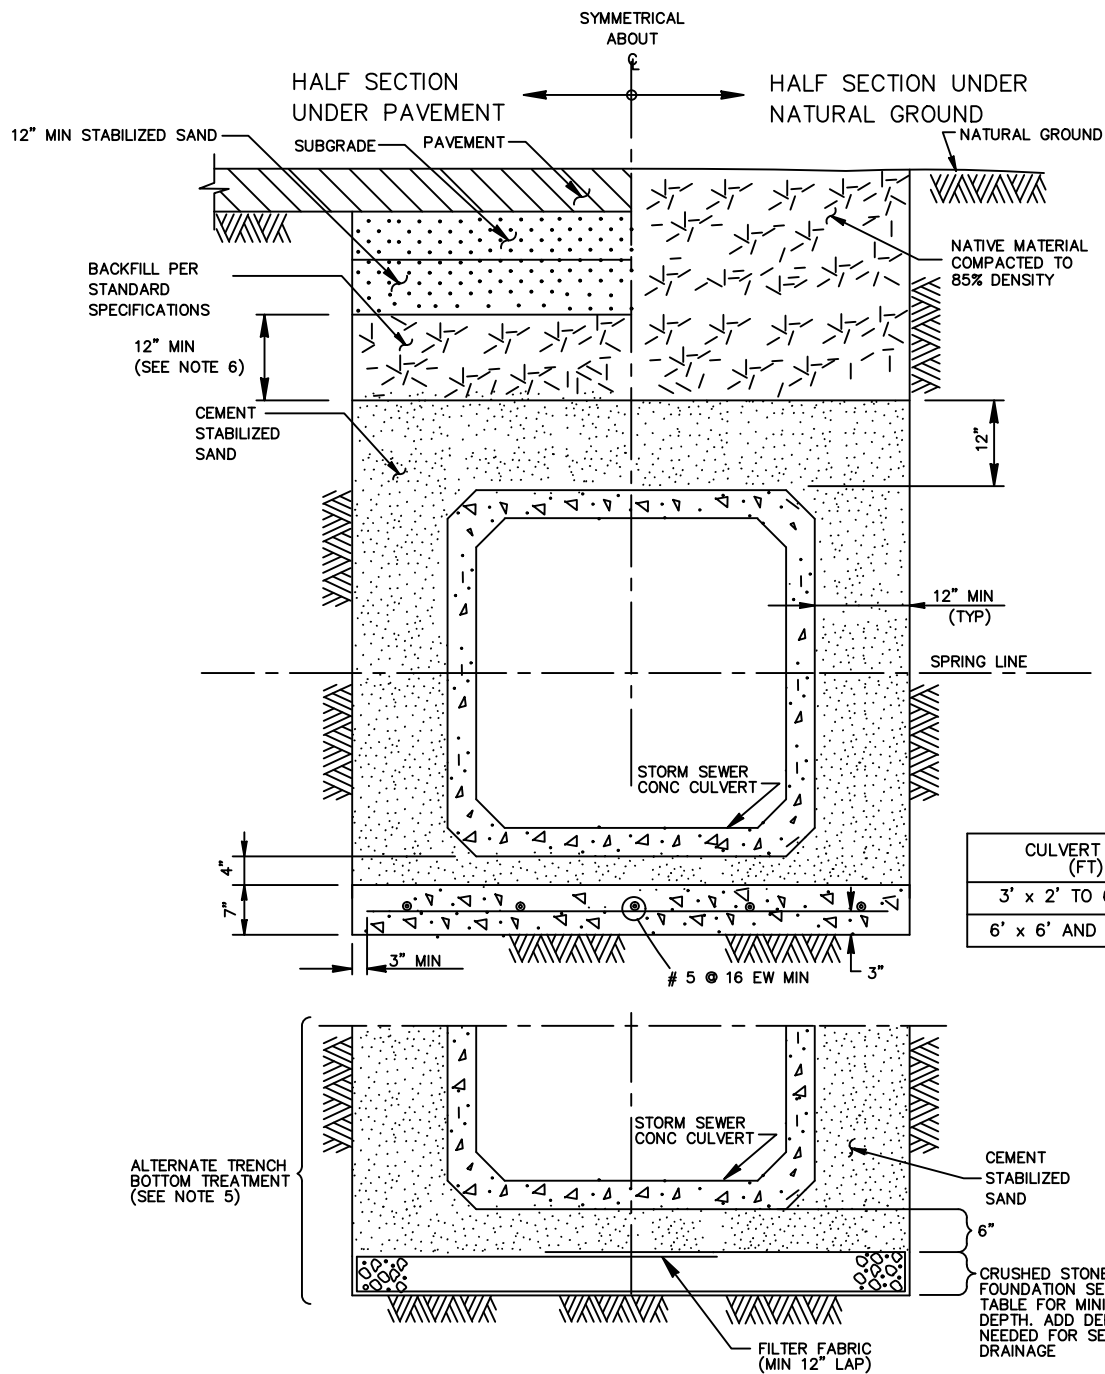

NOTES:

1. REINFORCED CONCRETE SLAB TO BE POURED IN DRY TRENCH ONLY.
2. CONCRETE SLAB TO REACH MIN COMPRESSIVE STRENGTH OF 1,000 PSI BASED ON MIX DESIGN BEFORE BOX IS LAID.
3. WHERE MULTIPLE BOX SEWERS ARE USED IN THE SAME TRENCH, MIN OUTSIDE TO OUTSIDE BOX SEWER SEPARATION SHALL BE 6".
4. THIS BEDDING DETAIL TO BE USED FOR ALL LOCATIONS WHERE SOIL CONDITION DO NOT CONFORM TO FOLLOWING REQUIREMENTS:
 - A. STRATA FROM SPRING LINE (CENTER) TO 3 FT. BELOW THE FLOW LINE OF THE BOX TO CONSIST OF NON-WATERBEARING COHESIVE SOIL.
 - B. NO WET SAND STRATA TO EXIST IN THE AREA FROM 1 FT. ABOVE THE TOP OF THE BOX TO 3 FT. BELOW THE FLOW LINE.
5. ALTERNATE TRENCH BOTTOM TREATMENT MAY BE USED AS APPROVED BY THE CITY ENGINEER AND AS PAID FOR IN THE PROPOSAL.
6. SELECT BACKFILL FOR RIGID PAVEMENT: FLEXIBLE BASE MATERIAL FOR ASPHALT PAVEMENT.

ENGINEERING DEPARTMENT

CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS PRECAST CONCRETE BOX WITH SEAL SLAB


NAME: PRECAST CONC. BOX
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
1	MAM	10/16/2019	RAM	
				SD-07


V1432-3DI Cover

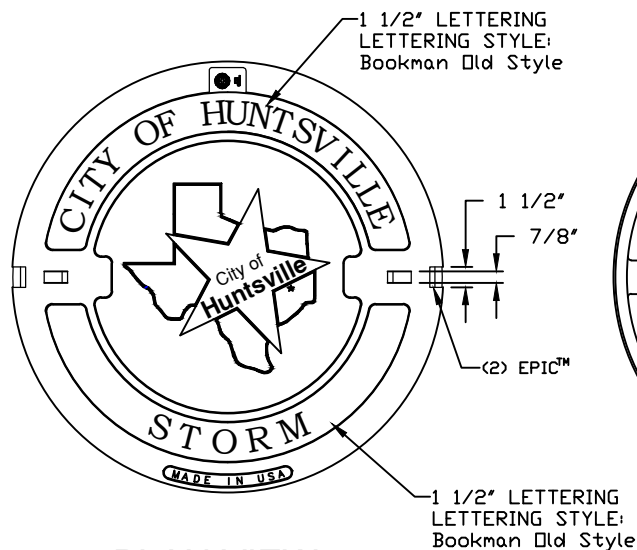


PLAN VIEW

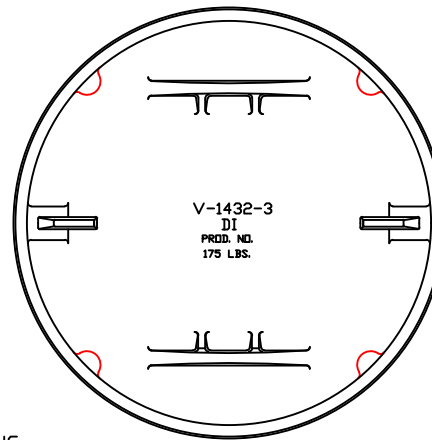

BOTTOM VIEW

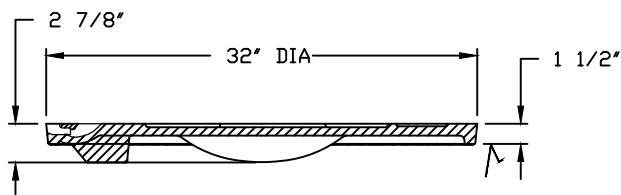

CROSS SECTION



EPIC PICKBAR

Product Number
41432146

Design Features

- Materials
Ductile Iron (70-50-05)
- Design Load
Heavy Duty
- Open Area
n/a
- Coating
Undipped
- √ Designates Machined Surface

Certification

- ASTM A536
-
- Country of Origin

Drawing Revision

07/09/2009 Designer: GAD
07/31/2013 Revised By: DVD

Disclaimer

Weights (lbs./kg) dimensions (inches/mm) and drawings provided for your guidance. We reserve the right to modify specifications without prior notice.

CONFIDENTIAL: This drawing is the property of EJ GROUP, Inc., and embodies confidential information, registered marks, patents, trade secret information, and/or know how that is the property of EJ GROUP, Inc. Copyright © 2012 EJ GROUP, Inc. All rights reserved.

Contact

800 626 4653
ejco.com

PATENT PENDING

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS STORM SEWER MANHOLE FRAME & COVER

NAME: ST SW MH FRAME & COVER
CATEGORY: STORM WATER CONTROL
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR


REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
1	MAM	06/15/2022		SD-08
2	KSJB	06/21/2022	KSJB	

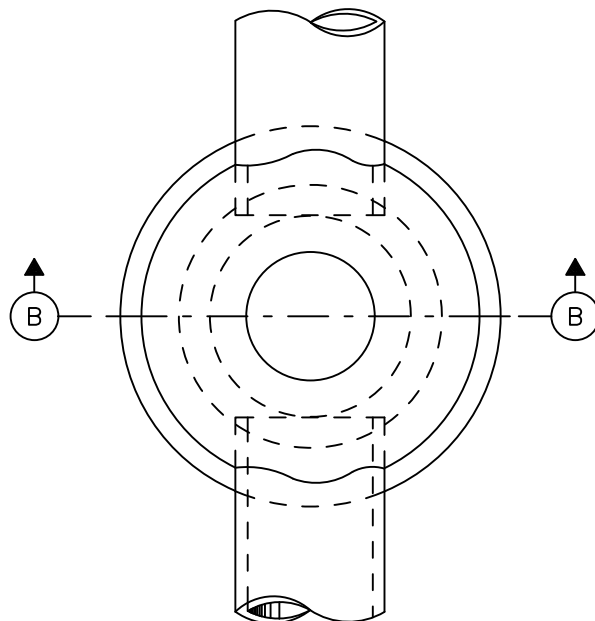

NOTE:

BRICK WALLS 12'-0" BELOW TOP OF CASTING TO BE 12" THICK. STD. FRAME & COVER SHALL BE PER COH STANDARD MH COVER

PLAN OF TYPE "C"
(COVER NOT SHOWN)

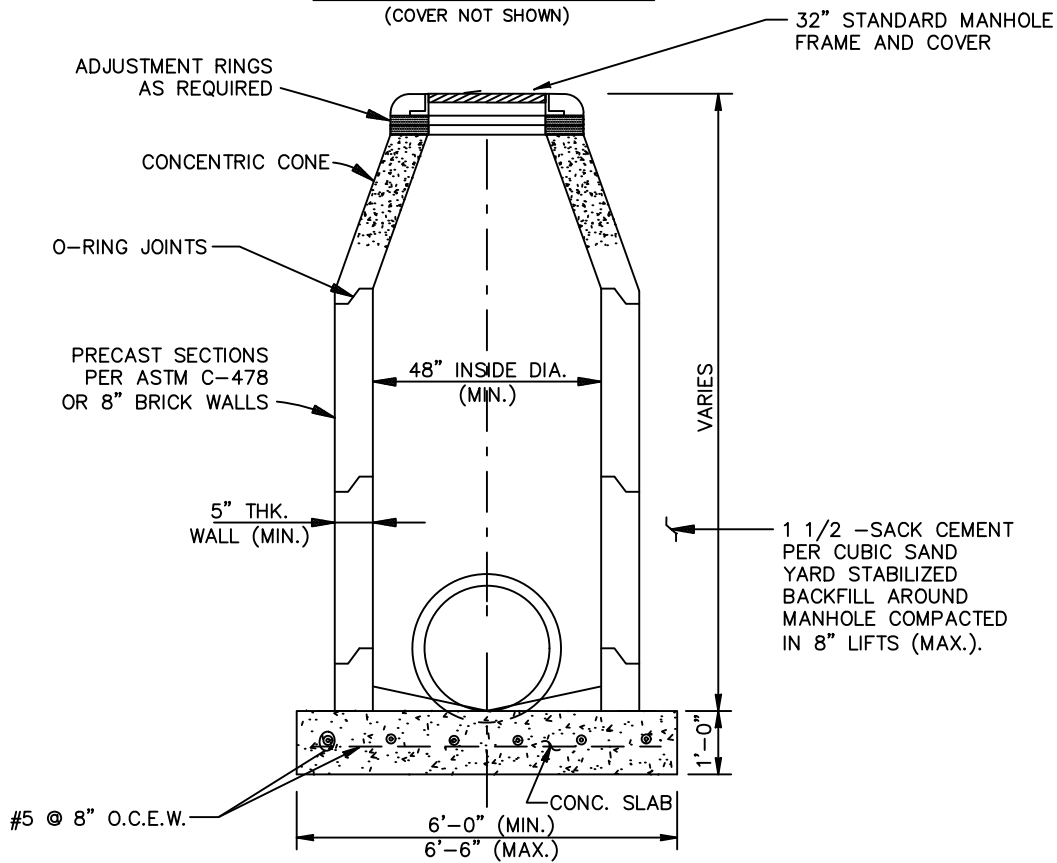

SECTION B-B

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320


CITY OF HUNTSVILLE STANDARD DETAILS
TYPE "C" STORM SEWER MANHOLE
FOR 42" PIPE AND SMALLER

NAME: TYPE C STSW MANHOLE
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR


REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-09

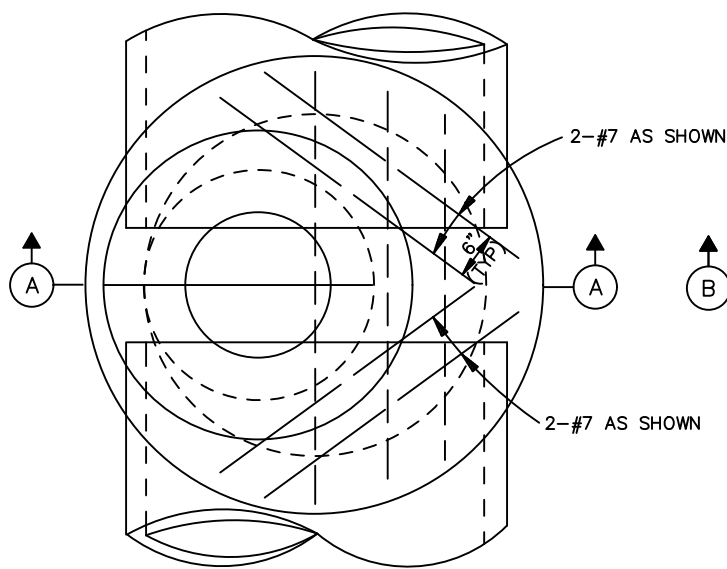


PLAN

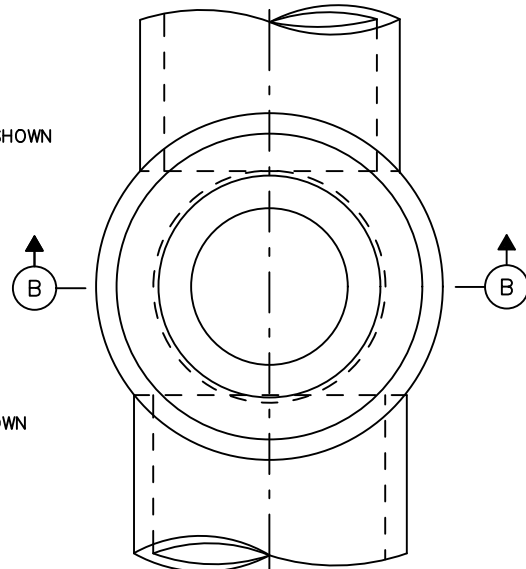

PLAN

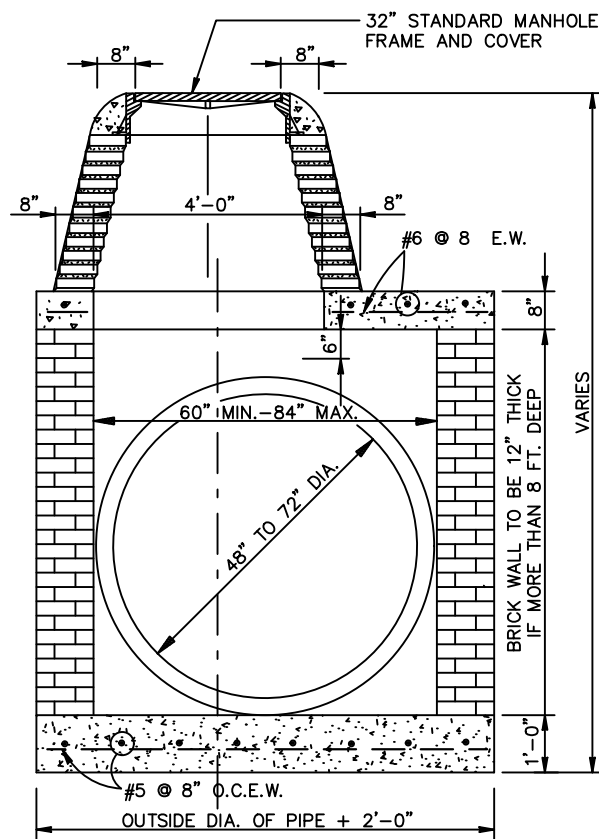

SECTION A-A

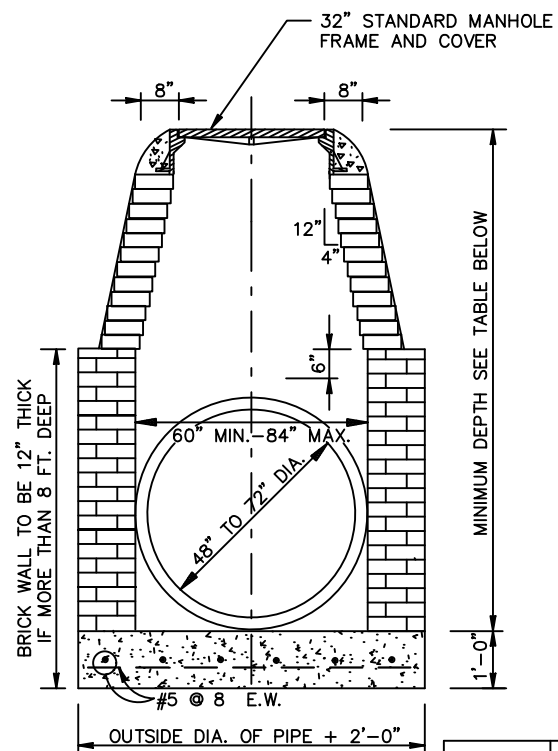

SECTION B-B

SIZE OF PIPE	MIN. DEPTH
48"	8'-0"
54"	9'-4"
60"	10'-7"
66"	11'-10"
72"	13'-2"

NOTES:

1. WHEN MANHOLE HAS LESS DEPTH THAN MIN. SHOWN ON CHART, BUILD SECTION A-A OTHERWISE BUILD SECTION B-B.
2. MANHOLE MAY BE CONSTRUCTED OF PRECAST REINFORCED CONCRETE.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
TYPE "C" MANHOLE FOR 48" TO 72"
CONCRETE PIPE STORM SEWERS


REV#	ISSUER	DATE	APPROVER	SHEET
0	MAM	07/10/2018		1 OF 1

SD-10

NAME: TYPE C MH 48"-72"
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

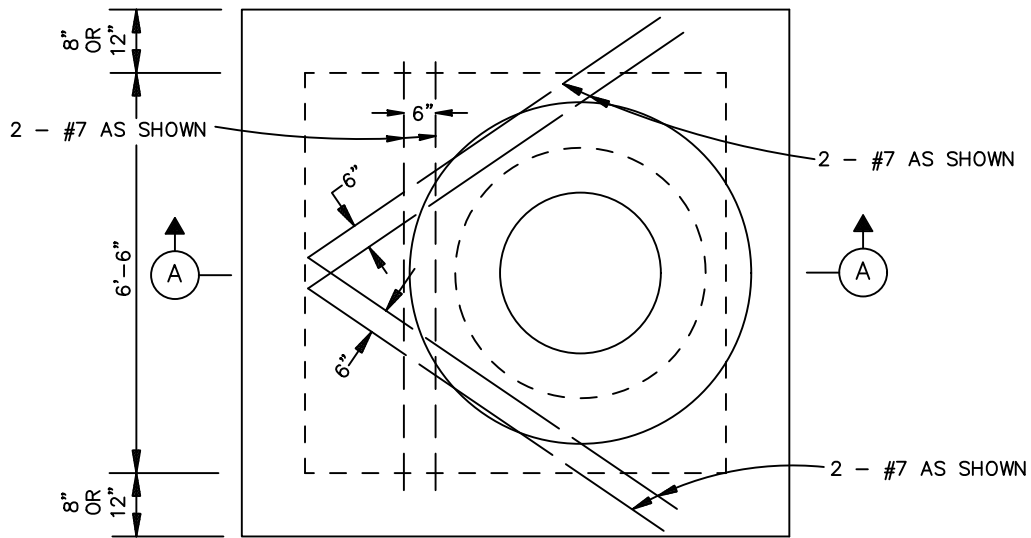

PLAN

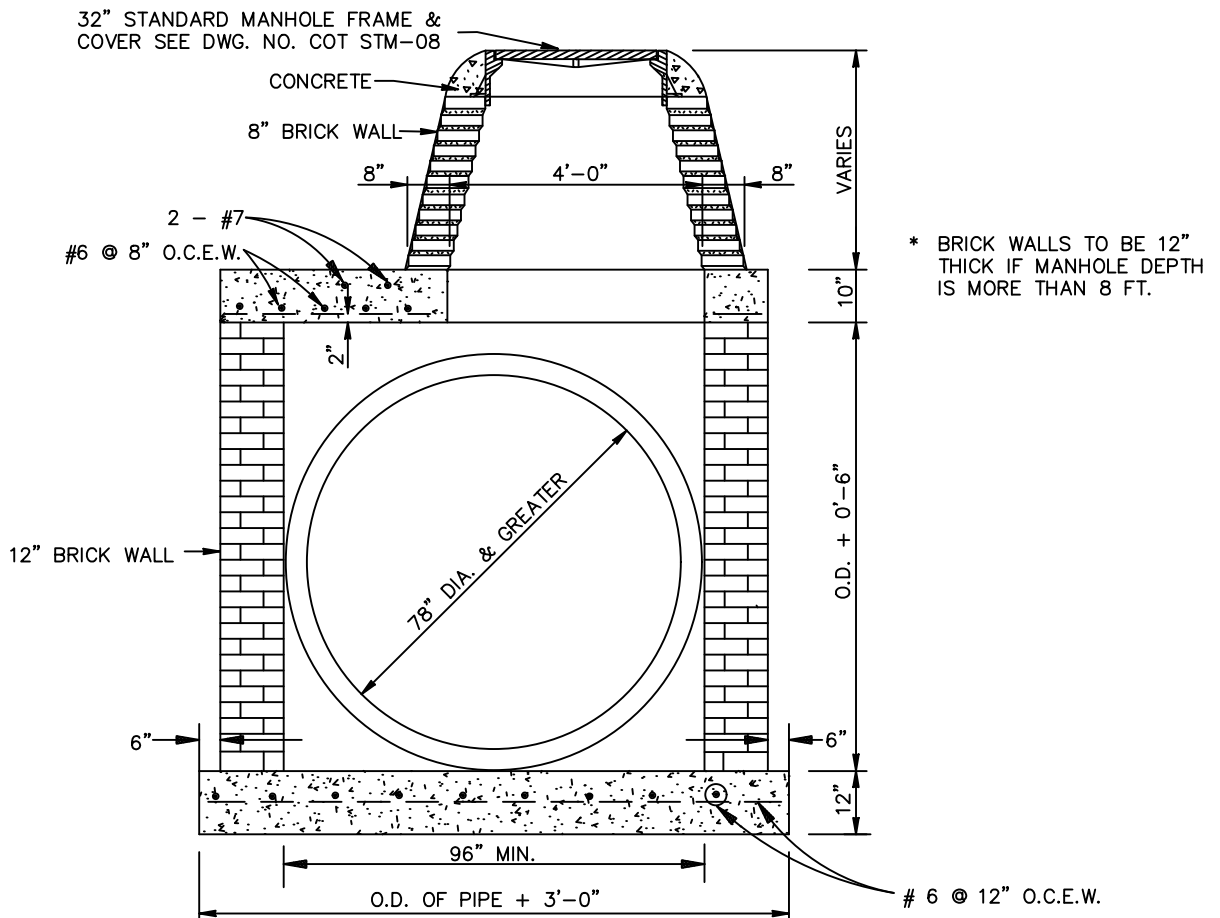

NOTE:
1. MANHOLE MAY BE CONSTRUCTED OF
PRECAST REINFORCED CONCRETE.

SECTION A-A

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
SPECIAL TYPE "C" STORM SEWER MANHOLE
FOR 78" PIPE AND GREATER

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-11

NAME: SPECIAL TYPE C MH
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

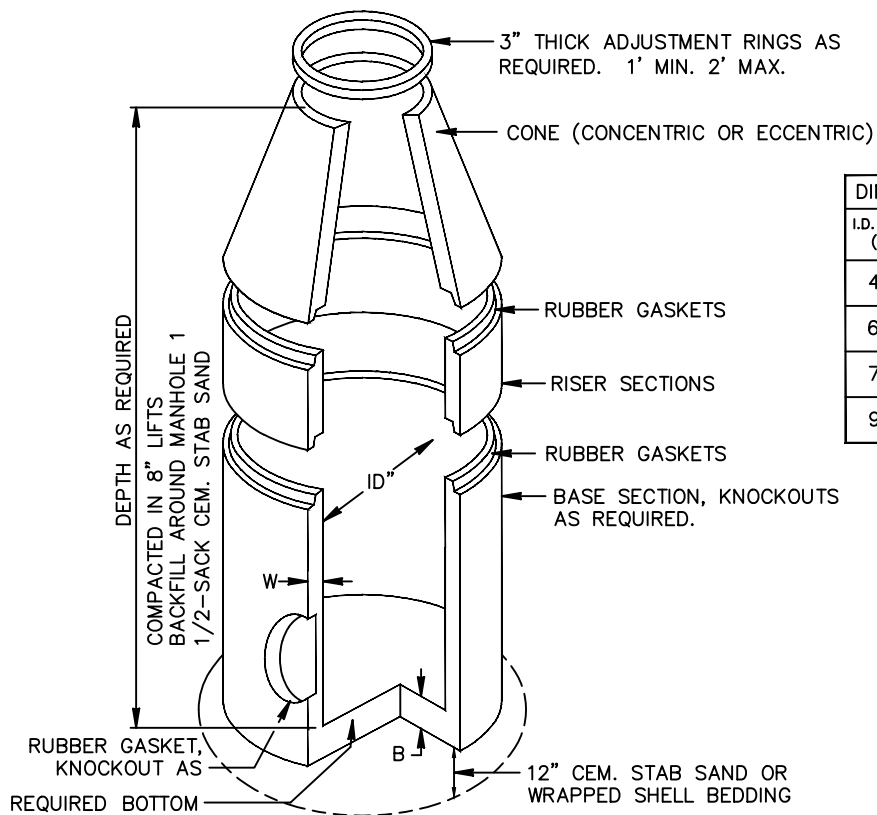

DIMENSIONS AND WEIGHTS			
I.D. SIZE (in)	W (in)	B (in)	RISER WT/LF (lb)
48	5	6	868
60	6	8	1300
72	7	8	1811
96	9	8	3090

SPECIFICATIONS:

CONCRETE: CLASS 1 CONCRETE WITH A DESIGN STRENGTH OF 4500 PSI AT 28 DAYS. RATES FOR H-20 LOADING.

REINFORCEMENT: STRUCTURAL REINFORCEMENT CONFORMING TO ASTM-C-478.

C.I. CASTINGS: CAST IRON FRAMES AND GRATES ARE MANUFACTURED OF GREY CAST IRON CONFORMING TO ASTM A48-76 CLASS 35.

PRECAST CONCRETE MANHOLE

NOTES:

1. LIFTING INSERTS AS REQUIRED.
2. ALL JOINTS SHALL BE SEALED WITH APPROVED RUBBER GASKET
3. STRUCTURE TO BE PLACED ON 12" STABILIZED BASE.
4. C.S.S. SHALL BE BROUGHT TO WITHIN 2-FT OF TOP OF MANHOLE.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS





City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS PRECAST CONCRETE MANHOLE

NAME: PRECAST CONC. MANHOLE
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-12

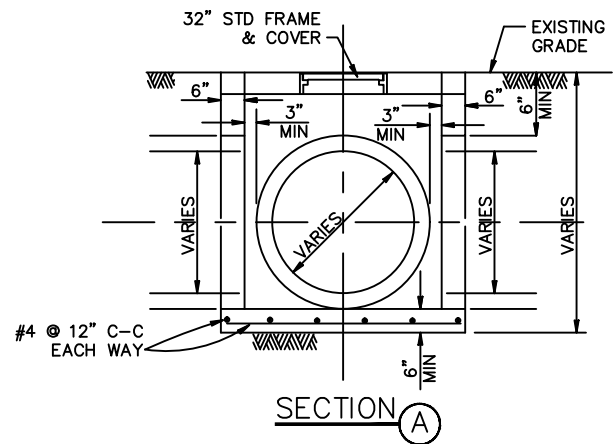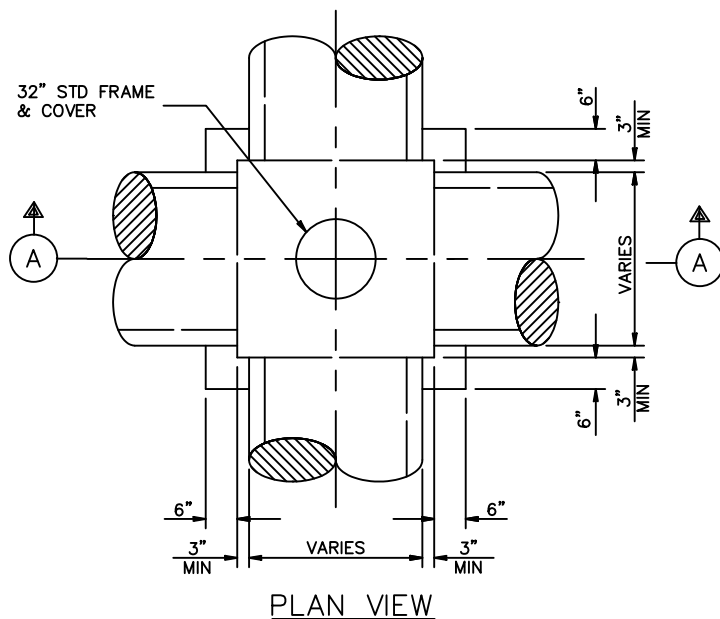

NOTES:

1. DETAIL TO BE USED WHERE STORM SEWER SIZE IS 24" DIAMETER OR LESS.
2. FOR PIPE SEWERS GREATER THAN 24", USE TYPE "C" MANHOLE

ENGINEERING DEPARTMENT
CITY OF
HUNTSVILLE, TEXAS





City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
STORM SEWER JUNCTION BOX
FOR MAX 24" DIAMETER PIPE

NAME: STSW JUNCTION BOX
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
1	MAM	10/16/2019	RAM	SD-13

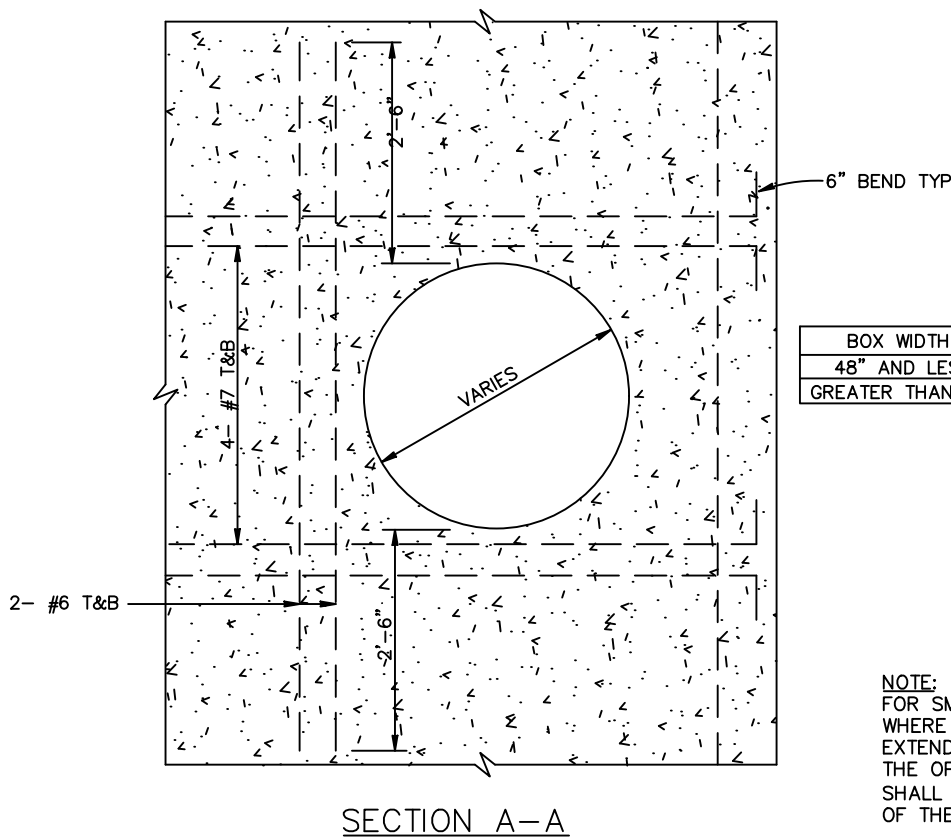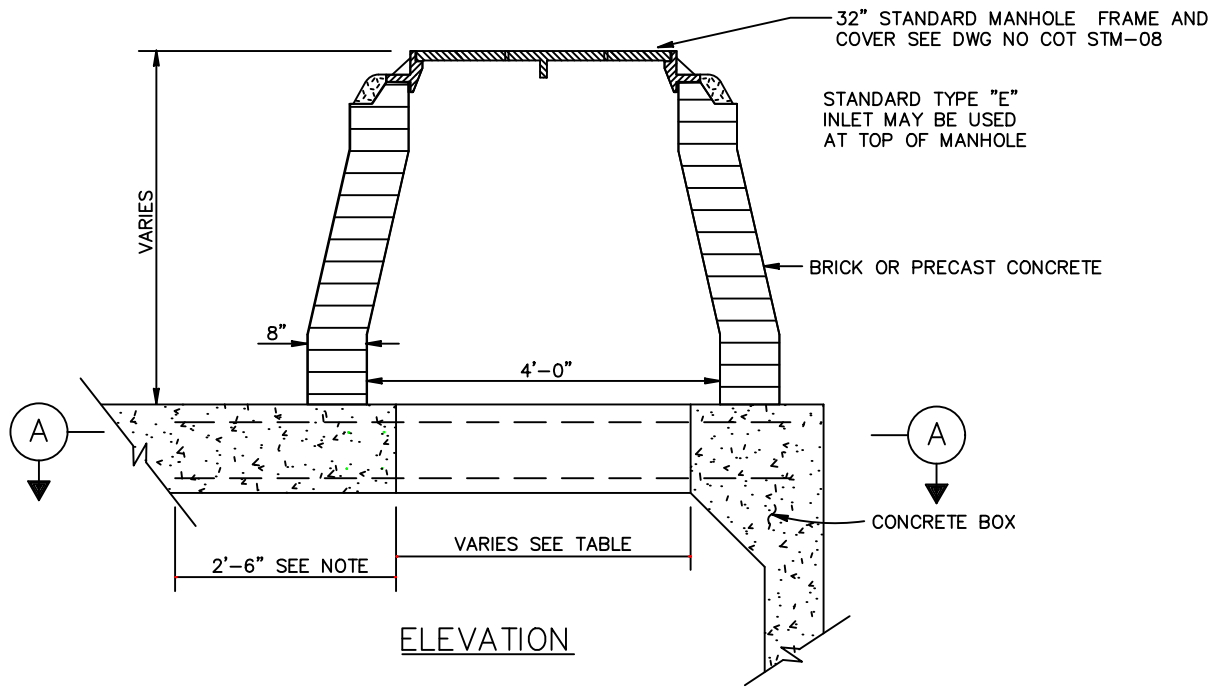

BOX WIDTH	OPENING SIZE
48" AND LESS	36"
GREATER THAN 48"	48"

NOTE:
FOR SMALLER BOX SEWER WIDTHS,
WHERE IT IS NOT POSSIBLE TO
EXTEND REINFORCING STEEL BEYOND
THE OPENING, REINFORCING STEEL
SHALL BE EXTENDED 3" TO THE EDGE
OF THE WALL.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS


NAME: BOX ST SEWER MANHOLE
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR



City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
MANHOLE FOR PROPOSED BOX STORM SEWER

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-14

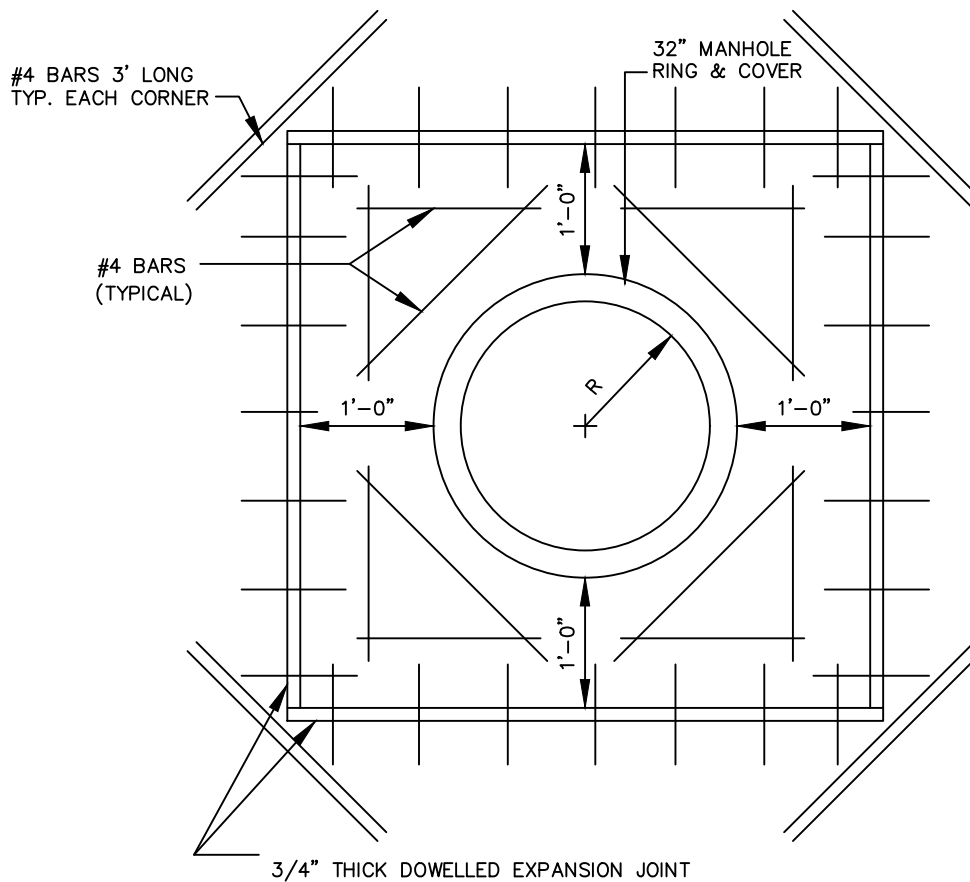

MANHOLE BLOCKOUT
(STORM SEWER)
IN PAVEMENT

ENGINEERING DEPARTMENT
CITY OF
HUNTSVILLE, TEXAS



City Service Center
448 State Highway 75
Huntsville, TX 77320


CITY OF HUNTSVILLE STANDARD DETAILS
MANHOLE BLOCKOUT FOR STORM SEWER
IN PAVEMENT

NAME: MH BLOCKOUT FOR ST SWR
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR


REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
1	MAM	10/16/2019	RAM	SD-15

Plan view of the concrete apron. The diagram shows a large rectangular area representing the concrete apron. Inside this area, there is a smaller rectangular area representing the concrete apron apron. The concrete apron apron is further divided into several smaller rectangular sections. The diagram is labeled with 'B' in a circle at the top left and bottom right corners, indicating the location of the concrete apron apron. A line with an arrow points to the top edge of the concrete apron, labeled '2' CONCRETE APRON'.


SECTION A

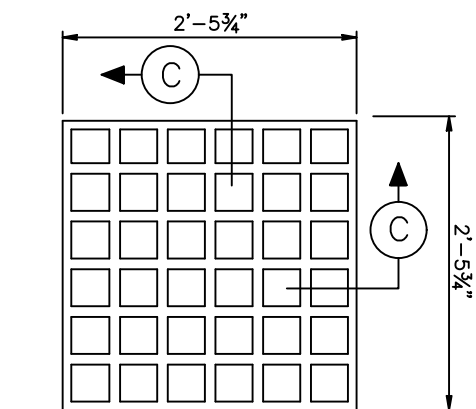

GRATE

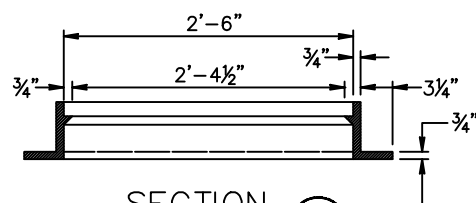

SECTION B

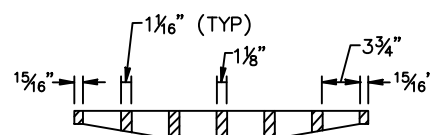


SECTION C


1. ALL BRICK CONSTRUCTION SHALL USE APPROVED CONCRETE BRICK WITH 1/2" (IN.) MORTAR INSIDE AND OUT. 1/4" TO 1/2" MORTAR JOINT, 3/8" (IN.) IS THE STANDARD.
2. REFER TO GENERAL NOTES, CONCRETE NOTES AND STORM SEWER NOTES.

CITY OF HUNTSVILLE STANDARD DETAILS
TYPE "A" INLET


REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-16

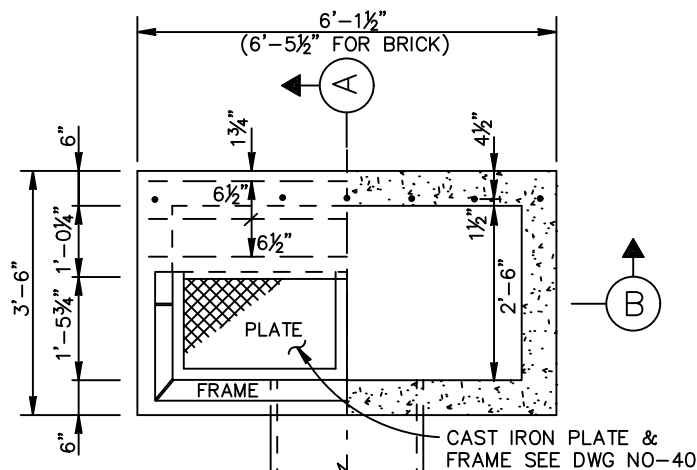


HALF PLAN HALF SECT. PLAN

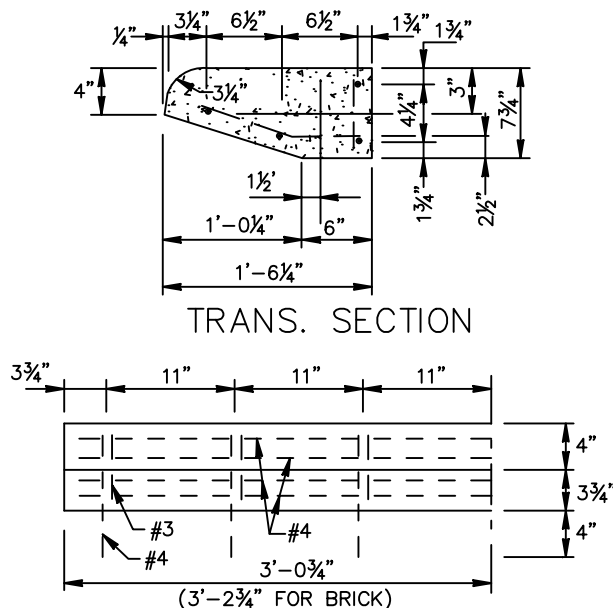

TRANS. SECTION
HALF FRONT ELEV.
PRECAST CURB BEAM

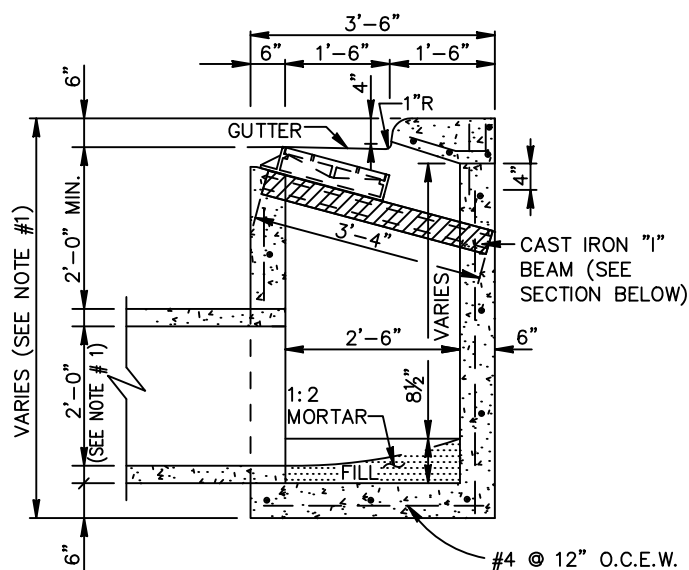


SECTION (A)



SECTION
THRU "I" BEAM

CURB BEAM BAR LIST				
NO.	SIZE	LENGTH	SHAPE	LOC.
4	# 4	5'-10"	ST.	HOR.
7	# 4	0'-10"	ST.	VERT.
7	# 3	1'-6"	BT.	

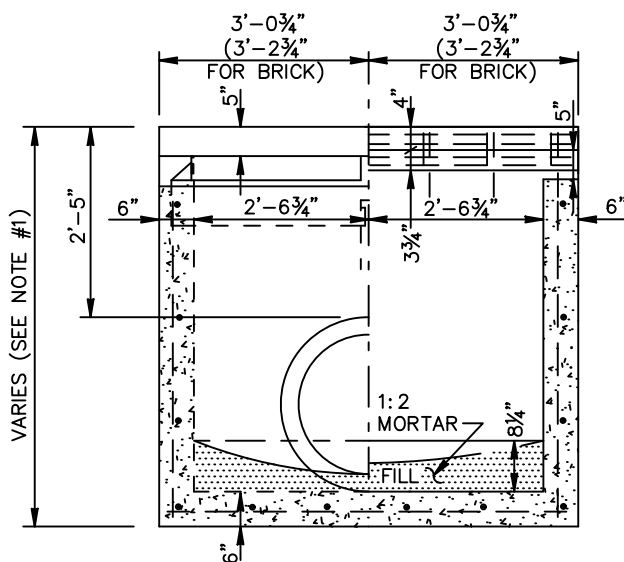

HALF FRONT
ELEV.

HALF SECT. (B)

NOTES:

1. DIMENSION VARIES BASED ON PIPE DIAMETER AND WALL THICKNESS.
2. CENTER REINFORCING IN SLAB AND WALLS.
3. CENTER STEEL BEAM ON INLET AND CAST INTO WALLS AS SHOWN.
4. USE STD. CAST IRON FRAME & PLATES. LEAD SHALL LEAVE INLET AT LOCATION AND GRADE REQUIRED. WHEN BRICK INLETS ARE BUILT EXTEND DOWELS 4 INCHES FROM CURB BEAM INTO BRICKWORK. WHEN BRICK INLETS ARE BUILT, WALLS SHALL BE INCREASED TO 8 INCHES, AND INLET BEAMS TO BE 4 INCHES LONGER.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320


CITY OF HUNTSVILLE STANDARD DETAILS
TYPE "B-B" INLET

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-17


NAME: TYPE "B-B" INLET
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

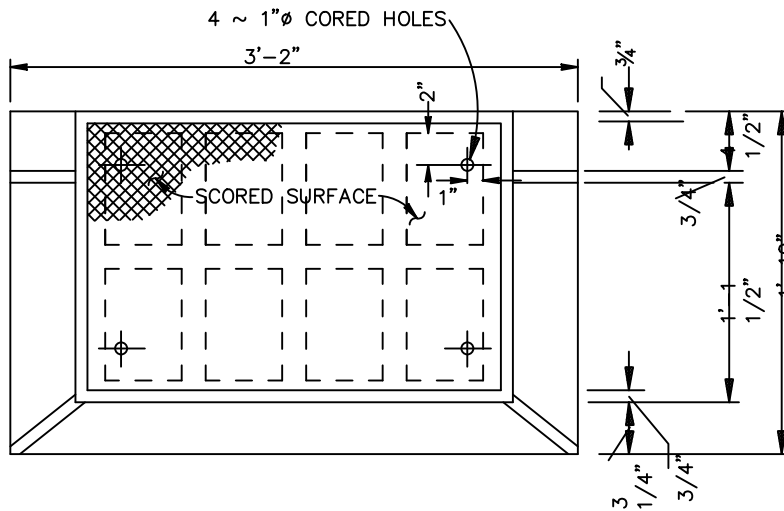


PLAN OF PLATE AND FRAME

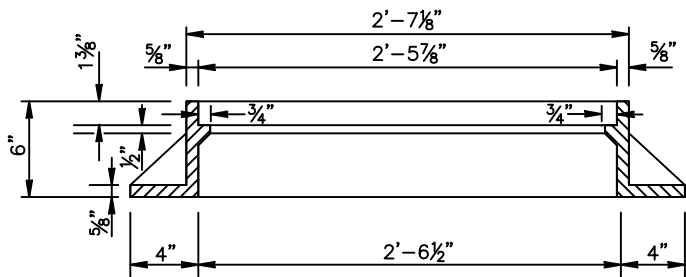


LONG SECTION OF FRAME

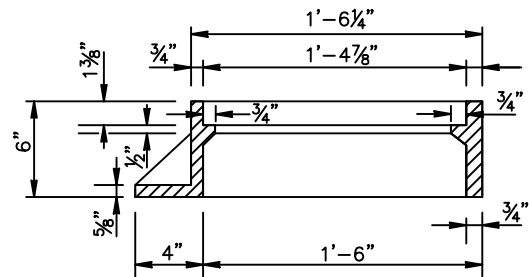

TRANS SECTION OF FRAME

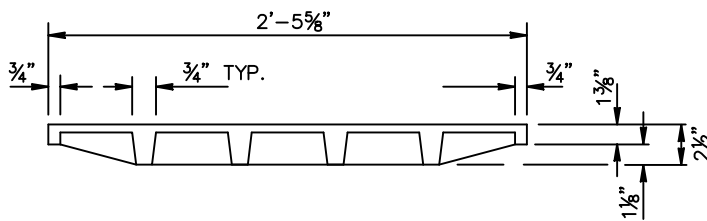

LONG SECTION OF PLATE

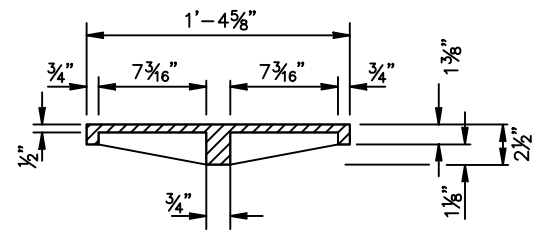

TRANS SECTION OF PLATE

FRAME: VULCAN MODEL V-4241 (2 REQ'D)
 PLATE: VULCAN MODEL V-4240-2 (2 REQ'D)

DEPARTMENT OF ENGINEERING &
 MAPPING/ENGINEERING
 DIVISION
 CITY OF
 HUNTSVILLE, TEXAS




City Service Center
 448 State Highway 75
 Huntsville, TX 77320


CITY OF HUNTSVILLE STANDARD DETAILS
 CAST IRON PLATE & FRAME FOR TYPE "B" INLETS

NAME: CAST IRON PLATE & FRAME
 CATEGORY: STORM DRAINAGE
 DRAWN DATE: 11/22/2016
 DRAWN BY: WLSIII
 SCALE: N.T.S.
 APPROVED BY: YSR


REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-19

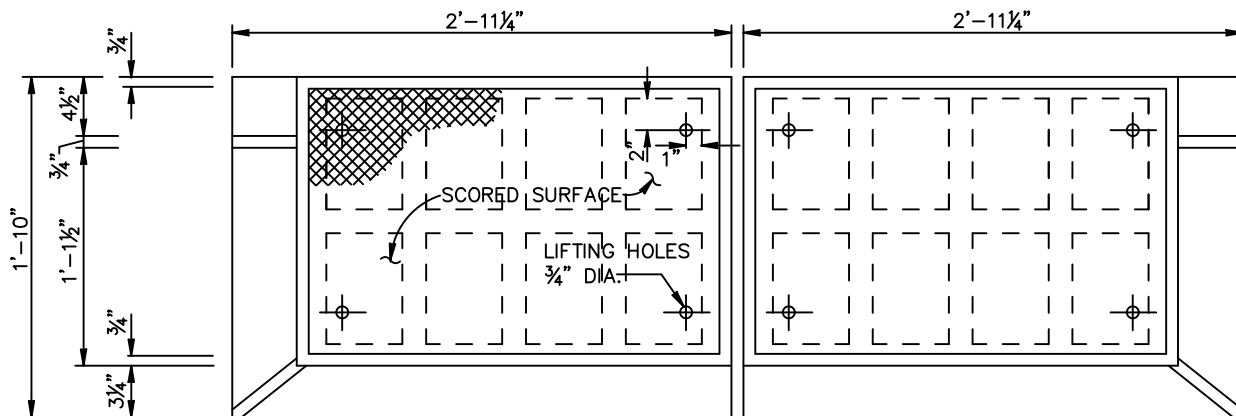


PLAN OF PLATE AND FRAME

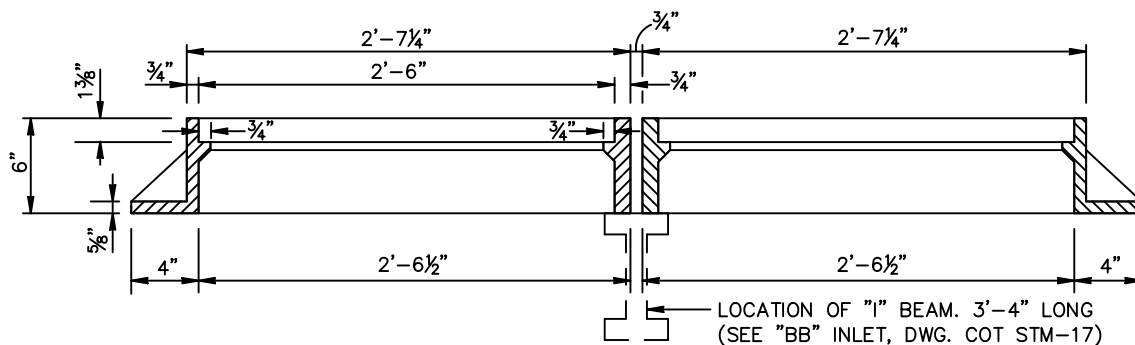


LONG SECTION OF FRAME

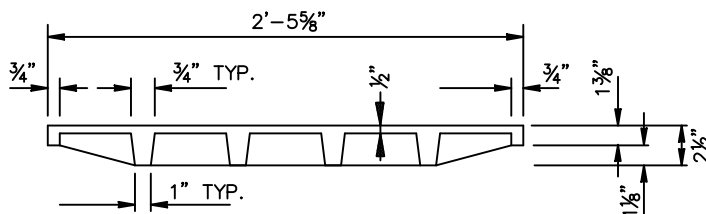

LONG SECTION

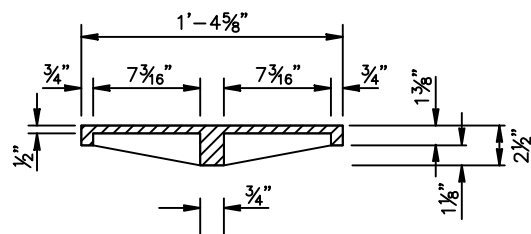


TRANS SECTION

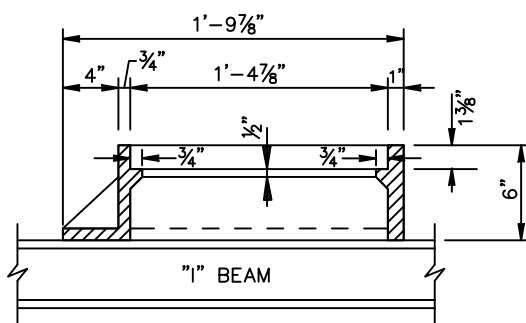

FRAME TRANS SECTION

PLATE

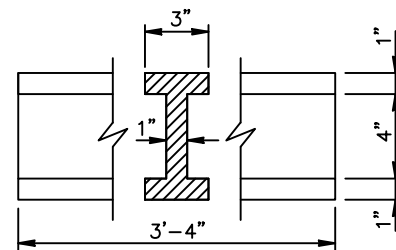

"1" BEAM
(CAST IRON)

FRAME: VULCAN MODEL V-4242L & V-4242R
PLATE: VULCAN MODEL V 4242-2
I-BEAM: VULCAN MODEL V 4881

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
CAST IRON PLATE, FRAME & "I" BEAM
FOR TYPE "B-B" INLET

NAME: CAST IRON PLATE
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-20

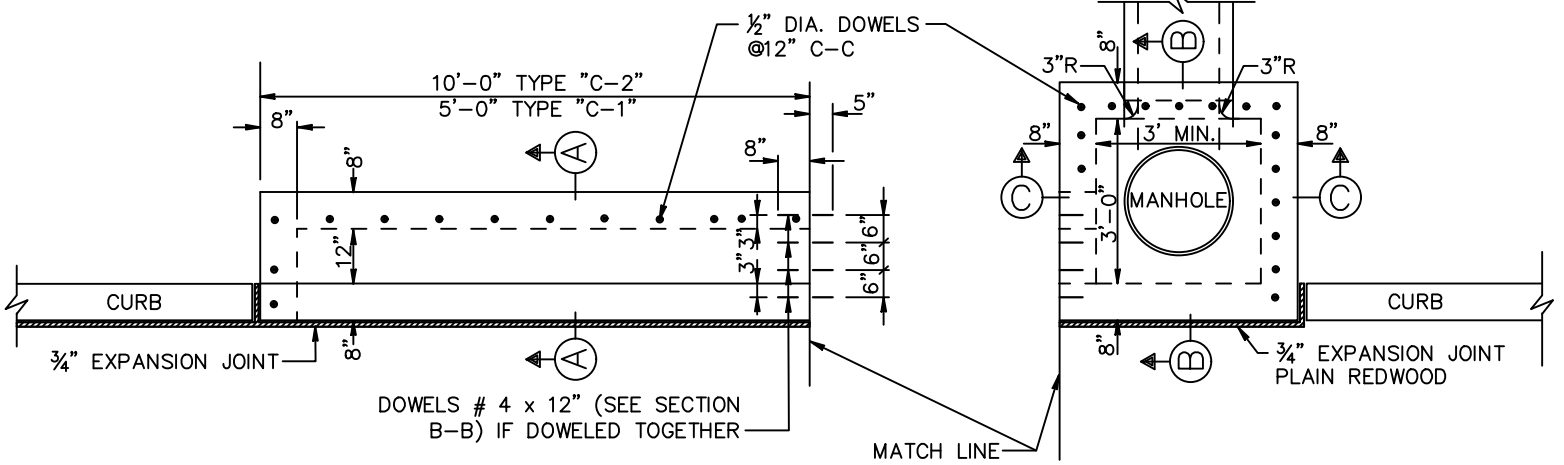


EXTENSION

PLAN


INLET TYPE C

NOTE:
TYPE "C-2" PROVIDE A CENTER
6"x6" COLUMNS IN THE CURB LINE
BETWEEN ALL EXTENSIONS

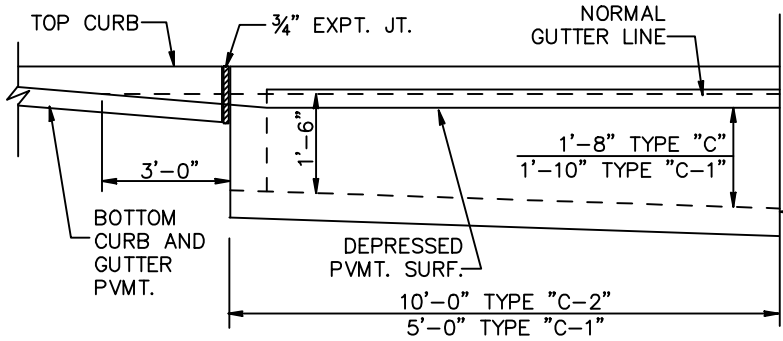

ELEVATION


NOTE:
THE WALLS MAY BE BUILT WITH BRICK
AND ALL TOP SLABS DOWELED INTO
THE BRICK WALLS WITH # 4 X 8" @ 12

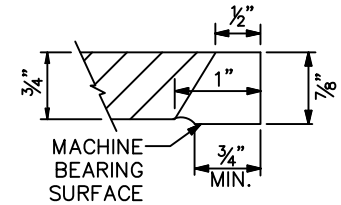

SECTION OF COVER THRU RECESS

GENERAL NOTE

TYPE "C" INLET WITH ONE EXTENSION
(5'-0" LONG)
TYPE "C-1" INLET WITH DOUBLE EXTENSION
(10'-0" LONG)
TYPE "C-2" INLET WITH ONE EXTENSION
ON EACH SIDE
TYPE "C-3" INLET WITH NO EXTENSION

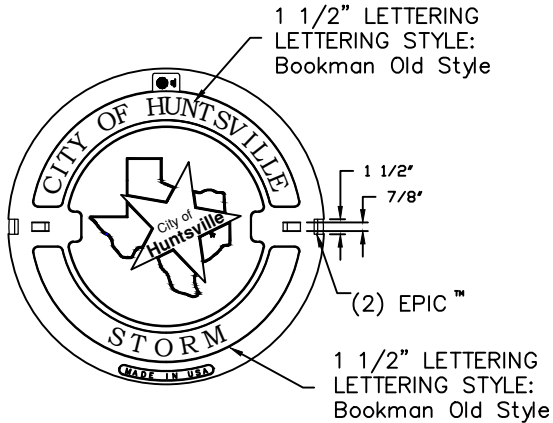

MANHOLE COVER PLAN

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320


CITY OF HUNTSVILLE STANDARD DETAILS TYPE "C" "C-1" "C-2" & "C-3" INLETS

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
1	KSJB	06/28/2022	KSJB	SD-21


NAME: TYPE C,C-1,C-2,C-3 INLETS
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

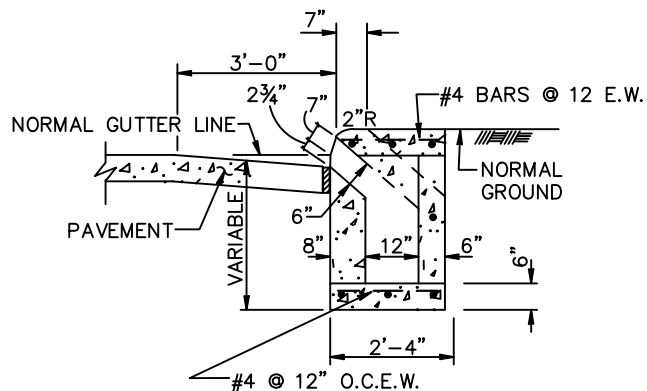

SECTION A-A

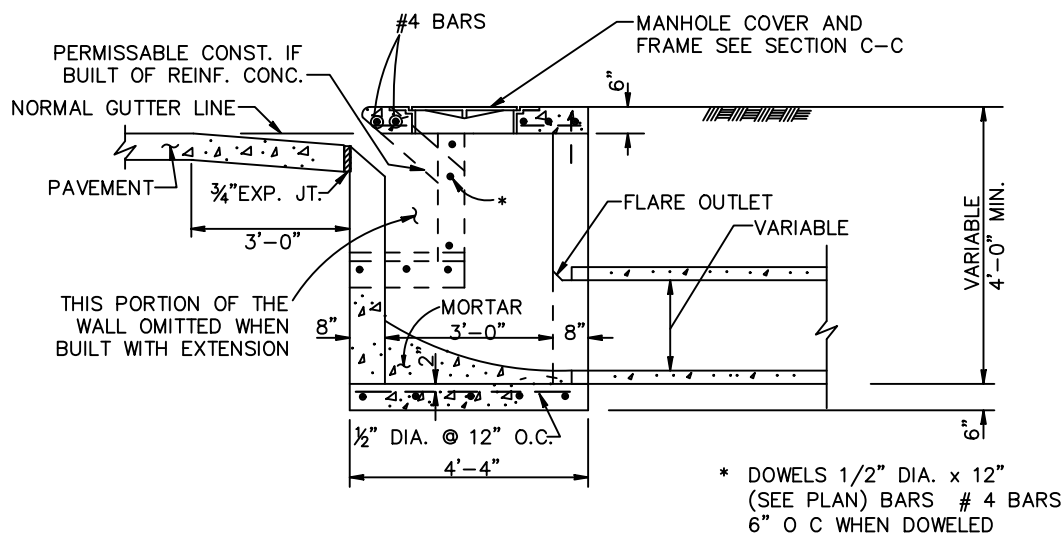

SECTION B-B

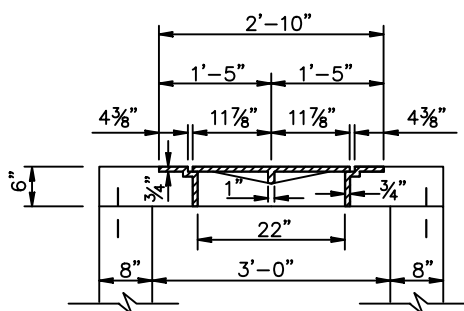

SECTION C-C

NOTE:

THE WALLS MAY BE BUILT WITH BRICK
AND ALL TOP SLABS DOWELED INTO
THE BRICK WALLS WITH # 4 X 8" @ 12

WALLS TO BE 6" REINF. CONC.
OR MAY BE MADE OF BRICK WITH
8" WALL, IF SO USE STRAIGHT
WALL IN BACK WITH 6" REINF.
CONC SLAB TOP

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320


CITY OF HUNTSVILLE STANDARD DETAILS
TYPE "C", "C-1", "C-2" & "C-3" INLETS

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-22

NAME: TYPE C,C-1,C-2, C-3 INLETS
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

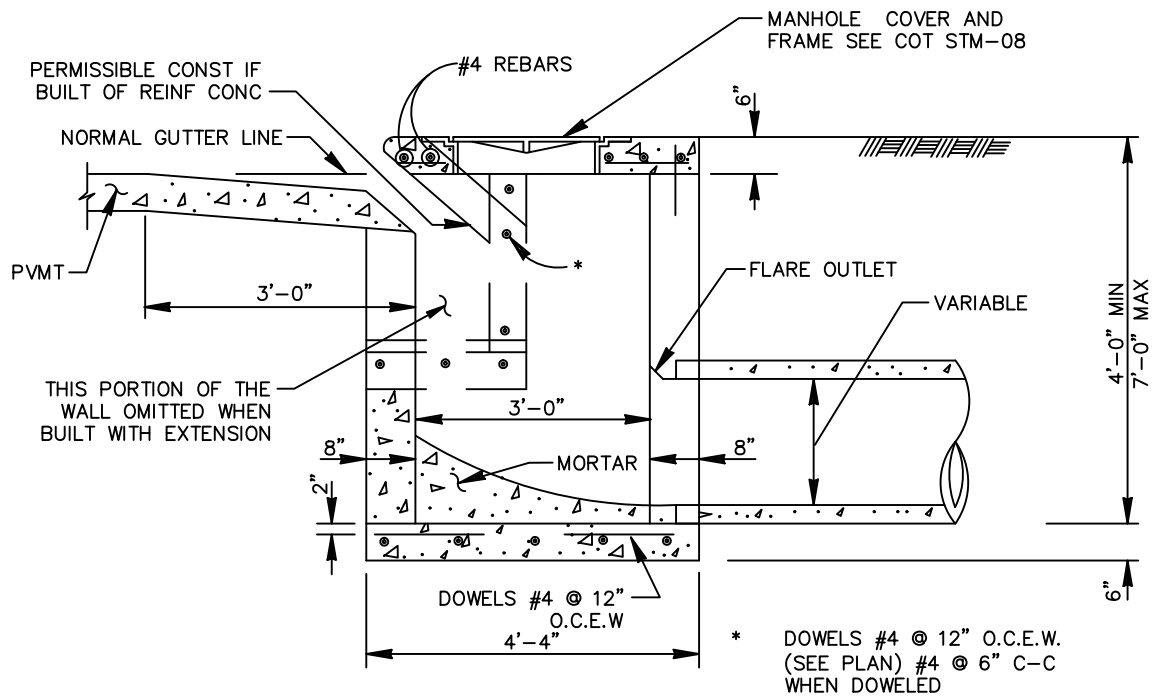

SECTION B

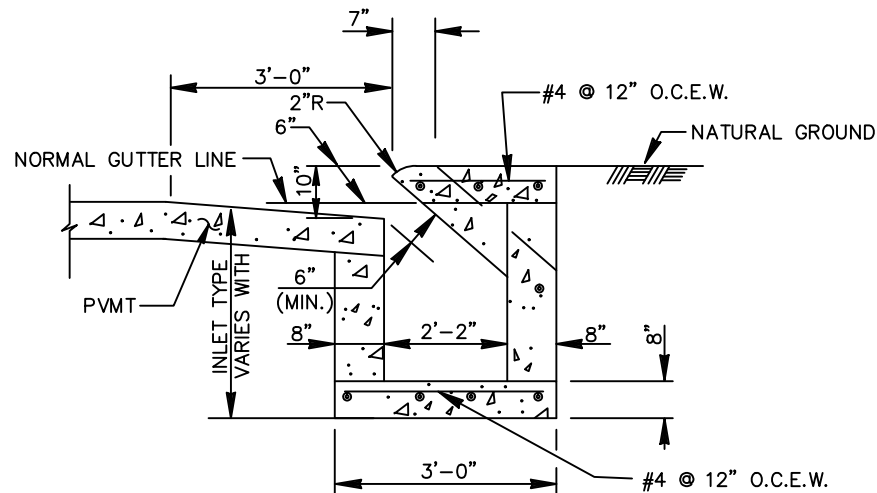

SECTION A

TYPE "C" INLET

NOTES:

1. REFER TO GENERAL NOTES, STORM SEWER & CONCRETE NOTES.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320


CITY OF HUNTSVILLE STANDARD DETAILS
PRECAST TYPE "C" INLET

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-23

NAME: PRECAST TYPE "C" INLET
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

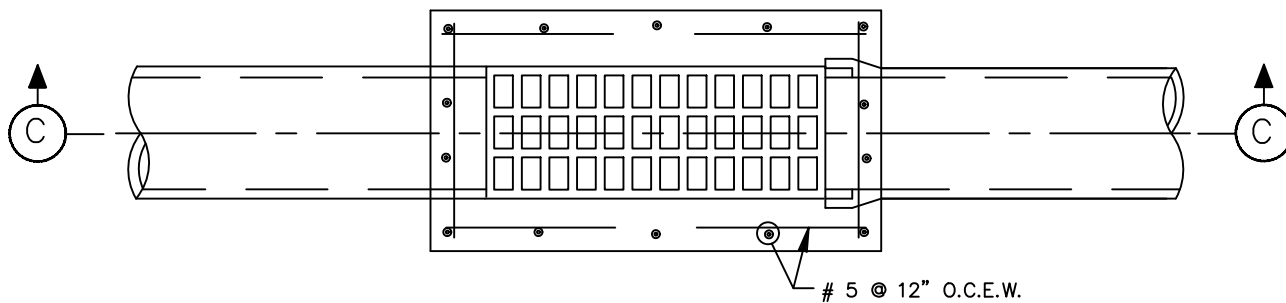

PLAN

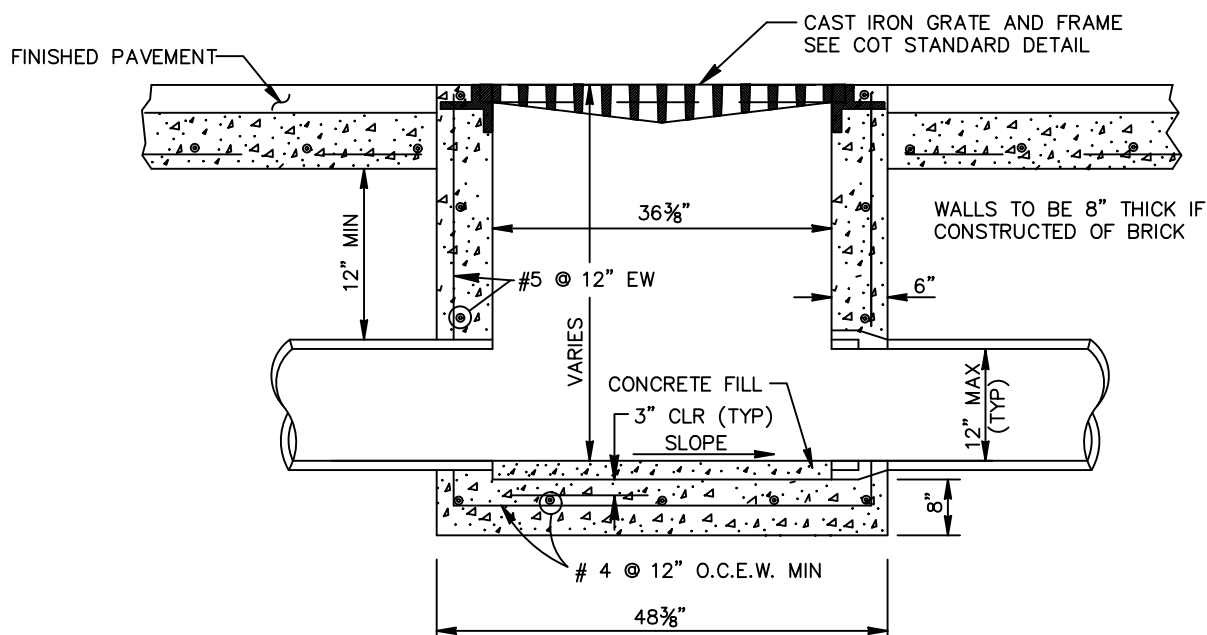

SECTION C

TYPE "D" INLET

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS






City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
TYPE "D" INLET

NAME: TYPE "D" INLET
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-24

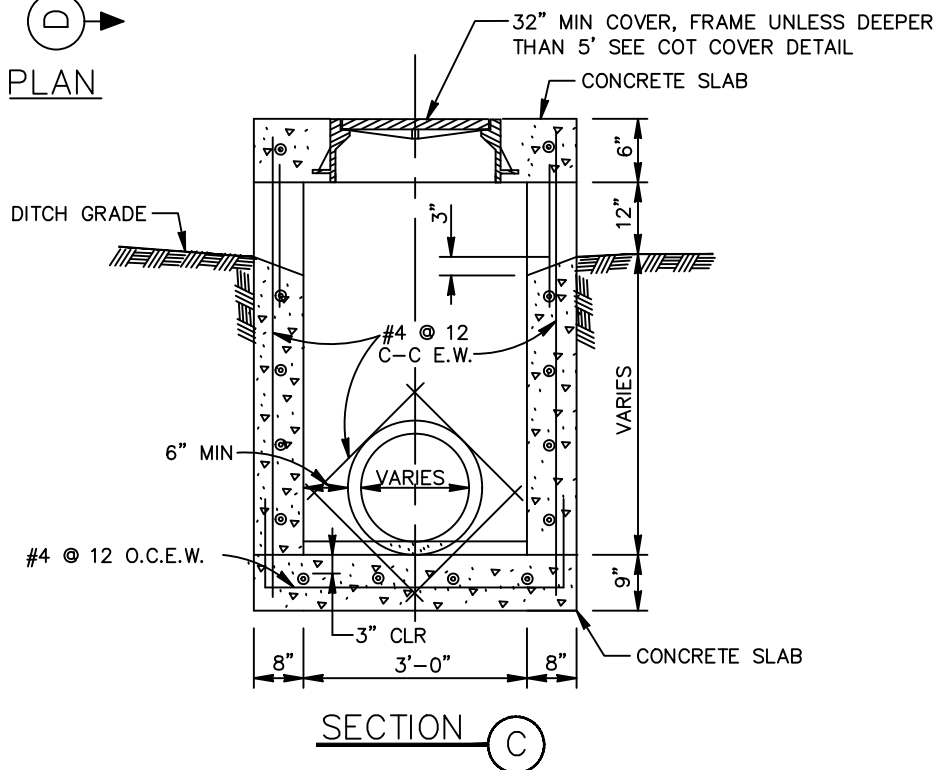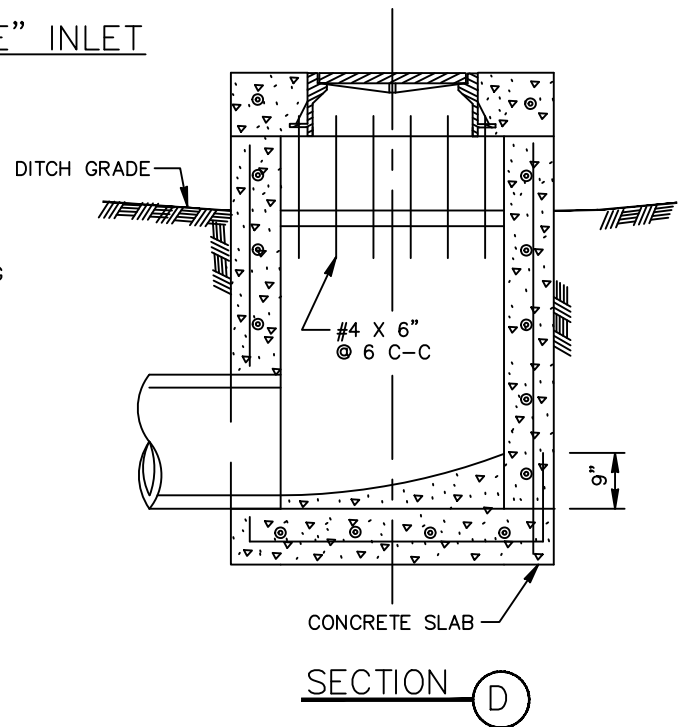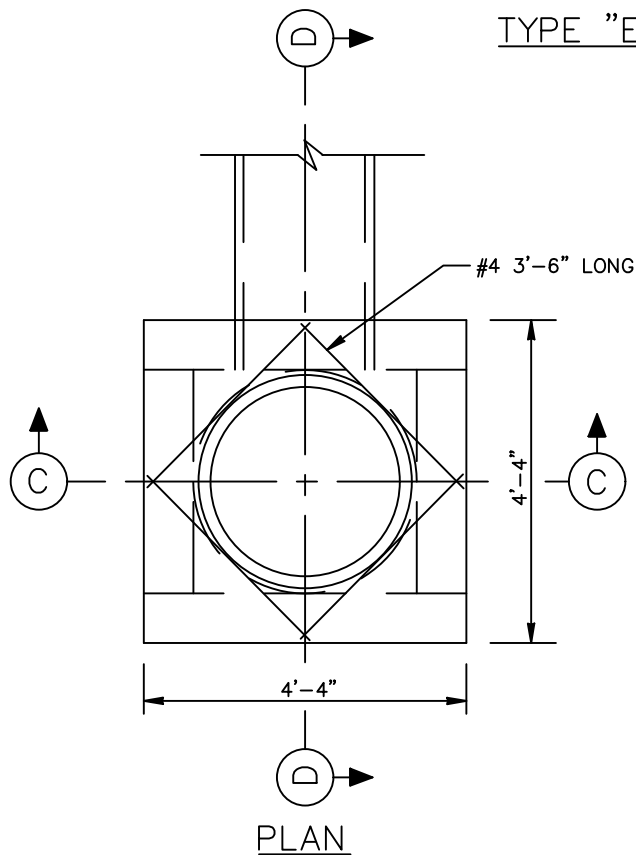

NOTE:
8" BRICK WALLS MAY BE CONSTRUCTED IN LIEU OF 8" CONCRETE WALLS SHOWN.

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320


NAME: TYPE "E" INLET
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

CITY OF HUNTSVILLE STANDARD DETAILS
TYPE "E" INLET

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-25

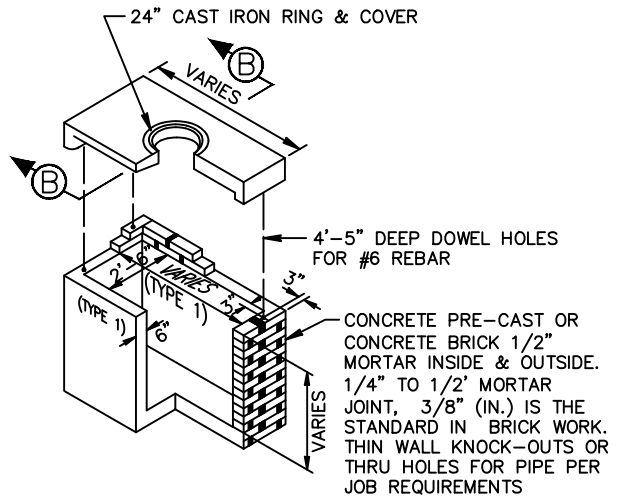

TYPE "H-2" PRECAST INLET

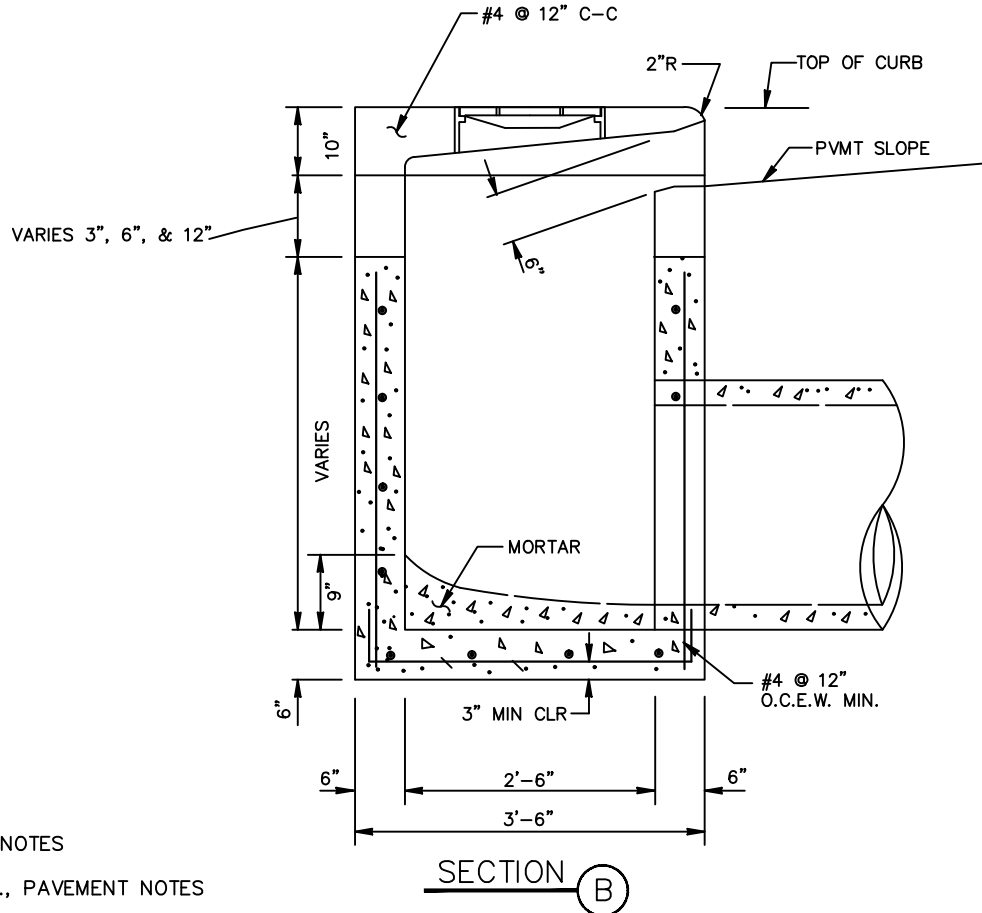

REFER TO:

1. GENERAL NOTES
2. SEE C.S.S., PAVEMENT NOTES

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS PRECAST "H-2" INLET

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-27

NAME: PRECAST H-2 INLET
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

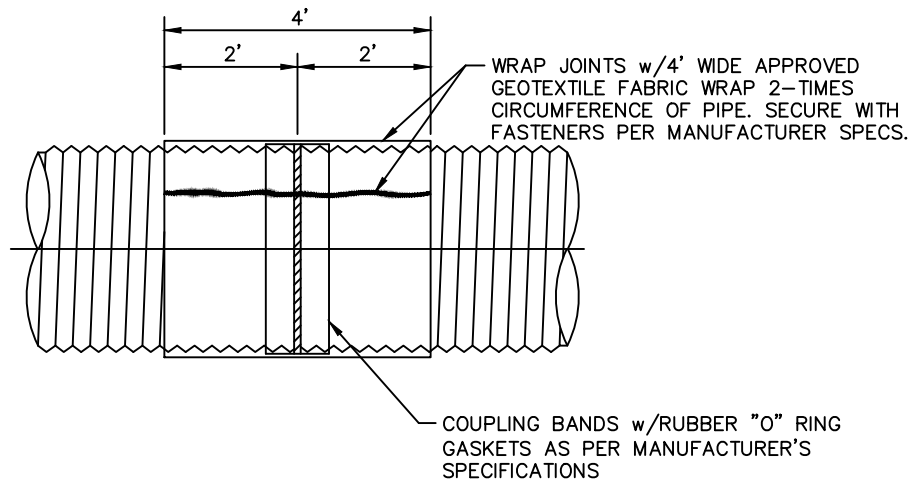

NOTES:

1. ANY PIPE DEFLECTED MORE THAN 2% SHALL BE REJECTED AND REPLACED AT CONTRACTOR'S EXPENSE.
2. INSTALLATION SHALL BE AS PER MANUFACTURER'S RECOMMENDATIONS INCLUDING ITEMS AS DETAILED IN INSTALLATION MANUAL FOR CORRUGATED STEEL DRAINAGE STRUCTURES.

STORM SEWER JOINT WRAP DETAIL

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS




City Service Center
448 State Highway 75
Huntsville, TX 77320

**CITY OF HUNTSVILLE STANDARD DETAILS
STORM SEWER JOINT WRAP**


NAME: STORM SEWER JOINT WRAP
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-29

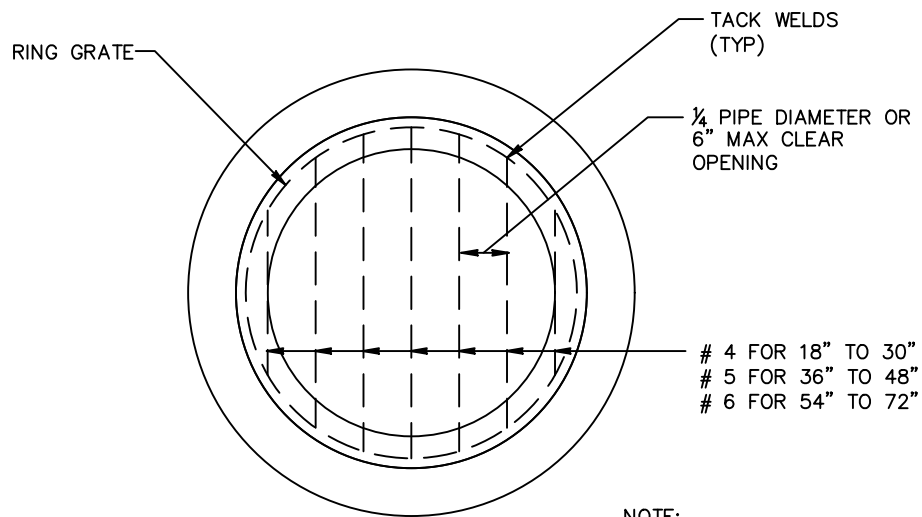

NOTE:
BARS MAY BE VERTICAL OR
HORIZONTAL AFTER INSTALLATION

END VIEW

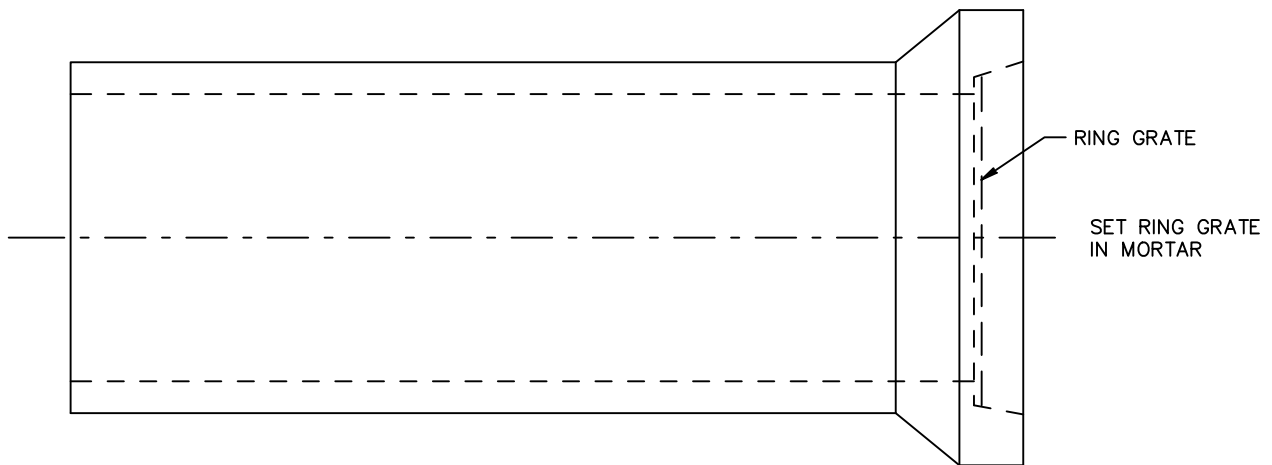

SIDE VIEW

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS





City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS
RING GRATE FOR OPEN END OF 18" TO 72" STUBS TO DITCH

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-30

NAME: RING GRATE
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

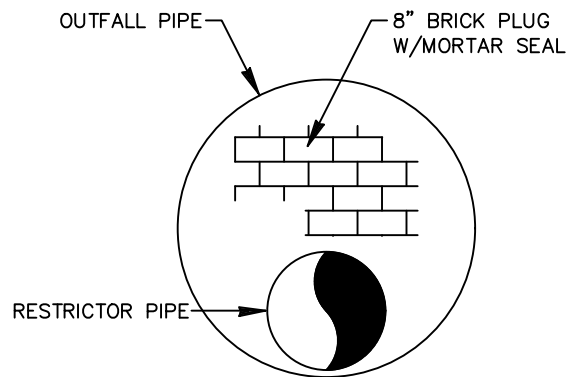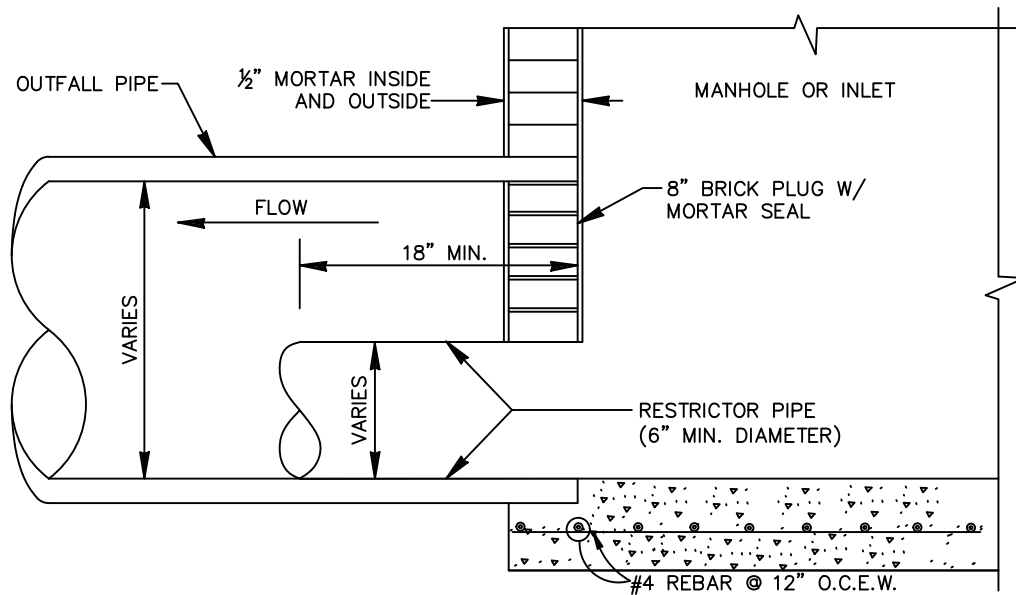

STORM SEWER CHOKE OUTFALL RESTRICTOR DETAIL

REFER TO:

1. GENERAL NOTES
2. STORM SEWER NOTES

DEPARTMENT OF ENGINEERING &
MAPPING/ENGINEERING
DIVISION
CITY OF
HUNTSVILLE, TEXAS



City Service Center
448 State Highway 75
Huntsville, TX 77320

CITY OF HUNTSVILLE STANDARD DETAILS STORM SEWER CHOKE RESTRICTOR

REV#	ISSUER	DATE	APPROVER	SHEET 1 OF 1
0	MAM	07/10/2018		
				SD-31

NAME: STM SW CHOKE RESTRICTOR
CATEGORY: STORM DRAINAGE
DRAWN DATE: 11/22/2016
DRAWN BY: WLSIII
SCALE: N.T.S.
APPROVED BY: YSR

PLAN

A SECTION

TYPICAL OFFSITE DITCH
INTERCEPTOR STRUCTURE
(42 INCH MAX.)

PLAN

(B) SECTION

TYPICAL BACKSLOPE
INTERCEPTOR STRUCTURE
(24 INCH & 30 INCH ONLY)

PLAN

SECTION

COMBINATION BACKSLOPE &
OFFSITE DITCH INTERCEPTOR STRUCTURE
(42 INCH MAX.)

PLAN

D SECTION

URBAN BACKSLOPE
INTERCEPTOR STRUCTURE
(24 INCH ONLY)

REV	DESCRIPTION	DATE	APPR
1.	TYPICAL INTERCEPTOR OUTFALL STRUCTURE LAYOUT	10/21/08	

INTERCEPTOR STRUCTURE DETAILS

PREPARED:	
CHECKED:	
APPROVED:	

[illegible]

DATE: 11-21-05
SCALE: NTS

SHEET NUMBER

COT STM-32

REV	ISSUER	DATE	APPR
0	MAM	07/10/2018	
1	MAM	04/21/2020	

STORM DRAINAGE

HCPCD INTERCEPTOR STRUCTURE DETAILS

DEPARTMENT OF
ENGINEERING & MAPPING
ENGINEERING DIVISION



City Service Center
448 State Highway 75
Huntsville, TX 77320

DATE: 04/21/2020
SCALE: NTS

SHEET 1 OF 1
SD-33

PLAN

SECTION

TYPICAL INTERCEPTOR OUTFALL STRUCTURE LAYOUT

CMP BAND
COUPLER DETAIL

SECTION _____

BEDDING
CMP DETAIL

CONCRETE COLLAR DETAIL

BEDDING CONCRETE
PIPE DETAIL

BEDDING CONCRETE
PIPE DETAIL

HDPE PIPE BAND COUPLER DETAIL

SECTION









BEDDING HDPE PIPE DETAIL

INTERCEPTOR STRUCTURE DETAIL NOTES:

1. INTERCEPTOR OUTFALL PIPES WITHIN THE HCFCO RIGHT-OFF-WAY SHALL BE CMP OR HDPE PIPE IN ACCORDANCE WITH SPECIFICATION SECTION 02642- CORRUGATED METAL PIPE, HIGH DENSITY POLYETHYLENE (HDPE) PIPE IN ACCORDANCE WITH SPECIFICATION SECTION 2505-HIGH DENSITY POLYETHYLENE, OR APPROVED EQUAL.
2. PROVIDE AND PLACE CEMENT STABILIZED SAND IN ACCORDANCE WITH SPECIFICATION SECTION 02321-CEMENT STABILIZED SAND. SEE SECTION 02316 - STRUCTURAL EXCAVATING.
3. EXCAVATION, FILL AND BACKFILL FOR STORM SEWER OUTFALLS SHALL BE IN ACCORDANCE WITH SPECIFICATION SECTION 02316-STRUCTURAL EXCAVATING AND BACKFILLING.
4. CONCRETE SHALL BE STRUCTURAL CONCRETE IN ACCORDANCE WITH SPECIFICATION SECTION 03310-CONCRETE.
5. INTERCEPTOR STRUCTURES:
 - a. ADJUST LENGTH AND WIDTH IN FIELD AS NECESSARY.
 - b. 2- FEET DEEP X 8- INCH WIDE TOE ALL AROUND THE STRUCTURE.
 - c. STEEL REINFORCING-#4 BARS (GRADE 40) AT 12 INCHES ON CENTER EACH WAY.
 - d. ANY INTERCEPTOR OUTFALL PIPE LARGER THAN MAXIMUM SIZE INDICATED REQUIRES A SEPARATE DETAIL.
 - e. MATCH TOP OF CONCRETE WITH NATURAL GROUND.
6. SET FLOWLINE OF OUTFALL PIPES 1' FOOT ABOVE CHANNEL FLOWLINE OR 1 FOOT ABOVE NORMAL WATER SURFACE ELEVATION.
7. SEE CONCRETE CHANNEL LINING DETAIL SHEET FOR CMP OR HDPE OUTFALL DETAILS THROUGH CONCRETE CHANNEL LINING.
8. CONCRETE PAD AROUND TYPE "B" INLET: PAID FOR AS CONCRETE INTERCEPTOR STRUCTURE PER UNIT PRICE SCHEDULE. TYPE "B" INLET BOX, CPO DWG. NO. 02632-02 WITH GRATE TO VULCAN FOUNDRY COMPANY, V-4880-1 OR APPROVED EQUAL, APPROX. 489 SQ.IN. OPENING.
9. BACKSLOPE SWALE AND INTERCEPTOR STRUCTURE ELEVATIONS AND LOCATIONS SHOWN ON THE PLANS ARE APPROXIMATE. FINAL ELEVATIONS AND LOCATIONS SHALL BE FIELD VERIFIED BY THE ENGINEER PRIOR TO INSTALLATION.
10. STRUCTURAL CONCRETE WITH #4 BARS (GRADE 40) 12 INCH O.C. EACH WAY - FOR COLLARS ONLY.
11. EPOXY CLEAN WATER CLEAR CHOICE LOGO BUTTON ON INTERCEPTORS. LOCATION TO BE DETERMINED BY THE ENGINEER.

THIS DETAIL SHEET HAS BEEN PREPARED FOR USE ON HCFC
PROJECTS OR PROJECTS TO BE MAINTAINED BY THE HCFC
WHEN COMPLETED BY OTHERS. AN ENGINEER WHO INCORPORATES
THE DETAILS ON THIS SHEET BECOMES RESPONSIBLE FOR ITS USE
IN THE END PRODUCT IN ACCORDANCE WITH RULE §137.33 (b)
AND (c) OF THE TEXAS STATE BOARD OF REGISTRATION FOR
PROFESSIONAL ENGINEERS.

P.E. SEAL AND SIGNATURE

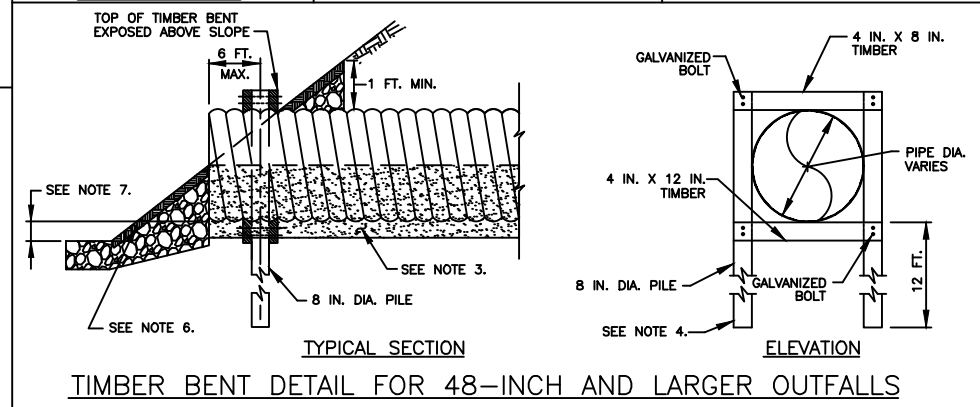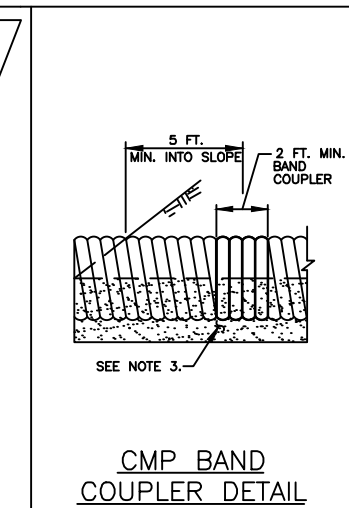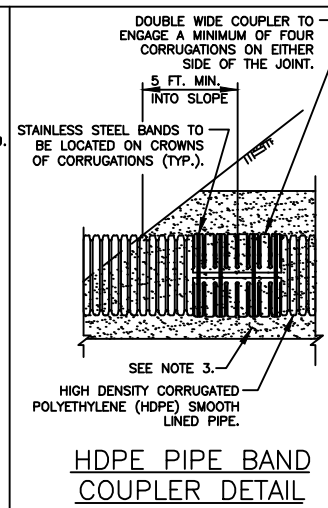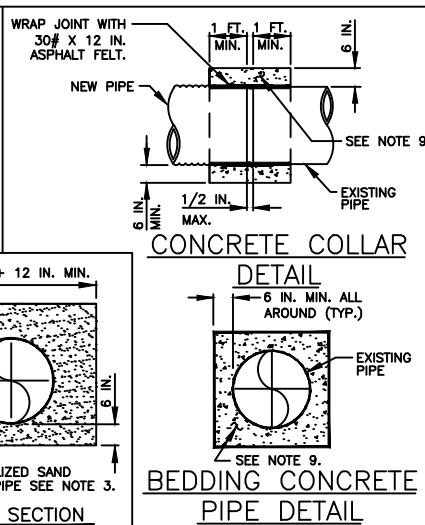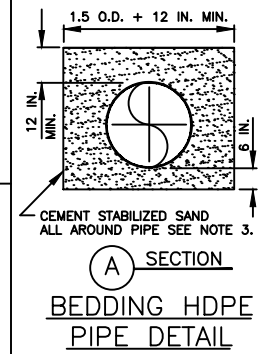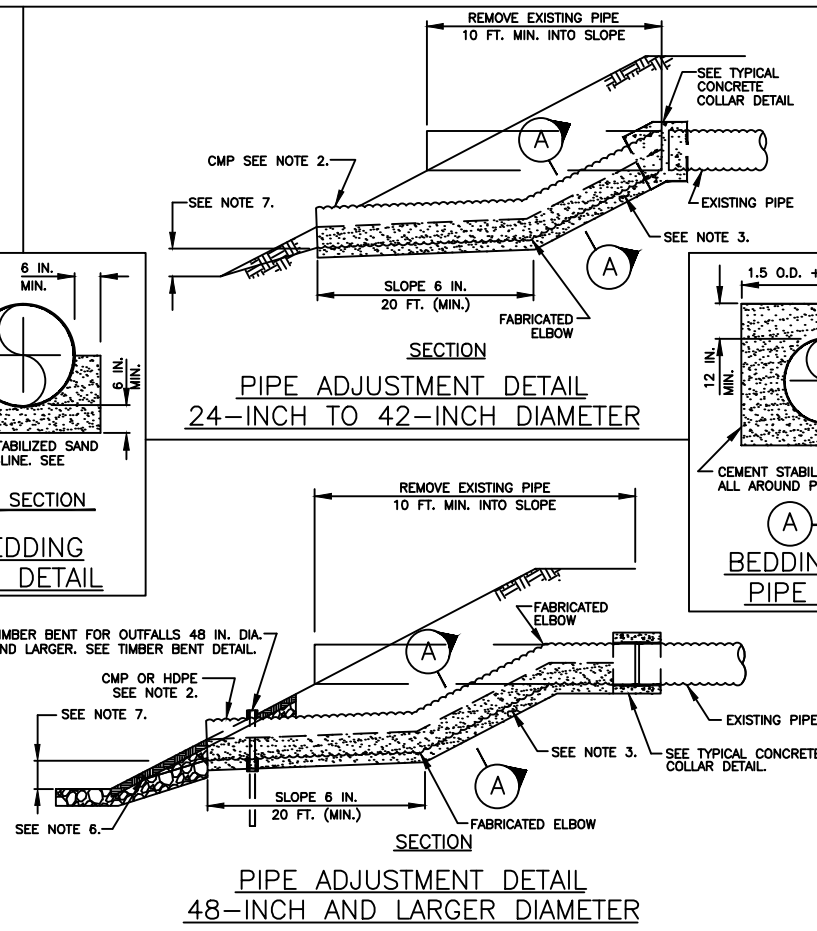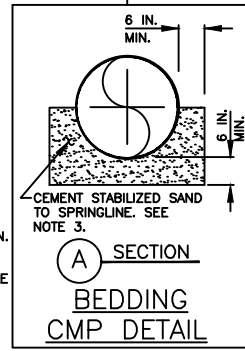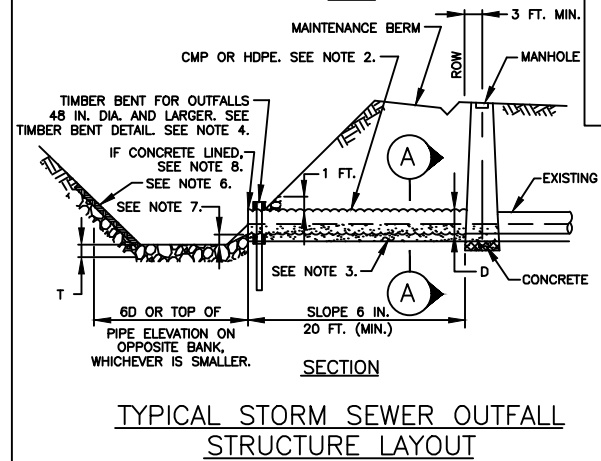

REV	DESCRIPTION	DATE	APPR

PREPARED:	
CHECKED:	
APPROVED:	STORM SEWER AND RIPRAP DETAILS



STORM DRAINAGE HCFCF STORM SEWER AND RIPRAP DETAILS	REV	ISSUER	DATE	APPR
	0	MAM	07/10/2018	
	1	MAM	04/21/2020	




City Service Center
448 State Highway 75
Huntsville, TX 77320

DEPARTMENT OF
ENGINEERING & MAPPING
ENGINEERING DIVISION

DATE: 04/21/2020
SCALE: NTS


SHEET 1 OF 1
SD-34

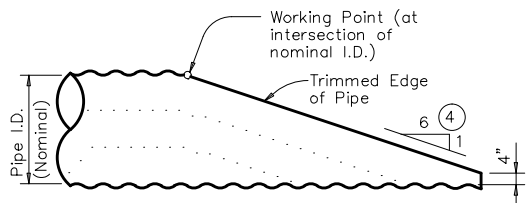


NOTE: All Cross Pipes, calculations, and dimensions are based on the pipe culverts mitered as shown in this detail. Alternate styles of mitered ends will require that appropriate adjustments be made to the values presented on this standard.

SIDE ELEVATION OF TYPICAL PIPE CULVERT MITER

(Showing Corrugated Metal Pipe Culvert.)
(Details at Concrete Pipe Culvert are similar.)

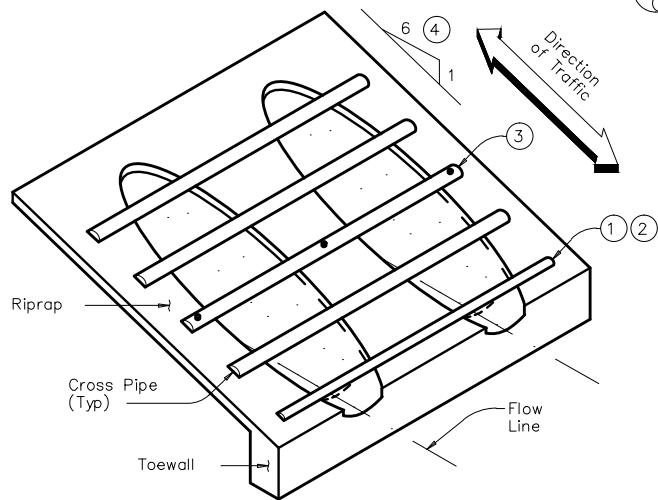


ISOMETRIC VIEW OF TYPICAL INSTALLATION

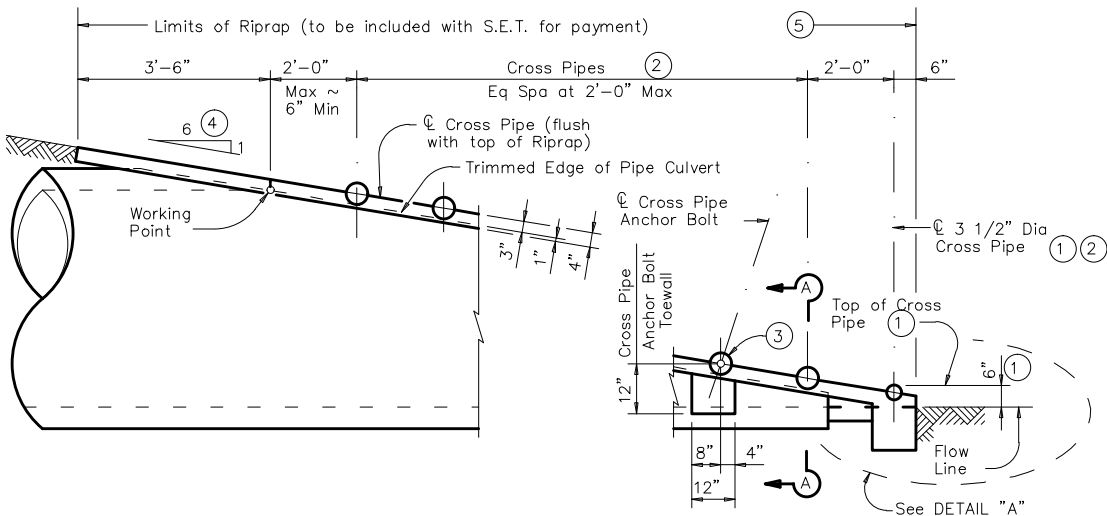


SIDE ELEVATION OF CAST-IN-PLACE CONCRETE


(Showing Concrete Pipe Culvert.)
(Details at Corrugated Metal Pipe Culvert are similar.)

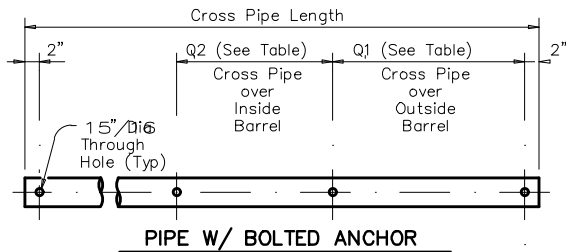

PIPE W/ BOLTED ANCHOR

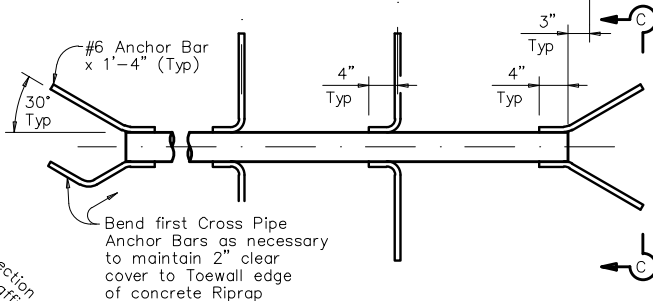


PIPE W/ ANCHOR BARS

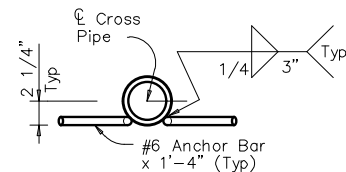


SECTION C-C

CROSS PIPE DETAILS

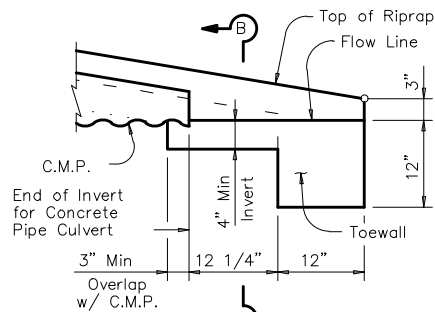


DETAIL "A"

(Showing Invert with Corrugated Metal Pipe Culvert. Concrete Pipe Culvert details are similar. Cross Pipes not shown for clarity.)

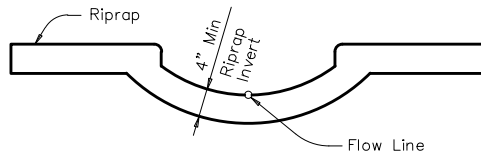


SECTION B-B


(Cross Pipes not shown for clarity.)

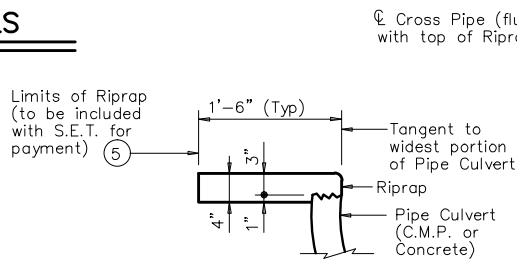

SHOWING TYPICAL PIPE CULVERT & RIPRAP

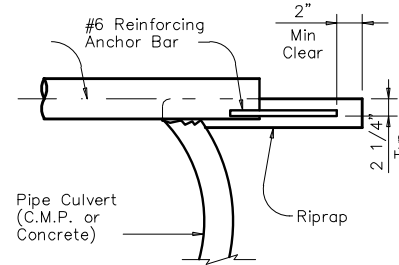

SHOWING CROSS PIPE WITH ANCHOR BAR

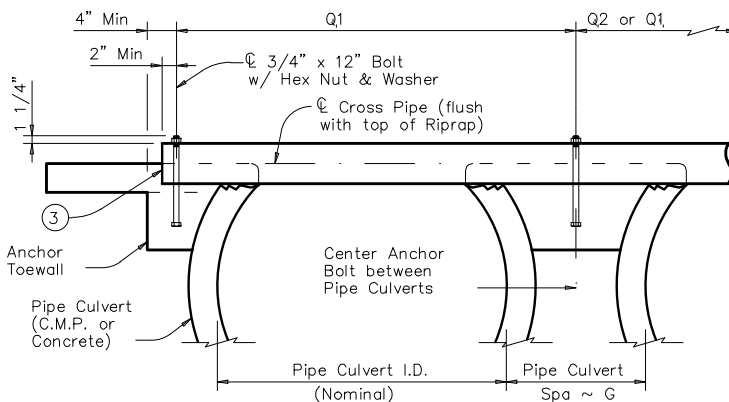

SECTION A-A

CROSS PIPE LENGTHS, REQUIRED PIPE SIZES, & RIPRAP QUANTITIES

Nominal Culvert I.D.	Conc Riprap (CY)	Pipe Culvert Spa ~ G	Single Barrel ~ Q1	Multi-Barrel ~ Q1	Q2	Conditions for use of Cross Pipes	Cross Pipe Size
12"	0.6	9"	N/A	2'- 1"	1'- 9"	3 or more Pipe Culverts	3" Std (3.500" O.D.)
15"	0.7	11"	N/A	2'- 5"	2'- 2"		
18"	0.8	1'- 2"	N/A	2'-10"	2'- 8"		
21"	0.9	1'- 4"	N/A	3'- 2"	3'- 1"		
24"	0.9	1'- 7"	N/A	3'- 6"	3'- 7"	3 or more Pipe Culverts	3 1/2" Std (4.000" O.D.)
27"	1.0	1'- 8"	N/A	3'-10"	3'-11"	2 or more Pipe Culverts	
30"	1.1	1'-10"	N/A	4'- 2"	4'- 4"	All Pipe Culverts	4" Std (4.500" O.D.)
33"	1.2	1'-11"	4'- 2"	4'- 5"	4'- 8"		
36"	1.3	2'- 1"	4'- 5"	4'- 9"	5'- 1"	All Pipe Culverts	5" Std (5.563" O.D.)
42"	1.5	2'- 4"	4'-11"	5'- 5"	5'-10"		
48"	1.7	2'- 7"	5'- 5"	6'- 0"	6'- 7"		
54"	2.0	3'- 0"	5'-11"	6'- 9"	7'- 6"		
60"	2.2	3'- 3"	6'- 5"	7'- 4"	8'- 3"	All Pipe Culverts	
66"	2.4	3'- 3"	6'-11"	7'-10"	8'- 9"		
72"	2.7	3'- 4"	7'- 5"	8'- 5"	9'- 4"		

- The proper installation of the first Cross Pipe is critical for vehicle safety. The top of the first Cross Pipe must be placed at no more than 6" above the flow line.
- Size of Cross Pipes, except the first bottom pipe, shall be as shown in the PIPE SIZE table. The first bottom pipe shall be 3 1/2" Standard Pipe (4" O.D.).
- The third Cross Pipe from the bottom of the Culvert shall always be installed using a bolted connection. Care shall be taken to ensure that Riprap concrete does not flow into the Cross Pipe so as to permit disassembly of the bolted connection to allow cleanout access. At the Contractor's option, all other Cross Pipes may also be installed using the bolted connection details.
- Match Cross Slope as shown elsewhere in the plans. Cross Slope of 6:1 or flatter is required for vehicle safety.
- Riprap placed beyond the limits shown will be paid as Concrete Riprap in accordance with Item 432, "Riprap".
- Quantities shown are for one end of one reinforced Concrete Pipe Culvert. For multiple pipe culverts or for Corrugated Metal Pipe Culverts, quantities will need to be adjusted. Riprap quantities are for Contractor's information only.

GENERAL NOTES:

Cross Pipes are designed for a traversing load of 10,000 pounds at yield as recommended by Research Report 280-2F, "Safety Treatment of Roadside Parallel-Drainage Structures", Texas Transportation Institute, March 1981.

Safety End Treatments shown herein are intended for use in those installations where out of control vehicles are likely to traverse the openings approximately perpendicular to the Cross Pipes.

Riprap and all necessary inverts shall be Concrete Riprap conforming to the requirements of Item 432, "Riprap".

Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise.

Payment for riprap and toewall is included in the Price Bid for each Safety End Treatment.


Cross Pipes shall conform to the requirements of ASTM A53 (Type E or S, Grade B), ASTM A500 (Grade B), or API 5LX52.

Bolts and nuts shall conform to ASTM A307.

All steel components, except concrete reinforcing, shall be galvanized after fabrication. Galvanizing damaged during transport or construction shall be repaired in accordance with the specifications.

		Bridge Division Standard	
SAFETY END TREATMENT			
FOR 12' DIA TO 72' DIA			
PIPE CULVERTS			
TYPE II ~ PARALLEL DRAINAGE			
SETP-PD			
FILE: setppdse.dgn	DN: GAF	CK: CAT	DN: JRP
©TXDOT February 2010	CONT	SECT	HIGHWAY
REVISIONS		SHEET NO.	
11-10 Add note for synthetic fibers.			


APPR					
DATE	07/10/2018				
ISSUER	MAM	MAM			
REV	0	1			
STORM DRAINAGE					
SAFETY END TREATMENT					
FOR 12" DIA TO 72" DIA PIPE CULVERTS TYPE II-PARALLEL DRAINAGE					
DEPARTMENT OF ENGINEERING & MAPPING					
ENGINEERING DIVISION					
City Service Center 448 State Highway 75 Huntsville, TX 77320					
DATE: 04/21/2020 SCALE: NTS					
SHEET 1 OF 1					
SD-35					

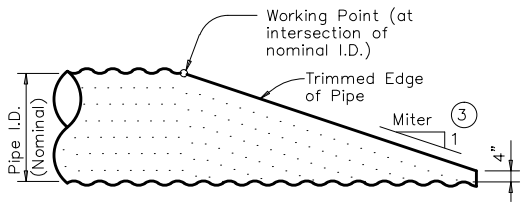

NOTE: All Pipe Runners, calculations, and dimensions are based on the pipe culverts mitered as shown in this detail. Alternate styles of mitered ends will require that appropriate adjustments be made to the values presented on this standard.


SIDE ELEVATION OF TYPICAL PIPE CULVERT MITER

(Showing Corrugated Metal Pipe Culvert. Details of Concrete Pipe Culvert are similar.)

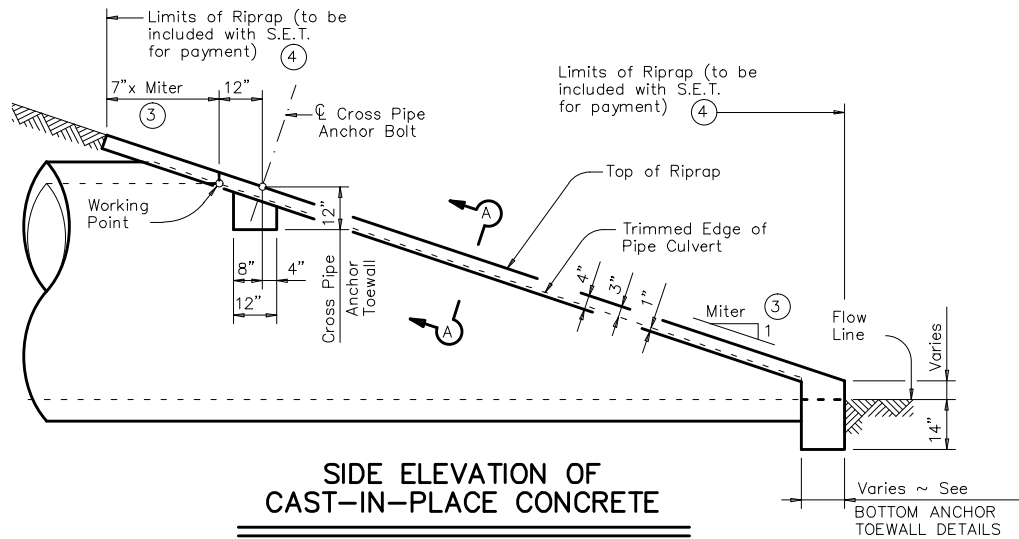

SIDE ELEVATION OF CAST-IN-PLACE CONCRETE

(Showing Concrete Pipe Culvert. Details of Corrugated Metal Pipe Culvert are similar. Pipe Runners not shown for clarity)

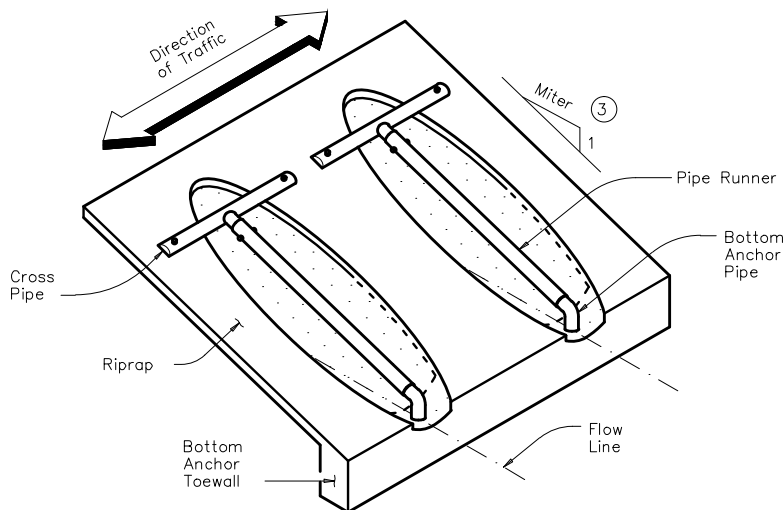

ISOMETRIC VIEW OF TYPICAL INSTALLATION

(Showing installation with no skew.)

① Size of Pipe Runner shall be as shown in the tables. Cross Pipe shall be the same size as the Pipe Runner. Cross Pipe Stub Out and Bottom Anchor Pipe shall be the next smaller size pipe as shown in the STANDARD PIPE SIZES table.

② This standard allows for the placement of only one pipe runner across each culvert pipe opening. In order to limit the clear opening to be traversed by an errant vehicle, the following conditions must be met:

For 60" culvert pipes, the skew must not exceed 0°.
For 54" culvert pipes, the skew must not exceed 15°.
For 48" culvert pipes, the skew must not exceed 30°.
For all culvert pipe sizes 42" and less, the skew must not exceed 45°.

If the above conditions cannot be met, the designer should consider using a safety end treatment with flared wings. For further information, refer to the TxDOT "Roadway Design Manual".

③ Miter = Slope of Mitered Pipe Culvert End

④ Riprap placed beyond the limits shown will be paid as Concrete Riprap in accordance with Item 432, "Riprap".

⑤ Quantities shown are for one end of one reinforced Concrete Pipe Culvert. For multiple Pipe Culverts or for Corrugated Metal Pipe Culverts, quantities will need to be adjusted. Riprap quantities are for Contractor's information only.

CROSS PIPE LENGTHS & PIPE RUNNER LENGTHS ① ②

Nominal Culvert I.D.	Pipe Culvert Spa ~ G	Cross Pipe Length	Pipe Runner Length											
			3:1 Side Slope				4:1 Side Slope				6:1 Side Slope			
			0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew
24"	1'- 7"	3'- 5"	N/A	N/A	N/A	5'-10"	N/A	N/A	N/A	8'- 1"	N/A	N/A	N/A	12'- 9"
27"	1'- 8"	3'- 8"	N/A	N/A	5'- 5"	6'-11"	N/A	N/A	7'- 7"	9'- 7"	N/A	N/A	11'-11"	14'-11"
30"	1'-10"	3'-11"	N/A	N/A	6'- 4"	8'- 0"	N/A	N/A	8'- 9"	11'- 0"	N/A	N/A	13'- 8"	17'- 0"
33"	1'-11"	4'- 2"	6'- 2"	6'- 5"	7'- 3"	9'- 1"	8'- 6"	8'-10"	10'- 0"	12'- 5"	13'- 3"	13'- 9"	15'- 5"	19'- 2"
36"	2'- 1"	4'- 5"	6'-11"	7'- 3"	8'- 2"	10'- 2"	9'- 6"	9'-11"	11'- 2"	13'-10"	14'- 9"	15'- 3"	17'- 2"	21'- 3"
42"	2'- 4"	4'-11"	8'- 6"	8'-10"	9'-11"	12'- 4"	11'- 7"	12'- 0"	13'- 6"	16'- 8"	17'- 9"	18'- 5"	20'- 8"	25'- 7"
48"	2'- 7"	5'- 5"	10'- 1"	10'- 5"	11'- 9"	N/A	13'- 7"	14'- 2"	15'-10"	N/A	20'- 9"	21'- 6"	24'- 2"	N/A
54"	3'- 0"	5'-11"	11'- 8"	12'- 1"	N/A	N/A	15'- 8"	16'- 3"	N/A	N/A	23'-10"	24'- 8"	N/A	N/A
60"	3'- 3"	6'- 5"	13'- 3"	N/A	N/A	N/A	17'- 9"	N/A	N/A	N/A	26'-10"	N/A	N/A	N/A

TYPICAL PIPE CULVERT MITERS ③

Side Slope	0° Skew	15° Skew	30° Skew	45° Skew
3:1	3:1	3.106:1	3.464:1	4.243:1
4:1	4:1	4.141:1	4.619:1	5.657:1
6:1	6:1	6.212:1	6.928:1	8.485:1

CONDITIONS WHERE PIPE RUNNERS ARE NOT REQUIRED ②

Nominal Culvert I.D.	Single Pipe Culvert	Multiple Pipe Culverts
12" thru 21"	Skews thru 45°	Skews thru 45°
24"	Skews thru 45°	Skews thru 30°
27"	Skews thru 30°	Skews thru 15°
30"	Skews thru 15°	Skews thru 15°
33"	Skews thru 15°	Always required
36"	Normal(No Skew)	Always required
42" to 60"	Always required	Always required

STANDARD PIPE SIZES & MAX PIPE RUNNER LENGTHS ①

Pipe Size	Pipe O.D.	Pipe I.D.	Max Pipe Runner Length
2" STD	2.375"	2.067"	N/A
3" STD	3.500"	3.068"	10'- 0"
4" STD	4.500"	4.026"	19'- 8"
5" STD	5.563"	5.047"	34'- 2"

ESTIMATED CONCRETE RIPRAP QUANTITIES (CY) ⑤

Nominal Culvert I.D.	3:1 Side Slope				4:1 Side Slope				6:1 Side Slope			
	0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew
12"	0.4	0.4	0.5	0.5	0.5	0.5	0.5	0.6	0.7	0.7	0.7	0.8
15"	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.7	0.7	0.7	0.8	0.9
18"	0.5	0.5	0.6	0.6	0.6	0.7	0.7	0.8	0.8	0.8	0.9	1.0
21"	0.6	0.6	0.6	0.7	0.7	0.7	0.8	0.9	0.9	0.9	1.0	1.2
24"	0.6	0.7	0.7	0.8	0.8	0.8	0.8	1.0	1.0	1.0	1.1	1.3
27"	0.7	0.7	0.8	0.9	0.8	0.9	0.9	1.1	1.1	1.1	1.2	1.4
30"	0.8	0.8	0.8	0.9	0.9	0.9	1.0	1.2	1.2	1.2	1.3	1.6
33"	0.8	0.8	0.9	1.0	1.0	1.0	1.1	1.3	1.3	1.4	1.5	1.7
36"	0.9	0.9	0.9	1.1	1.1	1.1	1.2	1.4	1.4	1.5	1.6	1.8
42"	1.0	1.0	1.1	1.3	1.2	1.3	1.3	1.6	1.6	1.7	1.8	2.1
48"	1.1	1.1	1.2	N/A	1.4	1.4	1.5	N/A	1.9	1.9	2.1	N/A
54"	1.3	1.3	N/A	N/A	1.6	1.6	N/A	N/A	2.1	2.1	N/A	N/A
60"	1.4	N/A	N/A	N/A	1.7	N/A	N/A	N/A	2.3	N/A	N/A	N/A

SHEET 1 OF 2



SAFETY END TREATMENT FOR 12' DIA TO 60' DIA PIPE CULVERTS TYPE II ~ CROSS DRAINAGE

SETP-CD

FILE: setpcdse.dgn	DN: GAF	OK: CAT	DN: JRP	OK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS				
11-10: Add note for synthetic fibers.	DIST	COUNTY		SHEET NO.

STORM DRAINAGE

SAFETY END TREATMENT FOR 12" DIA TO 60" DIA PIPE CULVERTS TYPE II-CROSS DRAINAGE


DEPARTMENT OF
ENGINEERING & MAPPING
ENGINEERING DIVISION




City Service Center
448 State Highway 75
Huntsville, TX 77320

DATE: 04/21/2020
SCALE: NTS

SHEET 1 OF 1
SD-36

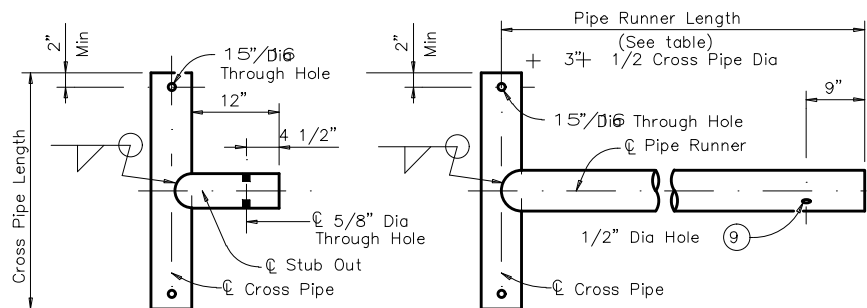


OPTION A1
OPTION A2
CROSS PIPE AND CONNECTIONS DETAILS

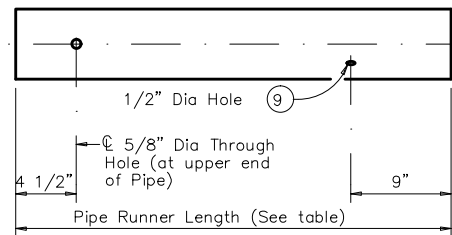


NOTE: The separate Pipe Runner shown is required when Cross Pipe Connection Option A1 is used.

PIPE RUNNER DETAILS

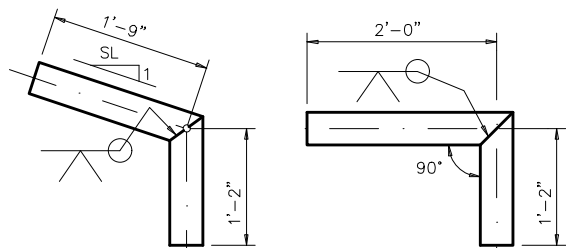


OPTION B1
OPTION B2
BOTTOM ANCHOR PIPE DETAILS (10)

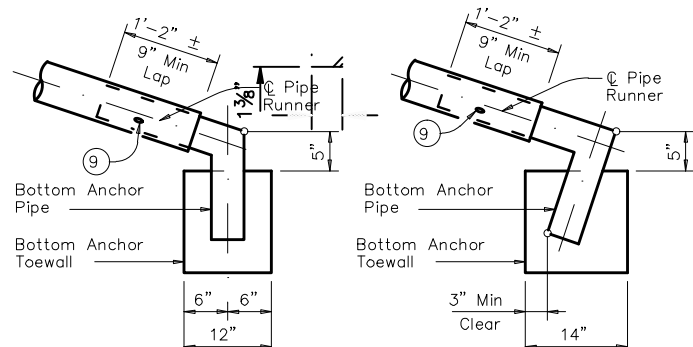


OPTION B1
OPTION B2
BOTTOM ANCHOR TOEWALL DETAILS

(Culvert & Riprap not shown for clarity)

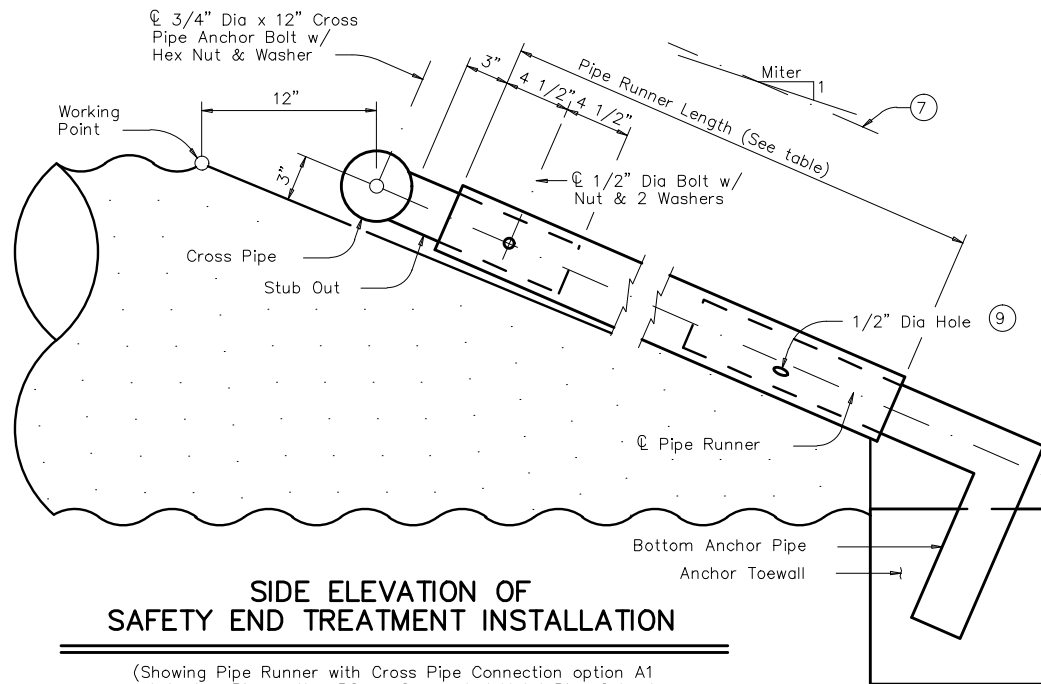


SIDE ELEVATION OF SAFETY END TREATMENT INSTALLATION


(Showing Pipe Runner with Cross Pipe Connection option A1 and Anchor Pipe option B2 on Corrugated Metal Pipe Culvert. Concrete Pipe Culvert details are similar. Riprap not shown for clarity)

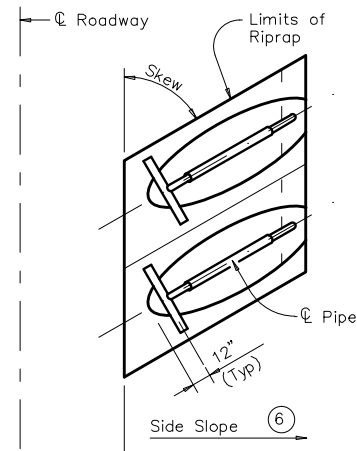

PLAN OF SKEWED INSTALLATION

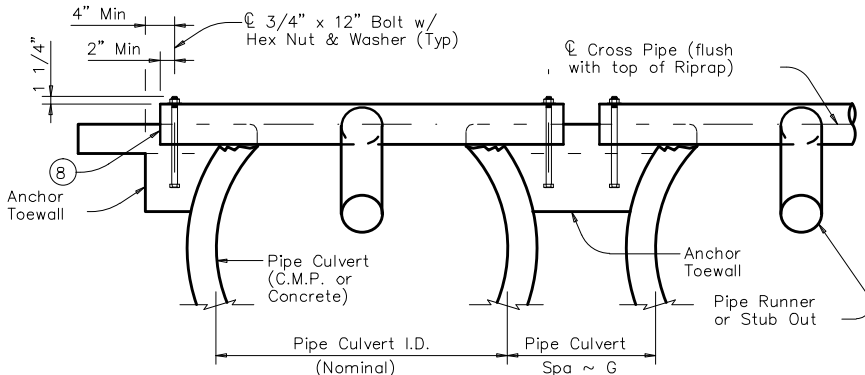

SHOWING CROSS PIPE & ANCHOR TOEWALL

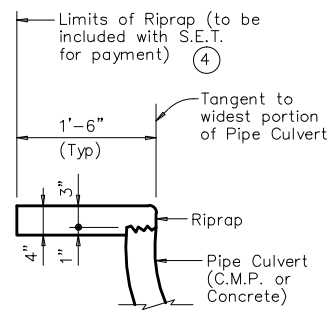

SHOWING TYPICAL PIPE CULVERT & RIPRAP

SECTION A-A

- (4) Riprap placed beyond the limits shown will be paid as Concrete Riprap in accordance with Item 432, "Riprap".
- (6) Recommended values of side slope are 3:1, 4:1, & 6:1. All quantities, calculations, and dimensions shown herein are based on these recommended values. Slope of 3:1 or flatter is required for vehicle safety.
- (7) Note that actual slope of Pipe Runner may vary slightly from Side Slope of Riprap and trimmed Culvert Pipe edge.
- (8) Care shall be taken to ensure that Riprap concrete does not flow into the Cross Pipe so as to permit disassembly of the bolted connection to allow cleanout access.
- (9) After installation, the 1/2" hole shall be inspected to ensure that the lap of the Pipe Runner with the Bottom Anchor Pipe is adequate.
- (10) At fabricator's option, a heat bend to a smooth 5" radius or a manufactured elbow (of the same material as the Runner) may be substituted for the mitered and welded joint in the Bottom Anchor Pipe.

GENERAL NOTES:

Pipe Runners are designed for a traversing load of 1,800 pounds at yield as recommended by Research Report 280-1, "Safety Treatment of Roadside Cross-Drainage Structures", Texas Transportation Institute, March 1981.

The Safety End Treatments shown herein are intended for use in those installations where out of control vehicles are likely to traverse the openings approximately perpendicular to the Pipe Runners.

Riprap and all necessary inverts shall be Concrete Riprap conforming to the requirements of Item 432, "Riprap".

Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise.

Payment for riprap and toewall is included in the Price Bid for each Safety End Treatment.

Pipe Runners, Cross Pipes, and Anchor Pipes shall conform to the requirements of ASTM A53 (Type E or S, Grade B), ASTM A500 (Grade B), or API 5LX52.

Bolts and nuts shall conform to ASTM A307.





All steel components, except concrete reinforcing, shall be galvanized after fabrication. Galvanizing damaged during transport or construction shall be repaired in accordance with the specifications.

SHEET 2 OF 2

	Bridge Division Standard
SAFETY END TREATMENT	
FOR 12" DIA TO 60" DIA	
PIPE CULVERTS	
TYPE II ~ CROSS DRAINAGE	
SETP-CD	
FILE: setpcdse.dgn	DW: GAF
©TxDOT February 2010	CONT: SECT
REVISIONS	JOB: HIGHWAY
11-10 Add note for synthetic fibers.	DIST: COUNTY: SHEET NO:

APPR					
DATE	07/10/2018				
ISSUER	MAM				
REV	0	1			
STORM DRAINAGE					
SAFETY END TREATMENT					
FOR 12" DIA TO 60" DIA PIPE CULVERTS TYPE II-CROSS DRAINAGE					
DEPARTMENT OF ENGINEERING & MAPPING					
ENGINEERING DIVISION					
City Service Center					
448 State Highway 75					
Huntsville, TX 77320					
DATE: 04/21/2020					
SCALE: NTS					
SHEET 1 OF 1					
SD-37					


TABLE OF VARIABLE DIMENSIONS AND QUANTITIES FOR ONE HEADWALL ⁽⁴⁾									
SLOPE	DIA OF PIPE	Values for one Pipe					Values to be added for each add'l Pipe		
		W	X	Y	L	Reinf (Lbs)	Conc (CY) ⁽¹⁾	X and W	Reinf (Lbs)
2:1	12"	4'- 7 1/2"	2'- 6"	2'-10"	3'- 3 1/4"	0.6		1'-20"	0.2
	15"	5'- 5 3/4"	2'- 9 1/2"	3'- 4"	3'-10 1/4"	0.7		2'-22"	0.3
	18"	6'- 4 1/4"	3'- 1"	3'-10"	4'-12 1/2"	0.9		2'-32"	0.3
	21"	7'- 2 3/4"	3'- 4 1/2"	4'- 4"	5'-10 3/4"	1.1		3'-43"	0.4
	24"	8'- 2 1/2"	3'- 9 1/2"	4'-10"	5'-15 5/8"	1.3		3'-50"	0.5
	27"	9'- 1"	4'- 1"	5'- 4"	6'-12 3/4"	1.5		3'-56"	0.6
	30"	9'-11 1/2"	4'- 4 1/2"	5'-10"	6'- 8 3/4"	1.7		4'-63"	0.8
	33"	10'-10"	4'- 8"	6'- 4"	7'- 3 3/4"	2.0		4'-78"	0.9
	36"	11'- 8 1/4"	4'-11 1/2"	6'-10"	7'-10 3/4"	2.2		5'-81"	1.0
	42"	13'- 5 1/4"	5'- 6 1/2"	7'-10"	9'- 0 1/2"	2.8		5'-90"	1.3
	48"	15'- 9"	6'- 1 1/2"	9'- 4"	10'- 9 1/2"	3.8		6'-117"	1.7
	54"	17'- 5 3/4"	6'- 8 1/2"	10'- 4"	11'-11 1/4"	4.5		7'-156"	2.1
3:1	60"	19'- 2 3/4"	7'- 3 1/2"	11'- 4"	13'- 4 5/8"	5.3		8'-176"	2.5
	66"	20'-11 1/2"	7'-10 1/2"	12'- 4"	14'- 5 3/8"	6.2		8'-199"	2.9
	72"	22'- 8 1/2"	8'- 5 1/2"	13'- 4"	15'- 4 3/4"	7.1		9'-213"	3.3
	12"	6'- 3"	2'- 6"	4'- 3"	4'-11 1/4"	0.8		1'-22"	0.2
	15"	7'- 5"	2'- 9 1/2"	5'- 0"	5'- 9 1/8"	1.1		2'-28"	0.3
	18"	8'- 6 3/4"	3'- 1"	5'- 9"	6'- 7 3/8"	1.3		2'-38"	0.5
	21"	9'- 8 3/4"	3'- 4 1/2"	6'- 6"	7'-10 9/16"	1.6		3'-48"	0.6
	24"	11'- 0"	3'- 9 1/2"	7'- 3"	8'- 4 1/2"	2.0		3'-58"	0.7
	27"	12'- 2"	4'- 1"	8'- 0"	9'- 2 3/4"	2.3		3'-67"	0.8
	30"	13'- 4"	4'- 4 1/2"	8'- 9"	10'- 1 1/8"	2.7		4'-74"	1.0
	33"	14'- 5 3/4"	4'- 8"	9'- 6"	10'-11 3/4"	3.1		4'-88"	1.2
	36"	15'- 7 3/4"	4'-11 1/2"	10'- 3"	11'-10 1/4"	3.5		5'-96"	1.4
4:1	42"	17'-11 1/2"	5'- 6 1/2"	11'- 9"	13'- 6 3/4"	4.5		5'-110"	1.7
	48"	21'- 1 3/4"	6'- 1 1/2"	14'- 0"	16'- 5 1/2"	6.1		6'-146"	2.3
	54"	23'- 5 1/2"	6'- 8 1/2"	15'- 6"	17'-10 3/4"	7.3		7'-186"	2.9
	60"	25'- 9 1/4"	7'- 3 1/2"	17'- 0"	19'- 7 1/2"	8.7		8'-219"	3.4
	66"	28'- 1"	7'-10 1/2"	18'- 6"	21'- 4 1/4"	10.1		8'-242"	3.9
	72"	30'- 4 3/4"	8'- 5 1/2"	20'- 0"	23'- 1 1/4"	11.7		9'-272"	4.4
	12"	7'-10 3/4"	2'- 6"	5'- 8"	6'- 6 1/4"	1.1		1'-24"	0.3
	15"	9'- 4"	2'- 9 1/2"	6'- 8"	7'- 8 1/2"	1.5		2'-32"	0.4
	18"	10'- 9 1/2"	3'- 1"	7'- 8"	8'-10 1/4"	1.9		2'-42"	0.5
	21"	12'- 2 3/4"	3'- 4 1/2"	8'- 8"	10'- 2 5/8"	2.3		3'-57"	0.7
	24"	13'- 9 1/2"	3'- 9 1/2"	9'- 8"	11'- 2 5/8"	2.8		3'-67"	0.9
	27"	15'- 3"	4'- 1"	10'- 8"	12'- 3 3/8"	3.3		3'-77"	1.0
6:1	30"	16'- 8 1/4"	4'- 4 1/2"	11'- 8"	13'- 5 3/4"	3.8		4'-89"	1.3
	33"	18'- 1 3/4"	4'- 8"	12'- 8"	14'- 7 1/2"	4.5		4'-108"	1.4
	36"	19'- 7"	4'-11 1/2"	13'- 8"	15'- 9 1/4"	5.1		5'-115"	1.7
	42"	22'- 5 3/4"	5'- 6 1/2"	15'- 8"	18'- 5 1/8"	6.5		5'-140"	2.1
	48"	26'- 6 1/4"	6'- 1 1/2"	18'- 8"	21'- 6 3/4"	8.9		6'-175"	2.8
	54"	29'- 5"	6'- 8 1/2"	20'- 8"	23'-10 1/8"	10.7		7'-226"	3.6
	60"	32'- 3 3/4"	7'- 3 1/2"	22'- 8"	26'- 9 3/4"	12.7		8'-263"	4.3
	66"	35'- 2 1/2"	7'-10 1/2"	24'- 8"	28'- 5 1/2"	14.9		8'-309"	4.9
	72"	38'- 1 1/4"	8'- 5 1/2"	26'- 8"	30'- 9 1/2"	17.3		9'-334"	5.6
	12"	11'- 2"	2'- 6"	8'- 6"	9'- 9 3/4"	1.9		1'-28"	0.4
	15"	13'- 2 1/4"	2'- 9 1/2"	10'- 0"	11'- 6 1/4"	2.5		2'-32"	0.5
	18"	15'- 2 1/2"	3'- 1"	11'- 6"	13'- 3 1/4"	3.2		2'-50"	0.7
	21"	17'- 2 3/4"	3'- 4 1/2"	13'- 0"	15'- 0 1/8"	3.9		3'-69"	0.9
	24"	19'- 4 1/2"	3'- 9 1/2"	14'- 6"	16'- 4 1/4"	4.8		3'-80"	1.2
	27"	21'- 4 3/4"	4'- 1"	16'- 0"	18'- 5 3/8"	5.7		3'-98"	1.4
	30"	23'- 5 1/4"	4'- 4 1/2"	17'- 6"	20'- 2 1/8"	6.7		4'-110"	1.7
	33"	25'- 5 1/2"	4'- 8"	19'- 0"	21'-11 1/8"	7.8		4'-128"	2.0
	36"	27'- 5 3/4"	4'-11 1/2"	20'- 6"	23'- 8 1/4"	9.0		5'-144"	2.3
	42"	31'- 6 1/4"	5'- 6 1/2"	23'- 6"	27'- 1 1/2"	11.5		5'-170"	3.0
	48"	37'- 3 1/2"	6'- 1 1/2"	28'- 0"	32'-11 1/4"	15.9		6'-237"	4.0
	54"	41'- 4 1/4"	6'- 8 1/2"	31'- 0"	35'- 9 1/2"	19.2		7'-300"	5.0
	60"	45'- 4 3/4"	7'- 3 1/2"	34'- 0"	39'-16 3/4"	22.9		8'-353"	6.0

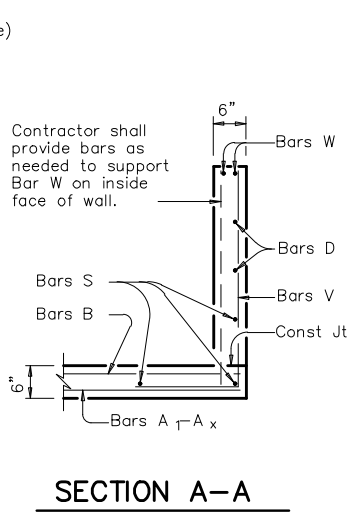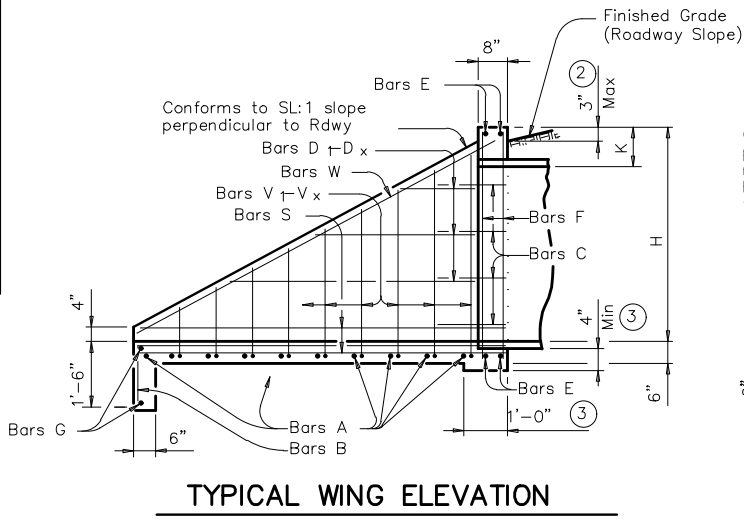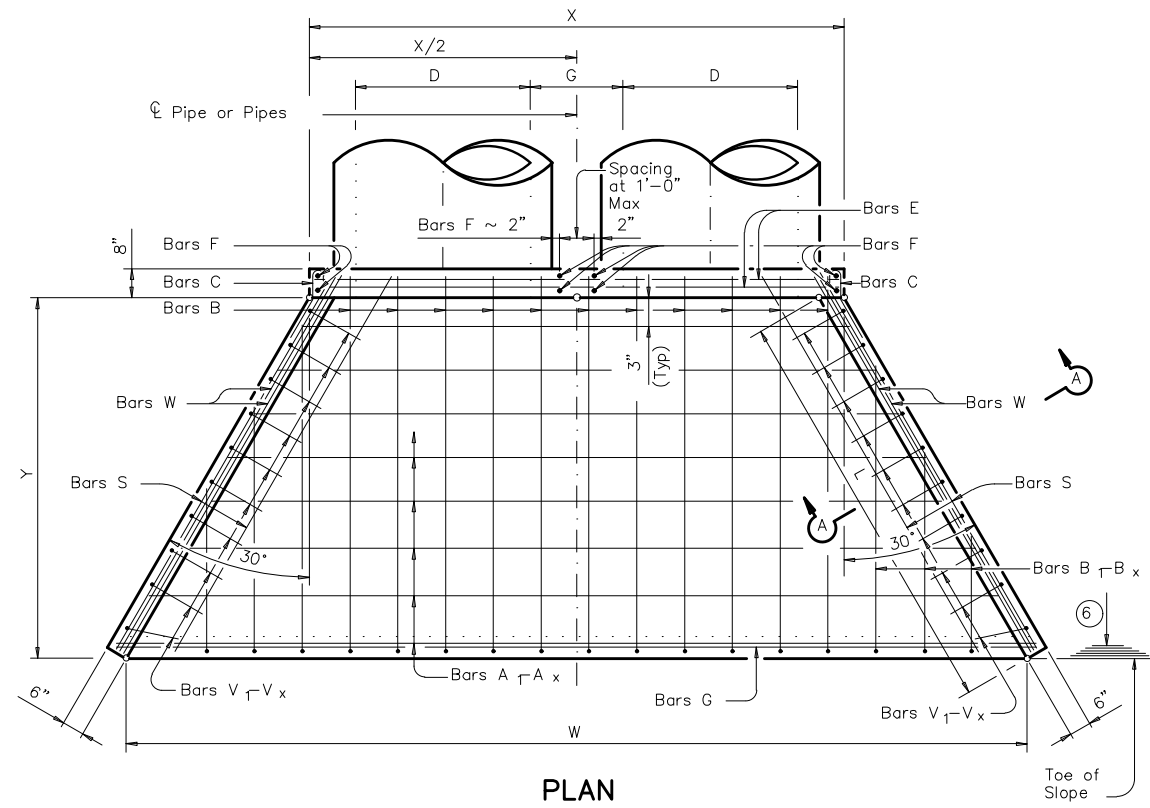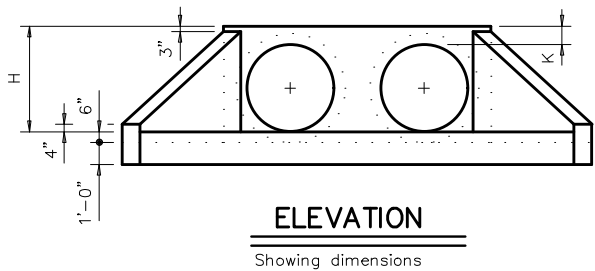

- Quantities shown are for concrete pipe and will increase slightly for metal pipe installations.
- For vehicle safety, curbs shall project no more than 3" above finished grade. Curb heights shall be reduced, if necessary, to meet these requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- Provide a 1'-0" footing as shown where required to maintain 4" Min cover for pipes.
- Quantities shown are for one structure end only (one headwall).
- Min Length = 6" $\times$ $\left(\frac{12 \times H - 7}{12 \times L} \right)$
Max Length = 12 x H $\times$ $\left(\frac{12 \times H - 7}{12 \times L} \right)$
- Lengths of wings based on SL:1 Slope along this line.

TABLE OF REINFORCING STEEL ⁽⁴⁾			
Bar	Size	Spa	No.
A	# 4	1'-0"	~
B	# 3	1'-6"	~
C	# 4	1'-0"	~
D	# 3	1'-0"	~
E	# 5	~	4
F	# 5	~	~
G	# 3	~	2
S	# 4	~	6
V	# 4	1'-0"	~
W	# 5	~	4

TABLE OF CONSTANT DIMENSIONS			
DIA OF PIPE	G	K	H
12"	9" 1'- 0"	2'- 0"	
15"	11" 1'- 0"	2'- 3"	
18"	1'- 2" 1'- 0"	2'- 6"	
21"	1'- 4" 1'- 0"	2'- 9"	
24"	1'- 7" 1'- 0"	3'- 0"	
27"	1'- 8" 1'- 0"	3'- 3"	
30"	1'-10" 1'- 0"	3'- 6"	
33"	1'-11" 1'- 0"	3'- 9"	
36"	2'- 1" 1'- 0"	4'- 0"	
42"	2'- 4" 1'- 0"	4'- 6"	
48"	2'- 7" 1'- 3"	5'- 3"	
54"	3'- 0" 1'- 3"	5'- 9"	
60"	3'- 3" 1'- 3"	6'- 3"	
66"	3'- 3" 1'- 3"	6'- 9"	
72"	3'- 4" 1'- 3"	7'- 3"	

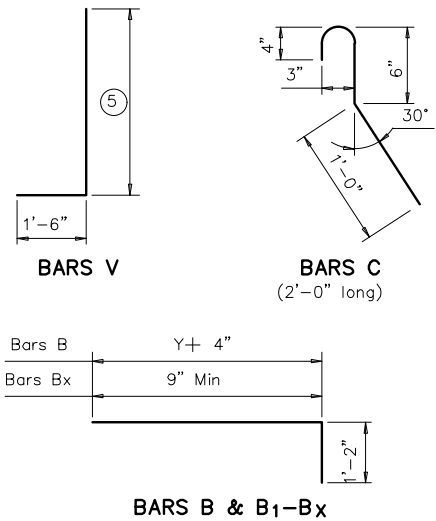

GENERAL NOTES:
Designed according to AASHTO LRFD Specifications.
Reinforcing steel shall be placed with the center of the outside layer of bars 2" from the surface of the concrete.
All reinforcing steel shall be Grade 60.
All concrete shall be Class "C" and shall have a minimum compressive strength of 3600 psi.
No bridge rails of any type may be mounted directly to these culvert headwalls.

Bridge Division Standard

CONCRETE HEADWALLS
WITH FLARED WINGS FOR
0° SKEW PIPE CULVERTS

CH-FW-0

FILE: chfw00se.dgn	DN: TxDDT	CK: TxDDT	DW: TxDDT	CK: GAF
©TxDDT February 2010	CNT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	

APPR					
DATE	07/10/2018				
ISSUER	MAM	MAM			
REV	0	1			

STORM DRAINAGE

CONCRETE HEADWALLS WITH FLARED WINGS
FOR 0 DEGREE SKEW PIPE CULVERTS





DEPARTMENT OF
ENGINEERING & MAPPING
ENGINEERING DIVISION

City Service Center
448 State Highway 75
Huntsville, TX 77320

DATE: 04/21/2020
SCALE: NTS

SHEET 1 OF 1
SD-38


TABLE OF VARIABLE DIMENSIONS AND QUANTITIES FOR ONE HEADWALL (4)									
SLOPE DIA OF PIPED	Values for one Pipe					Values to be added for each add'l Pipe			
	W	X	Y	L	Reinf (Lbs)	Conc (CY) (1)	X and W	Reinf (Lbs)	Conc (CY) (1)
2:1	12" 4'- 9"	3'- 1 1/2"	2'-10"	4'- 9"	0.6		2'- 022/40	2	
	15" 5'- 6 3/4"	3'- 5 1/4"	3'- 4"	4'- 8 11/22"	0.8		2'-28"	0.3	
	18" 6'- 4 3/4"	3'- 9 1/4"	3'-10"	5'- 12 9"	0.9		3'-41"	0.4	
	21" 7'- 2 3/4"	4'- 1 1/4"	4'- 4"	6'- 1 11/24"	1.1		3'- 64 3/4"	0.5	
	24" 8'- 2 1/2"	4'- 7"	4'-10"	6'- 10 4"	1.4		4'- 153/40"	0.6	
	27" 9'- 0 1/2"	4'-11"	5'- 4"	7'- 6 11/28"	1.6		4'- 662/40"	0.7	
	30" 9'-10 1/2"	5'- 3"	5'-10"	8'- 2 2/2"	1.8		5'-70"	0.9	
	33" 10'- 8 3/4"	5'- 7"	6'- 4"	8'-11 1225"	2.1		5'- 479/410"		
	36" 11'- 6 3/4"	5'-11 1/4"	6'-10"	9'- 250"	2.4		5'-1090/2112"		
	42" 13'- 2 3/4"	6'- 7 1/4"	7'-10"	11'- 304"	3.0		6'- 809/415"		
	48" 15'- 4 3/4"	7'- 3 1/4"	9'- 4"	13'- 2 1369"	4.0		7'- 142/420"		
	54" 17'- 1"	7'-11 1/2"	10'- 4"	14'- 7 1429"	4.7		8'-478"	2.5	
3:1	60" 18'- 9"	8'- 7 1/2"	11'- 4"	16'- 0 1484"	5.6		9'- 694/429"		
	66" 20'- 5"	9'- 3 1/2"	12'- 4"	17'- 5 1590"	6.5		10'- 2107/433"		
	72" 22'- 1 1/4"	9'-11 3/4"	13'- 4"	18'-10 1644"	7.5		10'- 239/437"		
	12" 6'- 2"	3'- 1 1/2"	4'- 3"	6'- 10 8"	0.9		2'- 024/40"	3	
	15" 7'- 2 3/4"	3'- 5 1/4"	5'- 0"	7'- 0 342"	1.1		2'-316"	0.4	
	18" 8'- 3 3/4"	3'- 9 1/4"	5'- 9"	8'- 1 11/23"	1.4		3'-48"	0.5	
	21" 9'- 4 3/4"	4'- 1 1/4"	6'- 6"	9'- 2 1104"	1.7		3'- 653/40"		
	24" 10'- 7 1/2"	4'- 7"	7'- 3"	10'- 227"	2.1		4'- 165/408"		
	27" 11'- 8 1/2"	4'-11"	8'- 0"	11'- 3 3235"	2.4		4'- 676/410"		
	30" 12'- 9 1/2"	5'- 3"	8'- 9"	12'- 4 1298"	2.8		5'- 86"	1.2	
	33" 13'-10 3/4"	5'- 7"	9'- 6"	13'- 5 1322"	3.2		5'- 493/413"		
	36" 14'-11 3/4"	5'-11 1/4"	10'- 3"	14'- 355"	3.7		5'-1008/215"		
4:1	42" 17'- 1 3/4"	6'- 7 1/4"	11'- 9"	16'- 7 1440"	4.6		6'- 833/420"		
	48" 20'- 0 3/4"	7'- 3 1/4"	14'- 0"	19'- 9 1542"	6.2		7'- 776/427"		
	54" 22'- 3"	7'-11 1/2"	15'- 6"	21'- 1626"	7.5		8'-218"	3.3	
	60" 24'- 5"	8'- 7 1/2"	17'- 0"	24'- 0 1725"	8.9		9'- 846/439"		
	66" 26'- 7"	9'- 3 1/2"	18'- 6"	26'- 821"	10.4		10'- 274/445"		
	72" 28'- 9 1/4"	9'-11 3/4"	20'- 0"	28'- 3 1930"	12.0		10'- 309/451"		
	12" 7'- 7"	3'- 1 1/2"	5'- 8"	8'- 0 1156"	1.2		2'- 028/40"	3	
	15" 8'-10 3/4"	3'- 5 1/4"	6'- 8"	9'- 5 1186"	1.5		2'-36"	0.5	
	18" 10'- 2 3/4"	3'- 9 1/4"	7'- 8"	10'- 1228"	1.9		3'-52"	0.6	
	21" 11'- 6 3/4"	4'- 1 1/4"	8'- 8"	12'- 254"	2.3		3'- 663/408"		
	24" 13'- 0 1/2"	4'- 7"	9'- 8"	13'- 301"	2.8		4'- 175/410"		
	27" 14'- 4 1/2"	4'-11"	10'- 8"	15'- 339"	3.4		4'- 687/412"		
6:1	30" 15'- 8 1/2"	5'- 3"	11'- 8"	16'- 364"	3.9		5'-99"	1.4	
	33" 17'- 0 3/4"	5'- 7"	12'- 8"	17'-1432"	4.5		5'- 412/417"		
	36" 18'- 4 3/4"	5'-11 1/4"	13'- 8"	19'- 479"	5.2		5'-1028/219"		
	42" 21'- 0 3/4"	6'- 7 1/4"	15'- 8"	22'- 1 564"	6.6		6'- 858/425"		
	48" 24'- 8 3/4"	7'- 3 1/4"	18'- 8"	26'- 4 386"	8.9		7'- 211/433"		
	54" 27'- 5"	7'-11 1/2"	20'- 8"	29'- 2 374"	10.8		8'-258"	4.1	
	60" 30'- 1"	8'- 7 1/2"	22'- 8"	32'- 0 399"	12.8		9'- 897/449"		
	66" 32'- 9"	9'- 3 1/2"	24'- 8"	34'-10 1139"	14.9		10'- 340/456"		
	72" 35'- 5 1/4"	9'-11 3/4"	26'- 8"	37'- 8 1290"	17.3		10'- 978/464"		
	12" 10'- 5"	3'- 1 1/2"	8'- 6"	12'- 0 1243"	1.9		2'- 032/40"	4	
	15" 12'- 2 3/4"	3'- 5 1/4"	10'- 0"	14'- 1 3745"	2.5		2'-48"	0.6	
	18" 14'- 0 3/4"	3'- 9 1/4"	11'- 6"	16'- 3 536"	3.2		3'-61"	0.8	
6:1	21" 15'-10 3/4"	4'- 1 1/4"	13'- 0"	18'- 4 1395"	3.9		3'- 678/411"		
	24" 17'-10 1/2"	4'- 7"	14'- 6"	20'- 450"	4.8		4'- 193/414"		
	27" 19'- 8 1/2"	4'-11"	16'- 0"	22'- 7 512"	5.7		4'- 608/416"		
	30" 21'- 6 1/2"	5'- 3"	17'- 6"	24'- 595"	6.6		5'-420"	2.0	
	33" 23'- 4 3/4"	5'- 7"	19'- 0"	26'-10 1624"	7.7		5'- 443/423"		
	36" 25'- 2 3/4"	5'-11 1/4"	20'- 6"	29'- 737"	8.8		5'-1060/227"		
	42" 28'-10 3/4"	6'- 7 1/4"	23'- 6"	33'- 2 3920"	11.3		6'- 802/435"		
	48" 34'- 0 3/4"	7'- 3 1/4"	28'- 0"	39'- 7 1180"	15.5		7'- 274/446"		

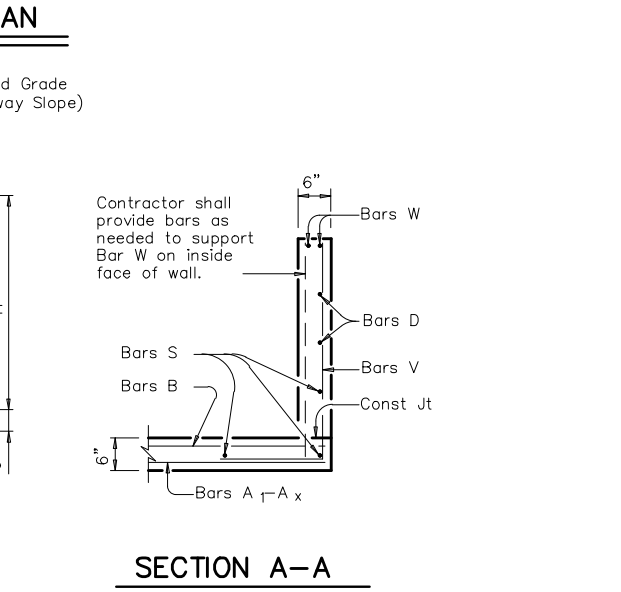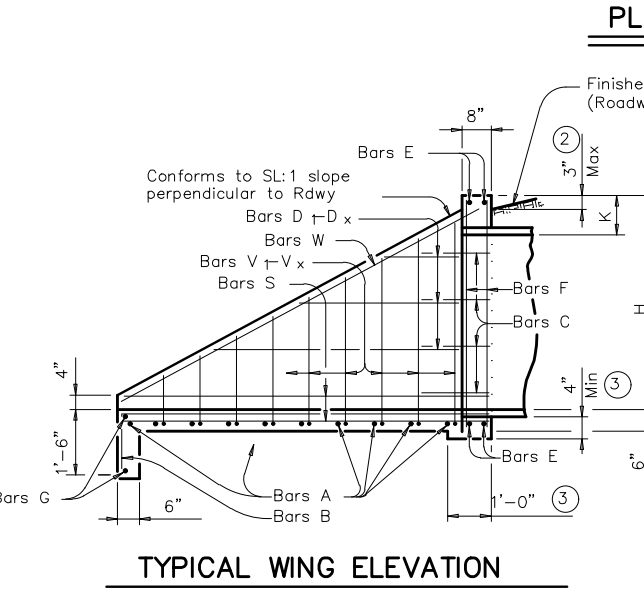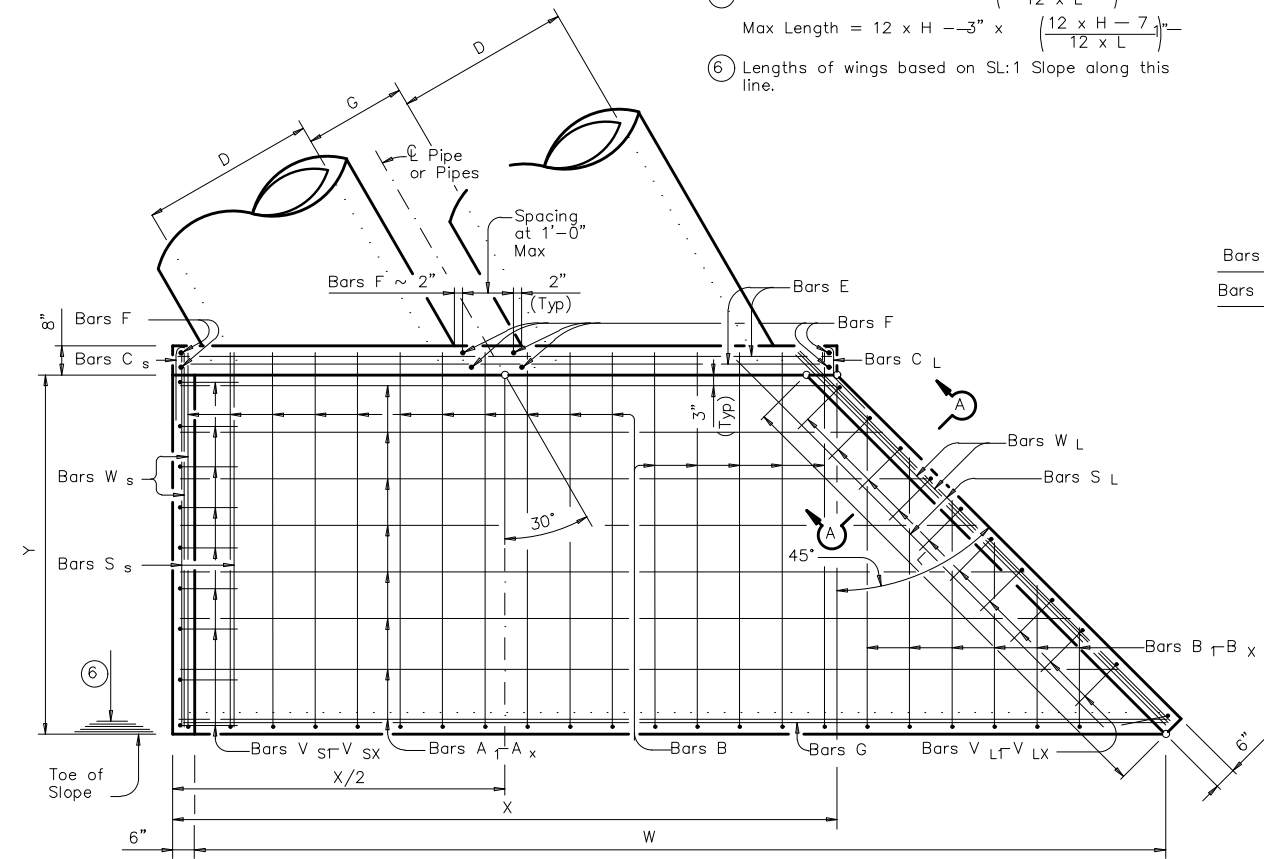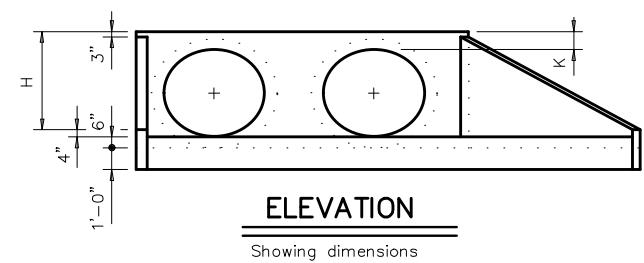

- Quantities shown are for concrete pipe and will increase slightly for metal pipe installations.
- For vehicle safety, curbs shall project no more than 3" above finished grade. Curb heights shall be reduced, if necessary, to meet these requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- Provide a 1'-0" footing as shown where required to maintain 4" Min cover for pipes.
- Quantities shown are for one structure end only (one headwall).
- Min Length = 6" + 13" x $\left(\frac{12 \times H - 7}{12 \times L}\right)$
Max Length = 12 x H - 3" x $\left(\frac{12 \times H - 7}{12 \times L}\right)$
- Lengths of wings based on SL:1 Slope along this line.

TABLE OF REINFORCING STEEL (4)			
Bar	Size	Spa	No.
A	# 4	1'-0"	~
B	# 3	1'-6"	~
CL	# 4	1'-0"	~
CS	# 4	1'-0"	~
D	# 3	1'-0"	~
E	# 5	~	4
F	# 5	~	~
G	# 3	~	2
SL	# 4	~	3
SS	# 4	~	3
V	# 4	1'-0"	~
WL	# 5	~	2
WS	# 5	~	2

TABLE OF CONSTANT DIMENSIONS			
DIA OF PIPED	G	K	H
12"	9" 1'- 0"	2'- 0"	
15"	11" 1'- 0"	2'- 3"	
18"	1'- 2" 1'- 0"	2'- 6"	
21"	1'- 4" 1'- 0"	2'- 9"	
24"	1'- 7" 1'- 0"	3'- 0"	
27"	1'- 8" 1'- 0"	3'- 3"	
30"	1'-10" 1'- 0"	3'- 6"	
33"	1'-11" 1'- 0"	3'- 9"	
36"	2'- 1" 1'- 0"	4'- 0"	
42"	2'- 4" 1'- 0"	4'- 6"	
48"	2'- 7" 1'- 3"	5'- 3"	
54"	3'- 0" 1'- 3"	5'- 9"	
60"	3'- 3" 1'- 3"	6'- 3"	
66"	3'- 3" 1'- 3"	6'- 9"	
72"	3'- 4" 1'- 3"	7'- 3"	

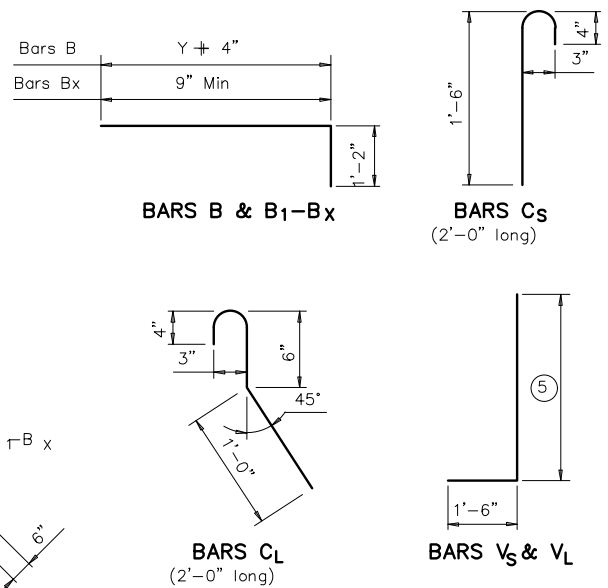

GENERAL NOTES:
Designed according to AASHTO LRFD Specifications.
Reinforcing steel shall be placed with the center of the outside layer of bars 2" from the surface of the concrete.
All reinforcing steel shall be Grade 60.
All concrete shall be Class "C" and shall have a minimum compressive strength of 3600 psi.
No bridge rails of any type may be mounted directly to these culvert headwalls.








CONCRETE HEADWALLS
WITH FLARED WINGS FOR
30° SKEW PIPE CULVERTS

CH-FW-30

FILE: chfw30se.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	

TABLE OF VARIABLE DIMENSIONS AND QUANTITIES FOR ONE HEADWALL ④									
SLOPE DIA OF PIPED	Values for one Pipe					Values to be added for each add'l Pipe			
	W	X	Y	L	Reinf (Lbs)	Conc (CY)	X and W	Reinf (Lbs)	Conc (CY)
2:1	12"	7'- 7 3/4"	4'- 3"	2'-10"	5'-185	0.9	2'- 563/40.3		
	15"	8'-10 1/2"	4'- 7 1/4"	3'- 4"	6'-181	1.1	3'- 323/8.4		
	18"	10'- 1 1/4"	4'-11 1/2"	3'-10"	7'-183	1.3	3'- 98/40.5		
	21"	11'- 3 3/4"	5'- 3 3/4"	4'- 4"	8'-181	1.6	4'- 64/40.6		
	24"	12'- 6 1/2"	5'- 8"	4'-10"	9'-208	1.8	5'- 063/40.8		
	27"	13'- 9"	6'- 0 1/4"	5'- 4"	10'-225	2.1	5'- 675/20.9		
	30"	14'-11 3/4"	6'- 4 1/2"	5'-10"	11'-259	2.5	6'- 186/21.1		
	33"	16'- 3"	6'- 9 1/2"	6'- 4"	12'-284	2.8	6'- 792/41.2		
	36"	17'- 6 1/4"	7'- 2 1/4"	6'-10"	13'-316	3.2	7'- 207/41.4		
	42"	20'- 1"	8'- 0 1/4"	7'-10"	15'-383	4.0	8'-438" 1.8		
	48"	23'- 6"	8'-10 1/4"	9'- 4"	18'-468	5.4	9'- 363/42.4		
	54"	26'- 0 3/4"	9'- 8" 10'- 4"	20'-349	6.4	10'- 798/43.0			
3:1	12"	7'- 7 3/4"	4'- 3"	2'-10"	5'-185	0.9	2'- 563/40.3		
	15"	8'-10 1/2"	4'- 7 1/4"	3'- 4"	6'-181	1.1	3'- 323/8.4		
	18"	10'- 1 1/4"	4'-11 1/2"	3'-10"	7'-183	1.3	3'- 98/40.5		
	21"	11'- 3 3/4"	5'- 3 3/4"	4'- 4"	8'-181	1.6	4'- 64/40.6		
	24"	12'- 6 1/2"	5'- 8"	4'-10"	9'-208	1.8	5'- 063/40.8		
	27"	13'- 9"	6'- 0 1/4"	5'- 4"	10'-225	2.1	5'- 675/20.9		
	30"	14'-11 3/4"	6'- 4 1/2"	5'-10"	11'-259	2.5	6'- 186/21.1		
	33"	16'- 3"	6'- 9 1/2"	6'- 4"	12'-284	2.8	6'- 792/41.2		
	36"	17'- 6 1/4"	7'- 2 1/4"	6'-10"	13'-316	3.2	7'- 207/41.4		
	42"	20'- 1"	8'- 0 1/4"	7'-10"	15'-383	4.0	8'-438" 1.8		
	48"	23'- 6"	8'-10 1/4"	9'- 4"	18'-468	5.4	9'- 363/42.4		
	54"	26'- 0 3/4"	9'- 8" 10'- 4"	20'-349	6.4	10'- 798/43.0			
4:1	12"	7'- 7 3/4"	4'- 3"	2'-10"	5'-185	0.9	2'- 563/40.3		
	15"	8'-10 1/2"	4'- 7 1/4"	3'- 4"	6'-181	1.1	3'- 323/8.4		
	18"	10'- 1 1/4"	4'-11 1/2"	3'-10"	7'-183	1.3	3'- 98/40.5		
	21"	11'- 3 3/4"	5'- 3 3/4"	4'- 4"	8'-181	1.6	4'- 64/40.6		
	24"	12'- 6 1/2"	5'- 8"	4'-10"	9'-208	1.8	5'- 063/40.8		
	27"	13'- 9"	6'- 0 1/4"	5'- 4"	10'-225	2.1	5'- 675/20.9		
	30"	14'-11 3/4"	6'- 4 1/2"	5'-10"	11'-259	2.5	6'- 186/21.1		
	33"	16'- 3"	6'- 9 1/2"	6'- 4"	12'-284	2.8	6'- 792/41.2		
	36"	17'- 6 1/4"	7'- 2 1/4"	6'-10"	13'-316	3.2	7'- 207/41.4		
	42"	20'- 1"	8'- 0 1/4"	7'-10"	15'-383	4.0	8'-438" 1.8		
	48"	23'- 6"	8'-10 1/4"	9'- 4"	18'-468	5.4	9'- 363/42.4		
	54"	26'- 0 3/4"	9'- 8" 10'- 4"	20'-349	6.4	10'- 798/43.0			
6:1	12"	7'- 7 3/4"	4'- 3"	2'-10"	5'-185	0.9	2'- 563/40.3		
	15"	8'-10 1/2"	4'- 7 1/4"	3'- 4"	6'-181	1.1	3'- 323/8.4		
	18"	10'- 1 1/4"	4'-11 1/2"	3'-10"	7'-183	1.3	3'- 98/40.5		
	21"	11'- 3 3/4"	5'- 3 3/4"	4'- 4"	8'-181	1.6	4'- 64/40.6		
	24"	12'- 6 1/2"	5'- 8"	4'-10"	9'-208	1.8	5'- 063/40.8		
	27"	13'- 9"	6'- 0 1/4"	5'- 4"	10'-225	2.1	5'- 675/20.9		
	30"	14'-11 3/4"	6'- 4 1/2"	5'-10"	11'-259	2.5	6'- 186/21.1		
	33"	16'- 3"	6'- 9 1/2"	6'- 4"	12'-284	2.8	6'- 792/41.2		
	36"	17'- 6 1/4"	7'- 2 1/4"	6'-10"	13'-316	3.2	7'- 207/41.4		
	42"	20'- 1"	8'- 0 1/4"	7'-10"	15'-383	4.0	8'-438" 1.8		
	48"	23'- 6"	8'-10 1/4"	9'- 4"	18'-468	5.4	9'- 363/42.4		
	54"	26'- 0 3/4"	9'- 8" 10'- 4"	20'-349	6.4	10'- 798/43.0			

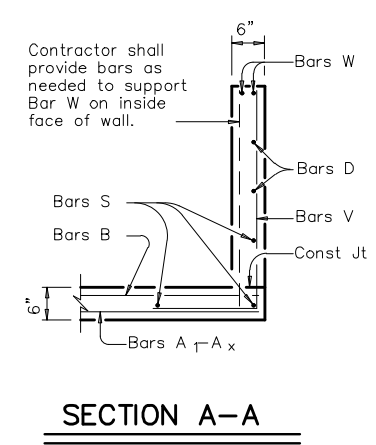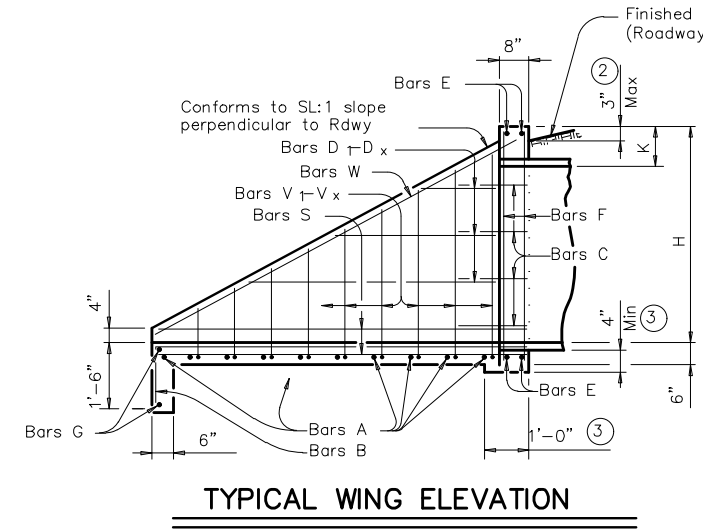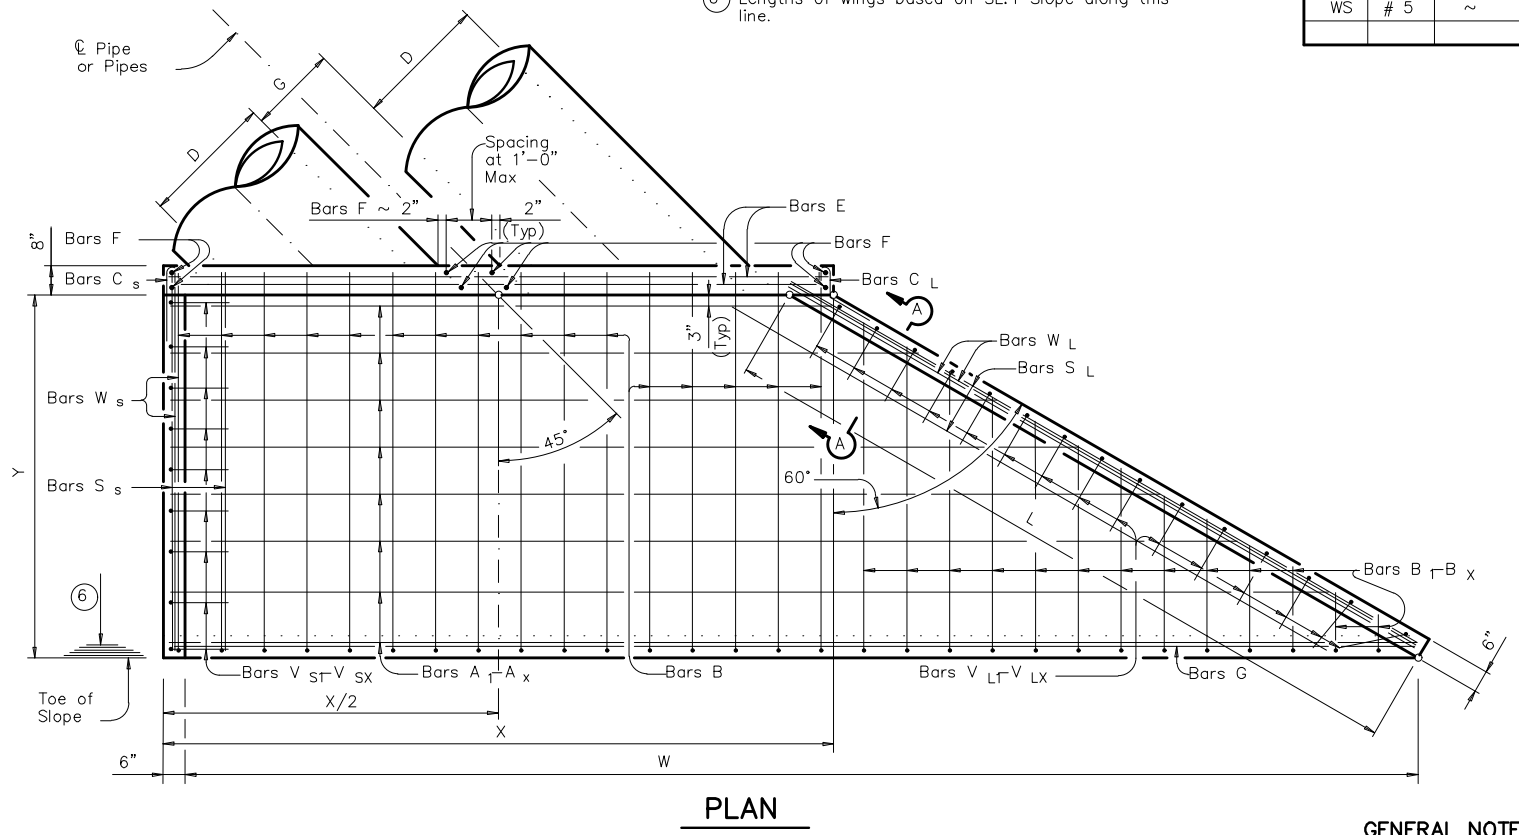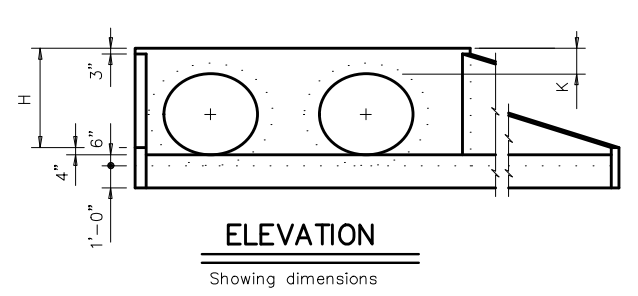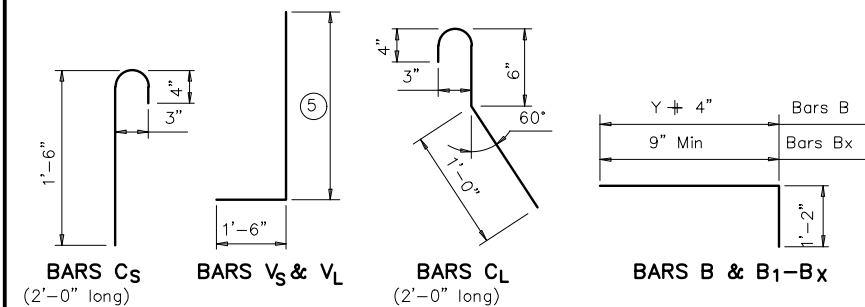

- Quantities shown are for concrete pipe and will increase slightly for metal pipe installations.
- For vehicle safety, curbs shall project no more than 3" above finished grade. Curb heights shall be reduced, if necessary, to meet these requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- Provide a 1'-0" footing as shown where required to maintain 4" Min cover for pipes.
- Quantities shown are for one structure end only (one headwall).
- Min Length = 6" + 13" x $\left(\frac{12 \times H - 7}{12 \times L}\right)$
Max Length = 12 x H - 3" x $\left(\frac{12 \times H - 7}{12 \times L}\right)$
- Lengths of wings based on SL:1 Slope along this line.

TABLE OF REINFORCING STEEL ④			
Bar	Size	Spa	No.
A	# 4	1'-0"	~
B	# 3	1'-6"	~
CL	# 4	1'-0"	~
CS	# 4	1'-0"	~
D	# 3	1'-0"	~
E	# 5	~	4
F	# 5	~	~
G	# 3	~	2
SL	# 4	~	3
SS	# 4	~	3
V	# 4	1'-0"	~
WL	# 5	~	2
WS	# 5	~	2

TABLE OF CONSTANT DIMENSIONS			
DIA OF PIPED	G	K	H
12"	9"	1'- 0"	2'- 0"
15"	11"	1'- 0"	2'- 3"
18"	1'- 2"	1'- 0"	2'- 6"
21"	1'- 4"	1'- 0"	2'- 9"
24"	1'- 7"	1'- 0"	3'- 0"
27"	1'- 8"	1'- 0"	3'- 3"
30"	1'-10"	1'- 0"	3'- 6"
33"	1'-11"	1'- 0"	3'- 9"
36"	2'- 1"	1'- 0"	4'- 0"
42"	2'- 4"	1'- 0"	4'- 6"
48"	2'- 7"	1'- 3"	5'- 3"
54"	3'- 0"	1'- 3"	5'- 9"
60"	3'- 3"	1'- 3"	6'- 3"
66"	3'- 3"	1'- 3"	6'- 9"
72"	3'- 4"	1'- 3"	7'- 3"

GENERAL NOTES:
Designed according to AASHTO LRFD Specifications.
Reinforcing steel shall be placed with the center of the outside layer of bars 2" from the surface of the concrete.
All reinforcing steel shall be Grade 60.
All concrete shall be Class "C" and shall have a minimum compressive strength of 3600 psi.
No bridge rails of any type may be mounted directly to these culvert headwalls.

Bridge Division Standard

CONCRETE HEADWALLS WITH FLARED WINGS FOR 45° SKEW PIPE CULVERTS

CH-FW-45

FILE: chfw45se.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	

APPR

DATE

07/10/2018

04/21/2020

ISSUER

MAM

MAM

REV

0

1

STORM DRAINAGE

CONCRETE HEADWALLS WITH FLARED WINGS
FOR 45 DEGREE SKEW PIPE CULVERTS

DEPARTMENT OF
ENGINEERING & MAPPING
ENGINEERING DIVISION

City Service Center
448 State Highway 75
Huntsville, TX 77320

DATE: 04/21/2020
SCALE: NTS

SHEET 1 OF 1
SD-41

TABLE OF DIMENSIONS & REINFORCING STEEL (Wings for One Structure End)									
Dimensions					Variable Reinforcing		Estimated Quantities per ft of wing length (2~Wings)		
Maximum Wingwall Height Hw	W	X	Y	Z	Bars J 1		Bars J 2		Reinf (Lb/Ft)
					Size	Spa	Size	Spa	
2'-6"	2'-5"	1'-0"	9"	7"	#4	1'-0"	#4	1'-0"	33.73
3'-0"	2'-5"	1'-0"	9"	7"	#4	1'-0"	#4	1'-0"	37.07
3'-6"	2'-5"	1'-0"	9"	7"	#4	1'-0"	#4	1'-0"	37.74
4'-0"	2'-5"	1'-0"	9"	7"	#4	1'-0"	#4	1'-0"	38.41
4'-6"	3'-2"	1'-6"	1'-0"	7"	#4	1'-0"	#4	1'-0"	41.75
5'-0"	3'-2"	1'-6"	1'-0"	7"	#4	1'-0"	#4	1'-0"	45.09
5'-6"	3'-2"	1'-6"	1'-0"	7"	#4	1'-0"	#4	1'-0"	45.75
6'-0"	3'-2"	1'-6"	1'-0"	7"	#4	1'-0"	#4	1'-0"	46.42
7'-0"	3'-8"	1'-9"	1'-3"	7"	#4	1'-0"	#4	1'-0"	52.77
8'-0"	4'-2"	2'-0"	1'-6"	8"	#5	1'-0"	#4	1'-0"	60.19
9'-0"	4'-8"	2'-3"	1'-9"	8"	#4	6"	#4	6"	81.49
10'-0"	5'-2"	2'-6"	2'-0"	8"	#5	6"	#4	6"	97.25
11'-0"	5'-8"	2'-9"	2'-3"	8"	#6	6"	#5	6"	133.65
12'-0"	6'-2"	3'-0"	2'-6"	9"	#7	6"	#5	6"	162.29
13'-0"	6'-8"	3'-3"	2'-9"	11"	#7	6"	#5	6"	178.80
14'-0"	7'-2"	3'-6"	3'-0"	1'-0"	#8	6"	#5	6"	216.78
15'-0"	7'-8"	4'-0"	3'-0"	1'-1"	#9	6"	#6	6"	283.06
16'-0"	8'-2"	4'-6"	3'-0"	1'-3"	#9	6"	#6	6"	297.02
									1.234

TABLE OF WINGWALL REINFORCING (2~Wings)			
Bar	Size	No.	Spa
D	#5	~	1'-0"
E	#4	~	1'-0"
F	#4	~	1'-0"
G	#6	4	~
M	#4	4	~
P	#4	~	1'-0"
R	#5	6	~
V	#4	~	1'-0"


TABLE OF ESTIMATED CULVERT TOEWALL QUANTITIES			
Bar	Size	No.	Spa
L	#4	~	1'-6"
Q	#4	1	~
Reinf (Lb/Ft)			2.45
Conc (CY/Ft)			0.037

WING DIMENSION CALCULATIONS:


Formulas: (All values are in Feet)
 $Hw = H + T + C - 0.250'$
 $A = (Hw - 0.333') (SL)$
 $B = (A) \text{ Tangent } (30^\circ)$
 $Lw = (A) \div \text{Cosine } (30^\circ)$
For Cast-in-place culverts:
 $Ltw = (N) (S) \div (N - 1) (U)$
For Precast culverts:
 $Ltw = (N) (2U - S) \div (N - 1) (0.500')$
Total Wingwall Area (Two Wings ~ S.F.) = $(Hw - 0.333') (Lw)$

Hw = Height of Wingwall
SL: 1 = Side Slope Ratio (Horizontal:1 Vertical)
Lw = Length of Wingwall
Ltw = Culvert Toewall Length
N = Number of Culvert Spans


See applicable box culvert standard for H, S, T, and U values.




BARS D



BARS R




BARS J 1



BARS L



BARS V




BARS J 2

- Extend Bars P 3'-0" minimum into bottom slab of Box Culvert.
- Adjust to fit as necessary to maintain 1 1/4" clear cover and 4" minimum between bars.
- Quantities shown are based on an average wing height for two wings (one structure end). To determine total quantities for two wings multiply the tabulated values by Lw.
- Recommended values of Slope are: 2:1, 3:1, 4:1, & 6:1.
- When shown elsewhere on the plans, a 5" deep concrete riprap shall be constructed. Payment for riprap shall be as required by Item 432, "Riprap". Unless otherwise shown on the plans or directed by the Engineer, the riprap shall have a 6" wide by 1'-6" deep reinforced concrete toewall along all edges adjacent to natural ground; the toewall shall be reinforced by extending typical riprap reinforcing into the toewall; construction joints or grooved joints, oriented in the direction of flow, shall extend across the full distance of the riprap, at intervals of approximately 20'. When such riprap is provided, the culvert toewall shown in SECTION B-B will not be required.
- At Contractor's option, Culvert Toewall may be ended flush with Wingwall Toewall. Adjust reinforcing from that shown as necessary.
- 0' min to 5'-0" max. Estimated curb heights are shown elsewhere in the plans. For structures with pedestrian rail, bicycle rail or curbs taller than 1'-0", refer to ECD standard. For structures with T6 bridge rail, refer to T6-CM standard. For structures with traffic rail, other than T6, refer to RAC standard.
- For vehicle safety, curb heights and wall heights shall be reduced, if necessary, to provide a maximum 3" projection above finished grade. No changes will be made in quantities and no additional compensation will be allowed for this work.


GENERAL NOTES:

Designed according to AASHTO LRFD Specifications. All reinforcing steel shall be Grade 60. Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise. All concrete shall be Class "C" and shall have a minimum compressive strength of 3600 psi. All reinforcing bars shall be adjusted to provide a minimum of 1 1/4" clear cover. When structure is founded on solid rock, depth of toewalls for culverts and wingwalls may be reduced or eliminated as directed by the Engineer. See BCS sheet for additional dimensions and information. The quantities for concrete and reinforcing steel resulting from the formulas given on this sheet are for Contractor's information only.

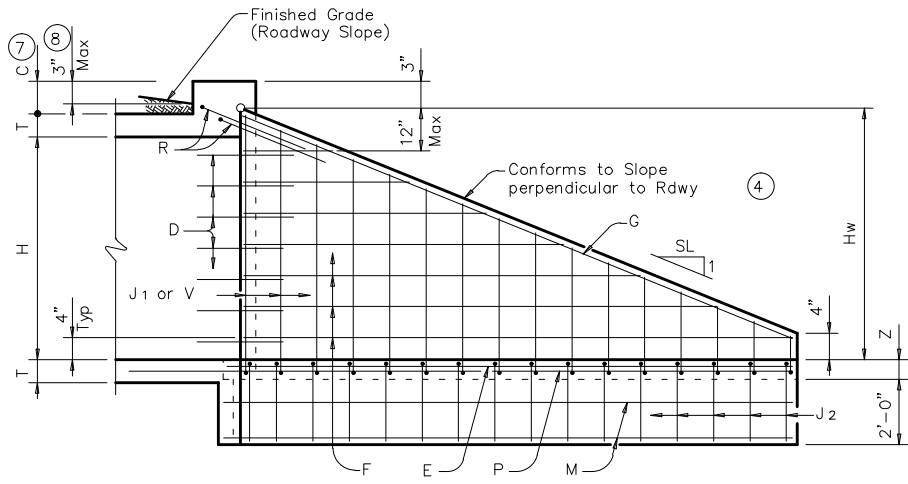


INSIDE ELEVATION

(Showing reinforcing. Culvert and Culvert Toewall reinforcing not shown for clarity.)

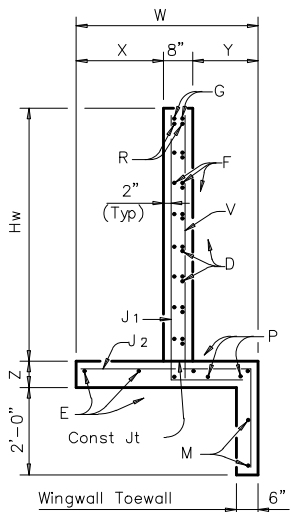


SECTION A-A

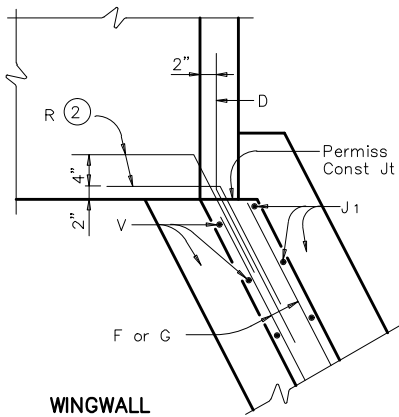

WINGWALL


CORNER DETAILS

(Culvert and Culvert Toewall reinforcing not shown for clarity.)

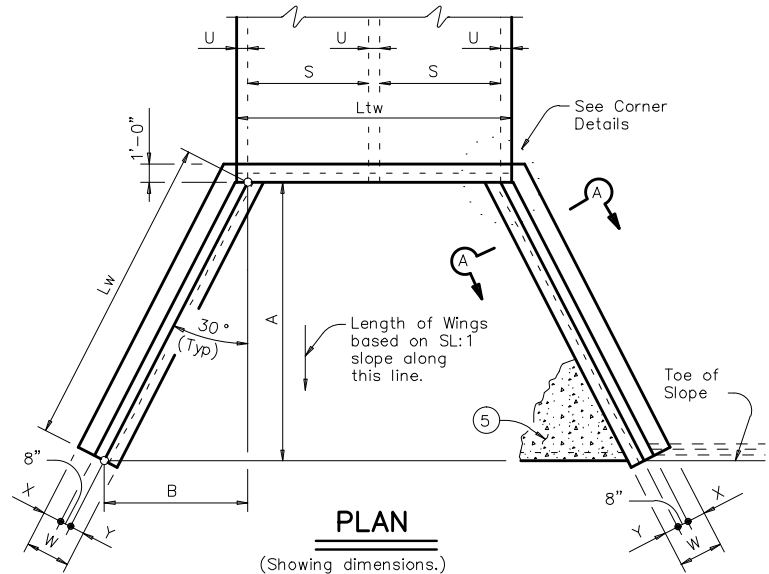


PLAN

(Showing dimensions.)

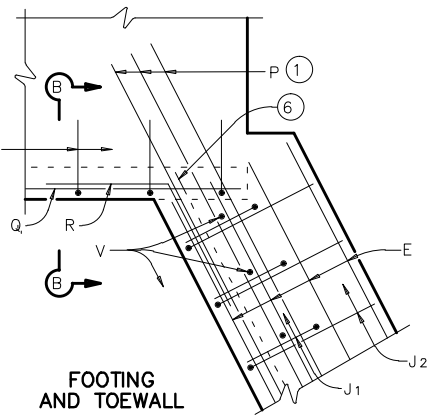

FOOTING AND TOEWALL

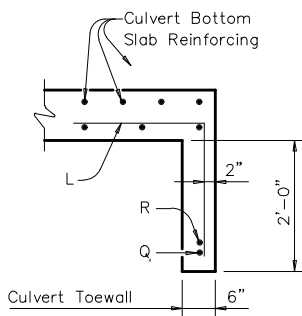

SECTION B-B

(5)

		Bridge Division Standard			
CONCRETE WINGWALLS WITH FLARED WINGS FOR 0° SKEW BOX CULVERTS					
FW-0					
FILE: fw-0stdedgn	DN: GAF	CK: CAT	DN: TxDOT		
©TxDOT February 2010	CONT	SECT	JOB		
REVISIONS		HIGHWAY			
11-10: Add note for synthetic fibers.	DIST	COUNTY	SHEET NO.		

APPR					
DATE	07/10/2018				
ISSUER	MAM				
REV	0	1			
STORM DRAINAGE					
CONCRETE WINGWALLS WITH FLARED WINGS FOR 0 DEGREE SKEW BOX CULVERTS					
DEPARTMENT OF ENGINEERING & MAPPING					
City Service Center 448 State Highway 75 Huntsville, TX 77320					
DATE: 04/21/2020 SCALE: NTS					
SHEET 1 OF 1 SD-42					

TABLE OF DIMENSIONS & REINFORCING STEEL (Wings for One Structure End)										
Dimensions					Variable Reinforcing				Estimated Quantities per ft of wing length (2~Wings)	
Maximum Wingwall Height Hw	W	X	Y	Z	Bars J 1		Bars J 2		Reinf (Lb/Ft)	Conc (CY/Ft)
					Size	Spa	Size	Spa		
2'-6"	2'-5"	1'-0"	9"	7"	#4	1'-0"	#4	1'-0"	33.73	0.248
3'-0"	2'-5"	1'-0"	9"	7"	#4	1'-0"	#4	1'-0"	37.07	0.261
3'-6"	2'-5"	1'-0"	9"	7"	#4	1'-0"	#4	1'-0"	37.74	0.273
4'-0"	2'-5"	1'-0"	9"	7"	#4	1'-0"	#4	1'-0"	38.41	0.285
4'-6"	3'-2"	1'-6"	1'-0"	7"	#4	1'-0"	#4	1'-0"	41.75	0.330
5'-0"	3'-2"	1'-6"	1'-0"	7"	#4	1'-0"	#4	1'-0"	45.09	0.343
5'-6"	3'-2"	1'-6"	1'-0"	7"	#4	1'-0"	#4	1'-0"	45.75	0.355
6'-0"	3'-2"	1'-6"	1'-0"	7"	#4	1'-0"	#4	1'-0"	46.42	0.367
7'-0"	3'-8"	1'-9"	1'-3"	7"	#4	1'-0"	#4	1'-0"	52.77	0.414
8'-0"	4'-2"	2'-0"	1'-6"	8"	#5	1'-0"	#4	1'-0"	60.19	0.486
9'-0"	4'-8"	2'-3"	1'-9"	8"	#4	6"	#4	6"	81.49	0.535
10'-0"	5'-2"	2'-6"	2'-0"	8"	#5	6"	#4	6"	97.25	0.584
11'-0"	5'-8"	2'-9"	2'-3"	8"	#6	6"	#5	6"	133.65	0.634
12'-0"	6'-2"	3'-0"	2'-6"	9"	#7	6"	#5	6"	162.29	0.721
13'-0"	6'-8"	3'-3"	2'-9"	11"	#7	6"	#5	6"	178.80	0.856
14'-0"	7'-2"	3'-6"	3'-0"	1'-0"	#8	6"	#5	6"	216.78	0.959
15'-0"	7'-8"	4'-0"	3'-0"	1'-1"	#9	6"	#6	6"	283.06	1.068
16'-0"	8'-2"	4'-6"	3'-0"	1'-3"	#9	6"	#6	6"	297.02	1.234

TABLE OF WINGWALL REINFORCING (2~Wings)			
Bar	Size	No.	Spa
DL	#5	~	1'-0"
DS	#5	~	1'-0"
E	#4	~	1'-0"
F	#4	~	1'-0"
G	#6	4	~
M	#4	4	~
P	#4	~	1'-0"
RS	#5	3	~
RL	#5	3	~
V	#4	~	1'-0"


TABLE OF ESTIMATED CULVERT TOEWALL QUANTITIES			
Bar	Size	No.	Spa
L	#4	~	1'-6"
Q	#4	1	~
Reinf (Lb/Ft)			2.45
Conc (CY/Ft)			0.037

WING DIMENSION CALCULATIONS:

Formulas: (All values are in Feet)
 $Hw = H + T + C - 0.250'$
 $A = (Hw - 0.333') (SL)$
 $B = (A) [\text{Tangent } (0 - 15^\circ)]$
 $Lw = (A) \div [\text{Cosine } (0 - 15^\circ)]$
For Cast-in-place culverts:
 $Ltw = [(N) (S) (N + 1) (U)] (\text{Cosine } 0) -$
For Precast culverts:
 $Ltw = [(N) (2U) (N + 1) (0.500')] (\text{Cosine } 0) -$
Total Wingwall Area (Two Wings ~ S.F.) = $(0.5) (Hw - 0.333') (Lw - A) +$

Hw = Height of Wingwall
SL:1 = Side Slope Ratio (Horizontal:1 Vertical)
A = Length of Short Wingwall
Lw = Length of Long Wingwall
Ltw = Culvert Toewall Length
N = Number of Culvert Spans
θ = Culvert Skew


See applicable box culvert standard for H, S, T, and U values.

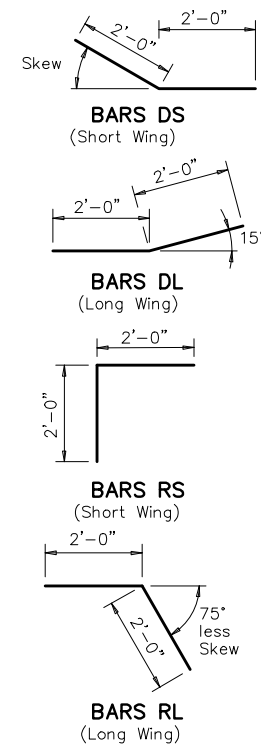

- Extend Bars P 3'-0" minimum into bottom slab of Box Culvert.
- Adjust to fit as necessary to maintain 1 1/4" clear cover and 4" minimum between bars.
- Quantities shown are based on an average wing height for two wings (one structure end). To determine total quantities for two wings multiply the tabulated values by 0.5 x (A+Lw).
- Recommended values of Slope are: 2:1, 3:1, 4:1, & 6:1.
- When shown elsewhere on the plans, a 5" deep concrete riprap shall be constructed. Payment for riprap shall be as required by Item 432, "Riprap". Unless otherwise shown on the plans or directed by the Engineer, the riprap shall have a 6" wide by 1'-6" deep reinforced concrete toewall along all edges adjacent to natural ground; the toewall shall be reinforced by extending typical riprap reinforcing into the toewall; construction joints or grooved joints, oriented in the direction of flow, shall extend across the full distance of the riprap, at intervals of approximately 20'. When such riprap is provided, the culvert toewall shown in SECTION B-B will not be required.
- At Contractor's option, Culvert Toewall may be ended flush with Wingwall Toewall. Adjust reinforcing from that shown as necessary.
- Applicable values of of Skew are: 15°, 30°, and 45°.
- Typical wingwall angle for all skews.
- 0" min to 5'-0" max. Estimated curb heights are shown elsewhere in the plans. For structures with pedestrian rail, bicycle rail or curbs taller than 1'-0", refer to ECD standard. For structures with T6 bridge rail, refer to T6-CM standard. For structures with traffic rail, other than T6, refer to RAC standard.
- For vehicle safety, curb heights and wall heights shall be reduced, if necessary, to provide a maximum 3" projection above finished grade. No changes will be made in quantities and no additional compensation will be allowed for this work.


GENERAL NOTES:

Designed according to AASHTO LRFD Specifications. All reinforcing steel shall be Grade 60. Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise. All concrete shall be Class "C" and shall have a minimum compressive strength of 3600 psi. All reinforcing bars shall be adjusted to provide a minimum of 1 1/4" clear cover. When structure is founded on solid rock, depth of toewalls for culverts and wingwalls may be reduced or eliminated as directed by the Engineer. See BCS sheet for additional dimensions and information. The quantities for concrete and reinforcing steel resulting from the formulas given on this sheet are for Contractor's information only.

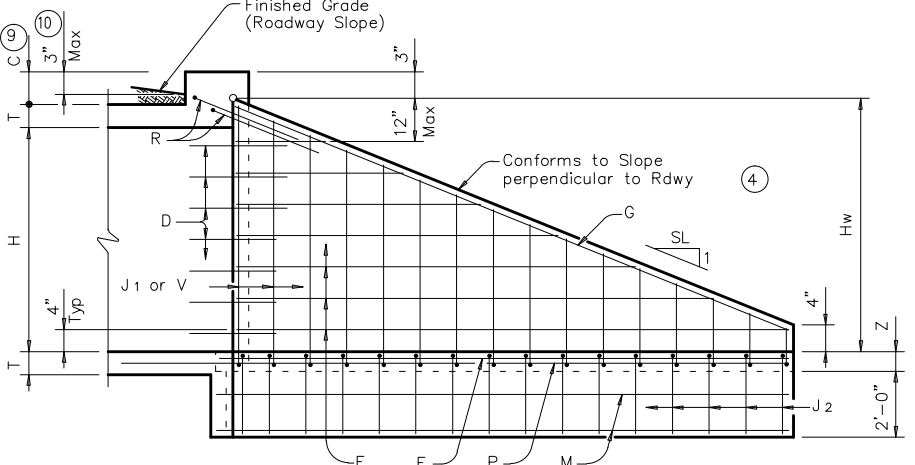


INSIDE ELEVATION

(Showing reinforcing. Culvert and Culvert Toewall reinforcing not shown for clarity.)

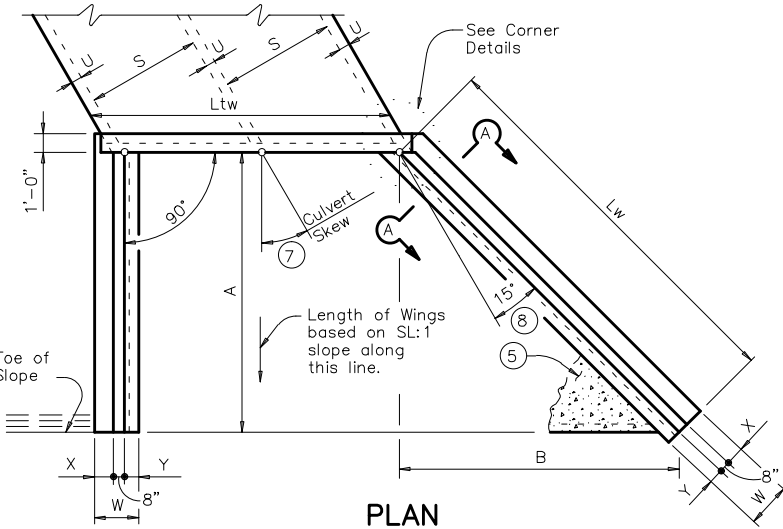


PLAN


(Showing dimensions and 30° Skew.)

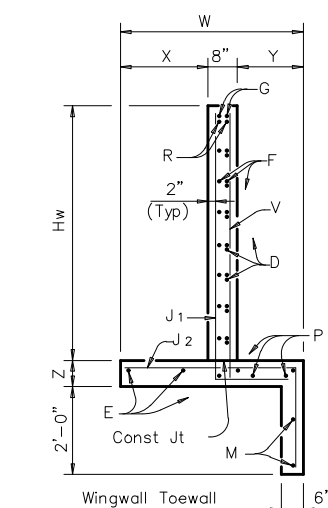


SECTION A-A

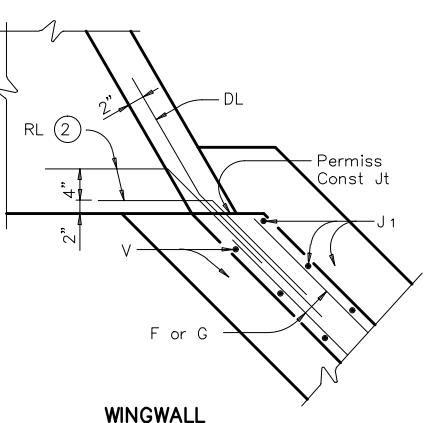

WINGWALL

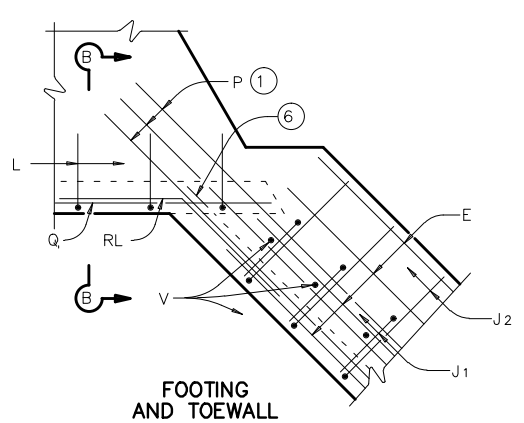

FOOTING AND TOEWALL

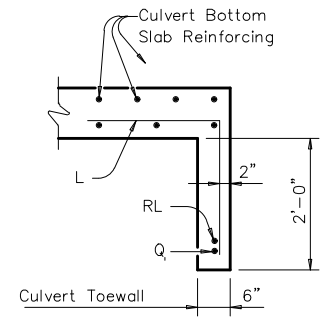

SECTION B-B

(5)



Bridge Division Standard

CONCRETE WINGWALLS WITH FLARED WINGS FOR SKEWED BOX CULVERTS

FW-S

FILE: fw-sside.dgn	DN: GAF	CK: CAT	DW: TxDOT	CK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	
11-10: Add note for synthetic fibers.				

APPR

DATE

ISSUER

REV

0

1

07/10/2018

04/21/2020

MAM

MAM

STORM DRAINAGE

CONCRETE WINGWALLS WITH FLARED WINGS FOR SKEWED BOX CULVERTS

DEPARTMENT OF ENGINEERING & MAPPING ENGINEERING DIVISION



City Service Center
448 State Highway 75
Huntsville, TX 77320

DATE: 04/21/2020
SCALE: NTS

SHEET 1 OF 1
SD-43